


AIR QUALITY DIVISION
CHAPTER 6, SECTION 3
OPERATING PERMIT

**WYOMING DEPARTMENT OF
ENVIRONMENTAL QUALITY**
AIR QUALITY DIVISION
122 West 25th Street
Cheyenne, Wyoming 82002

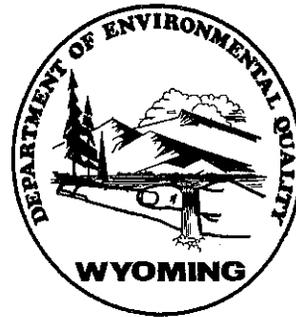

PERMIT NO. 3-0-229

Issue Date: **June 7, 2011**
Expiration Date: **June 7, 2016**
Effective Date: **June 7, 2011**
Replaces Permit No.: **N/A**

In accordance with the provisions of W.S. §35-11-203 through W.S. §35-11-212 and Chapter 6, Section 3 of the Wyoming Air Quality Standards and Regulations,

Cheyenne Light, Fuel, and Power Company
Wygen II Station
Section 27, Township 50 North, Range 71 West
Campbell County, Wyoming

is authorized to operate a stationary source of air contaminants consisting of emission units described in this permit. The units described are subject to the terms and conditions specified in this permit. All terms and conditions of the permit are enforceable by the State of Wyoming. All terms and conditions of the permit, except those designated as not federally enforceable, are enforceable by EPA and citizens under the Act. A copy of this permit shall be kept on-site at the above named facility.

Steven A. Dietrich
Steven A. Dietrich, Administrator
Air Quality Division

6-7-11
Date

John V. Corra
John V. Corra, Director
Department of Environmental Quality

6/8/11
Date

WAQSR CHAPTER 6, SECTION 3 OPERATING PERMIT

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY AIR QUALITY DIVISION

TABLE OF CONTENTS

General Information.....	3
Source Emission Points.....	4
Total Facility Estimated Emissions	4
Facility-Specific Permit Conditions.....	5
Facility-Wide Permit Conditions	5
Source-Specific Permit Conditions.....	5
Testing Requirements	6
Monitoring Requirements	7
Recordkeeping Requirements	8
Reporting Requirements	9
Time Limited Requirements	12
WAQSR Chapter 5, Section 2 and 40 CFR 60 Subpart Da Requirements.....	13
WAQSR Chapter 5, Section 3 and 40 CFR 60 Subpart Y Requirements.....	16
Compliance Certification and Schedule.....	18
Compliance Certification	18
Compliance Schedule.....	18
General Permit Conditions.....	19
State Only Permit Conditions	24
Acid Rain Permit Requirements	26
Summary of Source Emission Limits and Requirements	27
Abbreviations.....	30
Definitions.....	31
Appendix A: 40 CFR 60 Subpart Da (January 20, 2011 rule included for reference)	
Appendix B: 40 CFR 60 Subpart Y (October 8, 2009 rule included for reference)	
Appendix C: Acid Rain Permit Application	

GENERAL INFORMATION

Company Name: **Cheyenne Light, Fuel, and Power Company**

Mailing Address: **P.O. Box 1400**

City: **Rapid City** State: **South Dakota** Zip: **57709**

Plant Name: **Wygen II Station**

Plant Location: **Section 27, Township 50 North, Range 71 West, Campbell County, WY (five miles east of Gillette)**

Latitude = 44.17, Longitude = -105.23

Plant Mailing Address: **13151 Highway 51, HCR #81**

City: **Gillette** State: **Wyoming** Zip: **82718-9716**

Name of Owner: **Black Hills Corporation** Phone: **(605) 721-2286**

Responsible Official: **Mark Lux** Phone: **(303) 568-3241**

Designated Representative: **Mark Lux** Phone: **(303) 568-3241**

Plant Manager/Contact: **Derek Silbaugh** Phone: **(307) 682-3771 ext 2244**

DEQ Air Quality Contact: **District Three Engineer** Phone: **(307) 673-9337**
2100 West 5th Street
Sheridan, WY 82801

SIC Code: **4911**

Description of Process: **Wygen II Station is a 100 megawatt pulverized coal fired steam electric power generating facility.**

SOURCE EMISSION POINTS

This table may not include any or all insignificant activities at this facility.

SOURCE ID#	SOURCE DESCRIPTION	SIZE	CT, 6, SEC. 2 PERMITS
1	B & W Pulverized Coal Fired Boiler ¹	100 MW	CT-3030A3, wv-10325
2	Coal Bunker – Methane Vent ²	81.8 ton/hr	CT-3030A3, AP-9040
3	Lime Storage Silo ³	7 ton/hr	CT-3030A3
4A & 4B	Lime Slaker (one operates at a time) ⁴	2 ton/hr	wv-9761
5	Recycle Ash Storage Silo ³	12 ton/hr	wv-9761
6A & 6B	Recycle Ash Mix Tank (one operates at a time) ⁴	14 ton/hr	wv-9761
7	Waste Ash Silo – Bin ³	12 ton/hr	CT-3030A3
8A & 8B	Waste Ash Silo Exhauster (one operates at a time) ²	12 ton/hr	CT-3030A3

¹ Boiler is equipped with a baghouse for particulate control, atomizer spray dryer for SO₂ control, and selective catalytic reduction (SCR) for NO_x control.

² Particulate matter controlled with a baghouse.

³ Particulate matter controlled with bin vent dust collector.

⁴ Particulate matter controlled with a scrubber.

TOTAL FACILITY ESTIMATED EMISSIONS

For informational purposes only. These emissions are not to be assumed as permit limits.

POLLUTANT	EMISSIONS (TPY)
CRITERIA POLLUTANT EMISSIONS	
Particulate Matter	71
PM ₁₀ Particulate Matter	12
Sulfur Dioxide (SO ₂)	569
Nitrogen Oxides (NO _x)	399
Carbon Monoxide (CO)	854
Volatile Organic Compounds (VOCs)	57
HAZARDOUS AIR POLLUTANT (HAP) EMISSIONS	
OTHER - Sulfuric Acid (H ₂ SO ₄)	0.5

Emission estimates are from the operating permit application.

FACILITY-SPECIFIC PERMIT CONDITIONS

Facility-Wide Permit Conditions

- (F1) ACID RAIN AND TITLE IV ALLOWANCES
[WAQSR Ch 6, Sec 3(h)(i)(A)(II), Sec 3(h)(i)(D); W.S. 35-11-212(a)]
- (a) Where an applicable requirement of this operating permit is more stringent than an applicable requirement of the Acid Rain portion of this permit, both shall apply to the permittee and are enforceable by EPA and the Division.
- (b) Emissions from this facility shall not exceed any allowances that the permittee lawfully holds under title IV of the Clean Air Act or the regulations promulgated thereunder.
- (F2) SULFUR DIOXIDE EMISSIONS INVENTORY [WAQSR Ch 14, Sec 3]
The permittee shall comply with the requirements of WAQSR Ch 14, Sec 3, including estimating SO₂ emissions in accordance with Ch 14 Sec 3(b), and adjusting estimates in accordance with Ch 14 Sec 3(c), if necessary.
- (F3) PLANTWIDE FUGITIVE EMISSIONS [WAQSR Ch 6, Sec 2 Permit CT-3030A3]
Unpaved haul roads shall be treated with suitable chemical dust suppressants in addition to water to control fugitive dust emissions. All treated roads shall be maintained on a continuous basis to the extent that the surface treatment remains viable as a control measure.

Source-Specific Permit Conditions

- (F4) VISIBLE EMISSIONS [WAQSR Ch 6, Sec 2 Permit CT-3030A3 and Waiver wv-9761]
- (a) Visible emissions from the boiler (source 1) shall be limited to 20 percent opacity (6-minute average) except for one 6-minute period per hour of not more than 27 percent opacity in accordance with 40 CFR 60, Subpart Da, §60.42Da(b).
- (b) Visible emissions from all coal processing and conveying equipment (including breakers and crushers), coal storage systems, and coal transfer and loading systems (including source 2) shall be limited to less than 20 percent opacity as determined by 40 CFR 60, Appendix A, Method 9, unless a more stringent standard applies under 40 CFR 60 Subpart Y, condition P60-Y1 of this permit.
- (c) Visible emissions from any other source of emissions at this facility (including sources 3-8) shall be limited to 20 percent opacity in accordance with WAQSR Ch 3, Sec 2(a) as determined by 40 CFR 60, Appendix A, Method 9.
- (F5) BOILER EMISSIONS [WAQSR Ch 6, Sec 2 Permit CT-3030A3 and Waiver wv-10325]
Emissions from the boiler (source 1) shall not exceed the limits specified in Table I.

Table I: Boiler Emission Limits				
Pollutant	lb/MMBtu	lb/hr	lb/MW-hr	TPY
NO _x	0.07 (30-day rolling)	91.0 (30-day rolling)	1.0 (30-day rolling) ¹	399
SO ₂	0.10 (30-day rolling) 0.12 (3-hour block)	130.0 (30-day rolling) 156.0 (3-hour block)	1.4 (30-day rolling) ¹	569
PM/PM ₁₀ ²	0.012	15.6	-	68
CO	0.15	195.0	-	854
VOC	0.01	13.0	-	57
Hg	-	-	97x10 ⁻⁶ (12 month rolling) ¹	0.04

¹ 40 CFR 60 Subpart Da Limit

² Filterable PM/PM₁₀

- (F6) MATERIAL HANDLING [WAQSR Ch 6, Sec 2 Permit CT-3030A3 and Waiver wv-9761]
- (a) Particulate emissions from the material handling sources (sources 2-8) shall not exceed the limits specified in Table II.

Table II: Material Handling Particulate Emission Limits					
Source ID #	Source Description	Particulate Emission Limits			
		gr/dscf	dscfm ⁴	lb/hr	TPY
2	Coal Bunker – Methane Vent	0.009	4794	0.37	1.6
3	Lime Silo	0.01	1551	0.13	0.6
4A	Lime Slaker A / Lime Slaker B ¹	0.01	-	0.03	0.1
4B					
5	Recycle Ash Storage Silo	0.01	-	0.02	0.1
6A	Recycle Ash Mix Tank A / Recycle Ash Mix Tank B ²	0.01	-	0.03	0.1
6B					
7	Ash Silo	0.01	573.4	0.05	0.2
8A	Ash Exhauster A / Ash Exhauster B ³	0.01	1137	0.10	0.4
8B					

¹ Only one unit will be in service at any one time.

³ Only one unit will be in service at any one time.

² Only one unit will be in service at any one time.

⁴ Air flow rate is included for reference and is not a limit.

- (b) The permittee shall use a wet handling system for waste ash load-out. A pug mill rotary mixer shall be used to mix ash to a consistent moisture content of approximately 15 to 25 percent prior to loading into the haul truck.
- (c) Lime and ash shall be entirely enclosed in the haul trucks whenever the wet handling system is not operating.

Testing Requirements

(F7) SOURCE TESTING [WAQSR Ch, 6, Sec 2 Permit CT-3030A3; Ch 6, Sec 3(h)(i)(C)(I); W.S. 35-11-110; 40 CFR 60 Subpart Da]

- (a) The permittee shall measure particulate emissions from the boiler (source 1) at least once every 12 months in accordance with Subpart Da and condition P60-Da2 of this permit. The permittee shall determine particulate emissions (filterable PM/PM₁₀) in both lb/MMBtu and lb/hr for comparison with the limits in condition F5. Methods 1-4 and 5 shall be used to measure particulate emissions.
- (b) The permittee shall measure CO emissions from the boiler (source 1) at least annually for comparison with the emission limits specified in condition F5. Methods 1-4, or a 40 CFR Part 75 certified flow monitor, shall be used to determine actual flow rate in the stack. Method 10 shall be used to measure CO emissions.
- (c) The permittee shall measure VOC emissions from the boiler (source 1) at least annually for comparison with the emissions limits specified in condition F5. Method 18 and 25, or equivalent, shall be used to measure VOC emissions.
- (d) Testing shall be conducted in accordance with WAQSR Chapter 5, Section 2(h).

(F8) ADDITIONAL EMISSIONS TESTING

[W.S. 35-11-110; 40 CFR 60 Subpart Da; WAQSR Ch, 6, Sec 2 Permit CT-3030A3]

- (a) The Division reserves the right to require additional testing as provided under condition G1 of this permit. Should testing be required, test methods found at 40 CFR 60, Appendix A, shall be used as follows:
 - (i) For the boiler, visible, NO_x and SO₂ emissions shall be measured as specified in 40 CFR 60 Subpart Da §60.48Da.
 - (ii) For the boiler, particulate emissions shall be measured as specified in 40 CFR 60 Subpart Da §60.50Da and Methods 1-4 and 5.
 - (iii) For visible emissions from other sources, Method 9 shall be used.
 - (iv) For particulate emissions from other sources, Methods 1-4 and 5 shall be used.
 - (v) For CO emissions, Methods 1-4 and 10 shall be used.
 - (vi) For VOC emissions, Method 18 and 25 shall be used.

- (vii) For alternative test methods, or methods used for other pollutants, the approval of the Administrator must be obtained prior to using the test method to measure emissions.
- (b) Unless otherwise specified, testing shall be conducted in accordance with WAQSR Ch 5, Sec 2(h).

Monitoring Requirements

- (F9) **VISIBLE EMISSIONS MONITORING** [WAQSR Ch 6, Sec 3(h)(i)(C)(I); Ch 6, Sec 2 Permit CT-3030A3]
 - (a) The permittee shall calibrate, operate and maintain a monitoring system for measuring the opacity of the emissions from the boiler (source 1) in accordance with the following:
 - (i) Condition P60-Da3 of this permit.
 - (ii) 40 CFR 60, Appendix B, Performance Specification 1, unless otherwise specified in Subpart Da.
 - (b) The permittee shall conduct, at minimum once daily, visual observations of the material handling control equipment (sources 2-8) to determine the presence of visible emissions.
 - (i) The visual observations shall be conducted by a person who is educated on the procedures for determining the presence of visible emissions in accordance with Method 22.
 - (ii) Observation of any visible emissions shall prompt immediate inspection and, if necessary, corrective actions.

- (F10) **BOILER EMISSIONS MONITORING** [WAQSR Ch 6, Sec 3(h)(i)(C)(I); Ch 6, Sec 2 Permit CT-3030A3; Ch 14, Sec 4; February 26, 2010 Division Letter]
 - (a) The permittee shall calibrate, operate, and maintain a monitoring system for measuring NO_x emissions discharged to the atmosphere in units of lb/MW-hr, lb/MMBtu, and lb/hr. The NO_x monitoring system shall comply with condition P60-Da3 of this permit and consist of the following:
 - (i) A continuous emission NO_x monitor located in the boiler stack.
 - (ii) A continuous flow monitoring system for measuring the flow of exhaust gases discharged into the atmosphere.
 - (iii) A watt meter to measure gross electrical output in megawatt-hours on a continuous basis.
 - (iv) An in-stack oxygen or carbon dioxide monitor for measuring oxygen or carbon dioxide content of the flue gas at the location NO_x emissions are monitored.
 - (b) The permittee shall calibrate, operate, and maintain a monitoring system for measuring SO₂ emissions discharged to the atmosphere in units of lb/MW-hr, lb/MMBtu, and lb/hr. Emissions in lb/hr shall be determined using both a 30-day rolling average (in compliance with the procedures of Subpart Da) and a 3-hour block average. The SO₂ monitoring system shall comply with condition P60-Da3 of this permit and consist of the following:
 - (i) Continuous emissions SO₂ monitors located at the outlet to the SO₂ control device.
 - (ii) A continuous flow monitoring system for measuring the flow of exhaust gases discharged into the atmosphere.
 - (iii) An in-stack oxygen or carbon dioxide monitor for measuring oxygen or carbon dioxide content of the flue gas at the location of the SO₂ monitor.
 - (c) The continuous monitoring systems described in (a) and (b) above shall comply with the following unless otherwise specified in 40 CFR 60, Subpart Da:
 - (i) 40 CFR 60, Appendix B, Performance Specification 2. The monitoring system must demonstrate linearity in accordance with Division requirements and be certified in both concentration (ppm) and units of the standard (lb/MMBtu, lb/MW-hr, and lb/hr).
 - (ii) Quality Assurance requirements of 40 CFR 60, Appendix F or 40 CFR 75, Appendix B.
 - (d) Compliance with the lb/MW-hr NO_x, SO₂ and Hg emission limits in condition F5 shall be determined in accordance with 40 CFR 60 Subpart Da.
 - (e) For PM/PM₁₀ emissions, the permittee shall perform the testing required by condition F7(a).
 - (f) For CO emissions, the permittee shall perform the testing required by condition F7(b).
 - (g) For VOC emissions, the permittee shall perform the testing required by condition F7(c).
 - (h) The permittee shall certify, operate and maintain a continuous emissions monitoring system for measuring mercury emissions from the boiler (source 1) in accordance with 40 CFR 75 Appendices A and B.
 - (i) Procedures specified in 40 CFR 60 Method 30B and Performance Specification 12A should be used as guidelines for the certification testing. Mercury CEMS certification testing reports are required to be submitted to the Division for review.

- (ii) Quality Assurance Monitoring Provisions outlined in 40 CFR 75 are required to evaluate the quality of data collected by mercury CBMS.

(F11) FUGITIVE EMISSIONS AND MATERIAL HANDLING MONITORING

[WAQSR Ch 6, Sec 3(h)(i)(C)(I); Ch 6, Sec 2 Permit CT-3030A3]

- (a) For the treatment of unpaved haul roads, the permittee shall monitor the amount and dates of application of chemical dust suppressants and water in order to assess compliance with condition F3.
- (b) The permittee shall monitor the quantity of water supplied to the pug mill spray nozzles and the quantity of ash loaded each calendar month. At the end of each calendar month, the permittee shall calculate the moisture content of the waste ash by dividing the mass of water used by the mass of waste ash and water combined.
- (c) The permittee shall note the dates that the wet handling system is not operating and whether or not the haul trucks are covered.

(F12) AMBIENT MONITORING [WAQSR Ch 6, Sec 2 Permit CT-3030A3; W.S. 35-11-110]

- (a) The permittee shall operate an approved ambient SO₂ monitoring program in accordance with the requirements of 40 CFR Parts 50 and 58.
- (b) The meteorological monitoring program shall comply with the Quality Assurance Handbook for Air Pollution Measurement Systems Volume IV: Meteorological Measurements Version 2.0 (Final), EPA-454/B-08-002.
- (c) The permittee shall maintain and comply with a quality assurance plan (QAPP) for the monitoring network, as required by 40 CFR 58 and approved by the Division.

Recordkeeping Requirements

(F13) SULFUR DIOXIDE EMISSIONS INVENTORY RECORDS [WAQSR Ch 14, Sec 3(b)]

- (a) The permittee shall maintain all records used in the calculation of SO₂ emissions for the inventory required by condition F2, including but not limited to the following:
 - (i) Amount of fuel consumed;
 - (ii) Percent sulfur content of fuel and how the content was determined;
 - (iii) Quantity of product produced;
 - (iv) Emissions monitoring data;
 - (v) Operating data; and
 - (vi) How the emissions are calculated, including monitoring/estimation methodology with a demonstration that the selected methodology is acceptable under Ch 14, Sec 3.
- (b) The permittee shall maintain records of any physical changes to facility operations or equipment, or any other changes (e.g. raw material or feed) that may affect emissions projections of SO₂.
- (c) The permittee shall retain all records and support information for compliance with this condition and with the reporting requirements of condition F19 at the facility, for a period of **at least ten (10) years** from the date of establishment, or if the record was the basis for an adjustment to the milestone, five years after the date of an implementation plan revision, whichever is longer.

(F14) TESTING RECORDS [WAQSR Ch 6, Sec 3(h)(i)(C)(II)]

- (a) For any testing required under conditions F7 and F8, other than Method 9 or Method 22 observations, the permittee shall record, as applicable, the following:
 - (i) The date, place, and time of sampling or measurements;
 - (ii) The date(s) the analyses were performed;
 - (iii) The company or entity that performed the analyses;
 - (iv) The analytical techniques or methods used;
 - (v) The results of such analyses;
 - (vi) The operating conditions and parameters as they existed at the time of sampling or measurement; and
 - (vii) Any corrective actions taken.
 - (viii) For any testing of the boiler (source 1), any additional records required by condition P60-Da4 and Subpart Da.

- (b) The permittee shall retain on-site at the facility the records of each test, measurement, or observation and support information for a period of at least five years from the date of the test, measurement, or observation.
- (F15) **VISIBLE EMISSIONS RECORDS**
[WAQSR Ch 6, Sec 3(h)(i)(C)(II); Ch 6, Sec 2 Permit CT-3030A3; Ch 5, Sec 2; 40 CFR 60 Subpart Da]
- (a) For the boiler (source 1), the permittee shall meet the continuous opacity emissions recordkeeping provisions of P60-Da4 and Subpart Da.
- (b) For the visual observations of the material handling equipment required by condition F9(b), the permittee shall:
- (i) Keep field records in accordance with Sections 11.2 and 11.5 of Method 22; and
- (ii) Document any corrective actions taken in response to visible emissions.
- (c) For any Method 9 observations required by the Division under condition F8, the permittee shall keep field records in accordance with Section 2.2 of Method 9.
- (d) The permittee shall retain on-site at the facility the records kept in accordance with this condition for a period of at least five years from the date such records are generated.
- (F16) **BOILER CONTINUOUS EMISSIONS MONITORING RECORDS** [WAQSR Ch 6, Sec 3(h)(i)(C)(II); Ch 6, Sec 2 Permit CT-3030A3; Ch 5, Sec 2; 40 CFR 60 Subpart Da; 40 CFR 75 Subpart F]
For the boiler (source 1), the permittee shall meet the applicable continuous emissions recordkeeping provisions of P60-Da4, Subpart Da, and 40 CFR 75, Subpart F.
- (a) Records of the data, calculations, and assumptions used to determine NO_x and SO₂ emissions in lb/MW-hr, lb/MMBtu, and lb/hr on a 30-day rolling average shall also be maintained.
- (b) Records of the data, calculations, and assumptions used to determine SO₂ emissions in lb/hr and lb/MMBtu on a 3-hour block average, as well as each 3-hour block average, shall be maintained.
- (c) The permittee shall retain on-site at the facility the records kept in accordance with this condition for a period of at least five years from the date such records are generated.
- (F17) **FUGITIVE EMISSIONS AND MATERIAL HANDLING RECORDS**
[WAQSR Ch 6, Sec 2 Permit CT-3030A3]
- (a) For the unpaved haul roads, the permittee shall maintain records of the dates and amounts of chemical dust suppressant applied, dates of water application, and the total annual amount of water applied, in accordance with condition F3.
- (b) The permittee shall maintain monthly records of the quantity of water supplied to the pug mill spray nozzles and the quantity of ash loaded, as well as the monthly calculation of moisture content of the waste ash.
- (c) The permittee shall maintain records of dates that the wet handling system is not operating and whether or not the haul trucks are covered.
- (d) The permittee shall retain on-site at the facility the records kept in accordance with this condition for a period of at least five years from the date such records are generated.
- (F18) **AMBIENT MONITORING RECORDS**
[WAQSR Ch 6, Sec 3(h)(i)(C)(II); Ch 6, Sec 2 Permit CT-3030A3; W.S. 35-11-110]
- (a) The permittee shall maintain records of the data generated by the meteorological monitoring and ambient SO₂ monitoring networks required by condition F12 in accordance with 40 CFR 50 and 58.
- (i) Records shall include site visits and quality control checks, as well as detailed records of any monitor malfunctions.
- (b) The permittee shall retain on-site at the facility the ambient monitoring records for a period of at least five years from the date such records are generated.

Reporting Requirements

- (F19) **SULFUR DIOXIDE EMISSIONS INVENTORY REPORTS** [WAQSR Ch 14, Sec 3(b) and (c)]
- (a) The permittee shall report calendar year SO₂ emissions by April 15th of the following year. The inventory shall be submitted in the format specified by the Division.
- (b) Emissions from startup, shutdown, and upset conditions shall be included in the inventory.

- (c) If the permittee uses a different emission monitoring or calculation method than was used to report SO₂ emissions in 1999, the permittee shall adjust reported SO₂ emissions to be comparable to the emission monitoring or calculation method that was used in 1999. The calculations that are used to make this adjustment shall be included with the annual emission report.
- (d) For acid rain sources, the permittee shall submit a summary report of annual SO₂ emissions that were reported to the EPA under 40 CFR Part 75.
- (e) The permittee shall use 40 CFR Part 75 methodology for reporting SO₂ emissions for all sources subject to the federal acid rain program.
- (f) The annual reports shall reference this permit condition (F19) and shall be submitted in accordance with condition G4 of this permit.

(F20) TEST REPORTS [WAQSR Ch 6, Sec 3(h)(i)(C)(III)]

- (a) The permittee shall report the results of any emissions tests required under conditions F7, P60-Da2, and P60-Da3, and any additional testing required by the Division under condition F8, within 45 days of conducting the tests.
- (b) The reports shall include the information specified under conditions F14 and F15, as applicable, reference this permit condition (F20), and shall be submitted to the Division in accordance with condition G4.

(F21) MONITORING REPORTS [WAQSR Ch 6, Sec 3(h)(i)(C)(III)]

- (a) The following shall be reported to the Division by January 31 and July 31 each year:
 - (i) For the visible observations required by condition F9(b), the date, time, and duration of visible emissions and a brief description of any corrective actions taken. If no exceedance occurred during the reporting period, this shall be stated in the report.
- (b) All instances of deviations from condition F9(b) must be clearly identified in each report.
- (c) The semiannual reports shall reference this permit condition (F21) and shall be submitted in accordance with condition G4 of this permit.

(F22) GREENHOUSE GAS REPORTS [W.S. 35-11-110]

The permittee shall submit to the Division a summary of any report(s) required to be submitted to the EPA under 40 CFR Part 98.

- (a) The report(s) shall be submitted to the Division within 60 days of submission to EPA, in a format as specified by the Division.
- (b) The report(s) shall be submitted in accordance with condition G4(a)(i) of this permit, to the attention of the Division's Emission Inventory Program. A copy need not be sent to the DEQ Air Quality contact.

(F23) BOILERS COMPLIANCE & MONITORING SYSTEM PERFORMANCE REPORTS

[WAQSR Ch 5, Sec 2(g); Ch 6, Sec 3(h)(i)(C)(III); Ch 6, Sec 2 Permit CT-3030A3; 40 CFR 60 Subpart Da]

- (a) The permittee shall submit a Subpart Da emissions and monitoring systems performance report (excess emissions are defined in paragraph (b) of this condition) and/or a summary report form (see paragraph (a)(v) of this condition) to the Administrator quarterly. All reports shall be postmarked by the 30th day following the end of each calendar quarter. Written reports shall be in a format approved by the Division and shall include the following information:
 - (i) A summary of any performance evaluation of the continuous monitors conducted during the quarter, as described by the applicable requirements of §60.51Da(a).
 - (ii) For SO₂ and NO_x, the information listed in §60.51Da(b) shall be reported for each 24-hour period.
 - (iii) If the minimum quantity of emission data as required by condition P60-Da3 of this permit is not obtained for any 30 successive boiler operating days, the information described in §60.51Da(c) shall also be included.
 - (iv) If the SO₂ emission standards in P60-Da1 are exceeded during emergency conditions because of control system malfunction, a signed statement in accordance with §60.51Da(d).
 - (v) For any periods for which opacity, SO₂ or NO_x emissions data are not available, a signed statement in accordance with §60.51Da(f).
 - (vi) For mercury, the information described in §60.51Da(g).

- (vii) A signed statement in accordance with §60.51Da(h).
 - (viii) The magnitude of excess emissions computed in accordance with WAQSR Chapter 5, Section 2(j)(viii), any conversion factor(s) used, the date and time of commencement and completion of each time period of excess emissions, and the process operating time during the reporting period.
 - (ix) Specific identification of each period of excess emissions that occurs during startups, shutdowns, malfunctions of each boiler, the nature and cause of any malfunction (if known), and the corrective action taken or preventative measures adopted.
 - (x) The date and time identifying each period during which the continuous monitoring system was inoperative except for zero and span checks and the nature of the system repairs or adjustments.
 - (xi) When no excess emissions have occurred or the continuous monitoring system(s) have not been in operative, repaired, or adjusted, such information shall be stated in the report.
 - (xii) One summary report form for each pollutant monitored at each affected facility in a format approved by the Division.
 - (A) If the total duration of excess emissions for the reporting period is less than one percent of the total operating time for the reporting period and continuous monitoring system downtime for the reporting period is less than five percent of the total operating time for the reporting period, only the summary report form shall be submitted and the excess emission report described in paragraph (a) of this condition need not be submitted unless requested by the Administrator.
 - (B) If the total duration of excess emissions for the reporting period is one percent or greater of the total operating time for the reporting period or the total continuous monitoring system downtime for the reporting period is five percent or greater of the total operating time for the reporting period, the summary report form and the excess emission report described in paragraph (a) of this condition shall both be submitted.
- (b) For the purposes of reporting under this condition, excess emissions are defined as follows:
- (i) Any 30-day rolling average which exceeds the lb/MMBtu NO_x or SO₂ limits in condition F5, as calculated using the following formula:

$$E_{avg} = \frac{\sum_{h=1}^n (C)_h}{n}$$

Where:

C = 1-hour average emission rate (lb/MMBtu) for hour "h" calculated using valid data from the CEM equipment required by condition F10 and the procedures in 40 CFR 60, Appendix A, Method 19. Valid data shall meet the requirements of WAQSR, Ch 5, Sec 2(j).

E_{avg} = Weighted 30-day rolling average emission rate (lb/MMBtu).

n = The number of unit operating hours in the 30-day period with valid emissions data meeting the requirements of WAQSR Ch 5, Sec 2(j).

- (ii) Any 30-day rolling average which exceeds the lb/MW-hr NO_x or SO₂ limits calculated in accordance with 40 CFR 60.48Da, 60.49Da, and 60.50Da.
- (iii) Any 30-day rolling average calculated using valid data (output concentration and average hourly volumetric flowrate) from the CEM equipment, required by condition F10, which exceeds the lb/hr NO_x or SO₂ limits established in condition F5. Valid data shall meet the requirements of WAQSR Ch 5, Sec 2(j). The 30-day average emission rate shall be calculated at the end of each boiler operating day (as defined in 40 CFR 60.41Da) as the arithmetic average of hourly emissions with valid data during the previous 30-boiler operating day period.
- (iv) Any 3-hour block average of SO₂ calculated using valid data (output concentration and average hourly volumetric flowrate) from the CEM equipment, required by condition F10, which exceeds the lb/hr or lb/MMBtu limit established in condition F5. Valid data shall meet the requirements of WAQSR Ch 5, Sec 2(j). The 3-hour average emission rate shall be calculated at the end of each 3-hour operating block as the arithmetic average of hourly emissions with valid data during the previous three operating hours.

- (v) Any 6-minute average opacity, except for one 6-minute period per hour of not more than 27 percent opacity, in excess of 20 percent in accordance with 40 CFR 60.42Da(b).
 - (vi) Any 12-month rolling average which exceeds the lb/MW-hr Hg limits calculated in accordance with 40 CFR 60.48Da, 60.49Da, and 60.50Da.
 - (c) The permittee shall comply with all reporting requirements as specified in WAQSR Ch 5, Sec 2(g) and 40 CFR 60, Subpart Da.
 - (i) Reporting for the 30-day rolling lb/hr NO_x and SO₂ limits shall follow the same requirements as the 40 CFR 60, Subpart Da lb/MW-hr standards.
 - (ii) Reporting for the 3-hour fixed SO₂ emission rates shall follow the same requirements as the 40 CFR 60, Subpart Da lb/MW-hr standards.
 - (iii) Reporting for the 30-day rolling lb/MW-hr NO_x and SO₂ limits shall follow the requirements of 40 CFR 60, Subpart Da.
 - (d) The reports shall reference this condition (F23) and be submitted to the Division in accordance with condition G4 of this permit.
- (F24) AMBIENT MONITORING REPORTS [WAQSR Ch 6, Sec 3(h)(i)(C)(III); Ch 6, Sec 2 Permit CT-3030A3]
- (a) The data generated by the meteorological and SO₂ monitoring networks, required by condition F12, shall be submitted to the Division in an approved electronic format within 60 days of the end of each calendar quarter.
 - (b) In addition to the electronic submission, the permittee shall submit written certification to the Division in accordance with condition G4 of this permit.
- (F25) REPORTING EXCESS EMISSIONS & DEVIATIONS FROM PERMIT REQUIREMENTS [WAQSR Ch 6, Sec 3(h)(i)(C)(III)]
- (a) General reporting requirements are described under the General Conditions of this permit. The Division reserves the right to require reports as provided under condition G1 of this permit.
 - (b) Emissions which exceed the limits specified in this permit and which are not reported under a different condition of this permit shall be reported annually with the emission inventory unless specifically superseded by condition G17, condition G19, or other condition(s) of this permit. The probable cause of such exceedance, the duration of the exceedance, the magnitude of the exceedance, and any corrective actions or preventative measures taken shall be included in this annual report. For sources and pollutants which are not continuously monitored, if at any time emissions exceed the limits specified in this permit by 100 percent, or if a single episode of emission limit exceedance spans a period of 24 hours or more, such exceedance shall be reported to the Division within one working day of the exceedance. (Excess emissions due to an emergency shall be reported as specified in condition G17. Excess emissions due to unavoidable equipment malfunction shall be reported as specified in condition G19.)
 - (c) Any other deviation from the conditions of this permit shall be reported to the Division in writing within 30 days of the deviation or discovery of the deviation.

Time Limited Requirements

- (F26) IRON COMPOUND PROJECT REQUIREMENTS [WAQSR Ch 6, Sec 2 Waiver wv-10325]
- (a) The permittee shall maintain and operate the baghouse during all periods when the iron compound is injected such that the baghouse remains effective as a particulate matter (PM) emissions control device.
 - (b) The boiler shall not exceed the limits set forth in condition F5 of this permit.
- (F27) IRON COMPOUND PROJECT REPORT [WAQSR Ch 6, Sec 2 Waiver wv-10325]
The permittee shall submit to the Division a report documenting the amount of iron compound injected and resulting PM emissions from the process within 45 days of test completion.
- (F28) IRON COMPOUND PROJECT DEADLINE [WAQSR Ch 6, Sec 2 Waiver wv-10325]
Authorization for the addition of iron compound to the boiler, as allowed by waiver wv-10325, expires on June 1, 2011.

**WAQSR CHAPTER 5, SECTION 2 NEW SOURCE PERFORMANCE STANDARDS (NSPS) AND
40 CFR 60 SUBPART Da REQUIREMENTS FOR ELECTRIC UTILITY STEAM GENERATING UNITS
FOR WHICH CONSTRUCTION IS COMMENCED AFTER SEPTEMBER 18, 1978**

(Subpart Da is provided in Appendix A)

- (P60-Da1) SUBPART Da REQUIREMENTS [40 CFR 60 Subpart Da and WAQSR Ch 5, Sec 2]
The permittee shall meet all requirements of WAQSR Chapter 5, Section 2 and 40 CFR 60 Subpart Da as they apply to each electric utility steam generating unit defined under §60.40Da, including the boiler (source 1).
- (a) The permittee shall meet all applicable standards for opacity as specified in §60.42Da(b).
 - (b) The permittee shall meet all applicable standards for particulate emissions as specified in §60.42Da.
 - (c) The permittee shall meet all applicable standards for SO₂ emissions as specified in §60.43Da.
 - (d) The permittee shall meet all applicable standards for NO_x emissions as specified in §60.44Da.
 - (e) The permittee shall meet all applicable standards for mercury emissions as specified in §60.45Da(a).
 - (f) The particulate matter and the NO_x emission standards in 40 CFR 60 Subpart Da apply at all times except during periods of startup, shutdown, and malfunction. The SO₂ emission standards in Subpart Da apply at all times except during periods of startup, shutdown, or when both emergency conditions exist and the procedures under §60.48Da(d) are implemented.
- (P60-Da2) COMPLIANCE DETERMINATION AND GOOD AIR POLLUTION CONTROL PRACTICE
[40 CFR 60 Subpart Da §§60.48Da and 60.50Da; WAQSR Ch 5, Sec 2(h) and (i)]
- (a) At all times, including periods of startup, shutdown, and malfunction, the permittee shall, to the extent practicable, maintain and operate any affected facility, including associated air pollution control equipment, in a manner consistent with good air pollution control practice for minimizing emissions.
 - (b) In conducting any performance tests required by Subpart Da, the permittee shall use as reference methods and procedures the methods in appendix A of Part 60 or the methods and procedures as specified in Subpart Da, except as provided in WAQSR Ch 5, Sec 2(h)(ii). WAQSR Ch 5, Sec 2(h)(v) does not apply to performance tests for SO₂ and NO_x. Acceptable alternative methods are given in §60.50Da(e).
 - (c) For particulate matter:
 - (i) Except as provided in §60.48Da(p), the permittee shall demonstrate compliance with each applicable particulate emission limit according to §60.48Da(o).
 - (ii) The permittee shall determine compliance as required by §60.50Da(b) and (e).
 - (d) For SO₂:
 - (i) Compliance with the applicable SO₂ emission limitations and percentage reduction requirements in Subpart Da is based on the average emission rate for 30 successive boiler operating days, calculated at the end of each boiler operating day, in accordance with §60.48Da(e).
 - (ii) The permittee shall determine compliance as specified in the applicable requirements of §§60.48Da(g), (h), and (m); and 60.50Da(c) and (e).
 - (e) For NO_x:
 - (i) Compliance with the applicable NO_x emission limitations in Subpart Da is based on the average emission rate for 30 successive boiler operating days, calculated at the end of each boiler operating day, in accordance with §60.48Da(e).
 - (ii) The permittee shall determine compliance as specified in the applicable requirements of §§60.48Da(g), (h), (i), and (m); and 60.50Da(d) and (e).
 - (f) For mercury:
 - (i) Compliance with the applicable mercury emission limitations in 40 CFR 60 Subpart Da is determined on a 12-month rolling average basis, in accordance with §60.48Da(l).
 - (ii) The permittee shall determine compliance as specified in the applicable requirements of §§60.48Da(l) and 60.50Da(h).

(P60-Da3) EMISSIONS MONITORING [40 CFR 60 Subpart Da §§60.48Da and 60.49Da; WAQSR Ch 5, Sec 2(j); and Ch 6, Sec 2 Permit CT-3030A3]

The permittee shall calibrate, maintain, and operate continuous monitoring systems for emissions from the boiler as described in 40 CFR 60 Subpart Da, WAQSR Ch 5, Sec 2(j), and condition F10.

- (a) Except as provided for in §60.49Da(a)(2), the permittee shall calibrate, maintain, and operate a continuous monitoring system, and record the output of that system, for measuring the opacity of emissions discharged to the atmosphere. The system shall meet the applicable requirements of §60.49Da(a)(1).
 - (i) The continuous opacity monitoring system (COMS) shall meet the requirements of §60.48Da(o)(2) unless the permittee elects to comply with an applicable alternative in §60.48Da(o)(3) or (4).
- (b) The permittee shall calibrate, maintain, and operate a continuous emission monitoring system (CEMS), and record the output of that system, for measuring the SO₂ emissions discharged to the atmosphere. The CEMs shall meet the requirements of §60.49Da(b).
- (c) The permittee shall calibrate, maintain, and operate a CEMS, and record the output of that system, for measuring the NO_x emissions discharged to the atmosphere. The CEMs shall meet the requirements of §60.49Da(c).
- (d) The permittee shall calibrate, maintain, and operate a CEMS, and record the output of that system, for measuring the oxygen or carbon dioxide content of the flue gases as described in §60.49Da(d).
- (e) The CEMS described by paragraphs (b), (c), and (d) above shall be operated and data recorded during all periods of operation of the unit, including periods of startup, shutdown, and malfunction or emergency conditions, except for CEMS breakdowns, repairs, calibration checks, and zero and span adjustments.
 - (i) The permittee shall obtain emission data for at least 90 percent of all operating hours for each 30 successive boiler operating days.
 - (ii) If this minimum data requirement cannot be met with a CEMS, the permittee shall supplement emission data with the reference methods and procedures described in §60.49Da(h) and (j).
 - (iii) The permittee shall follow the applicable procedures in §60.49Da(g), (w), and (i) or (j), and WAQSR Ch 5 Sec 2(j).
- (f) The permittee shall calibrate, maintain, and operate a CEMS, and record the output of that system, for measuring the mercury emissions discharged to the atmosphere as required by §60.49Da(p) and (r). Alternatively, for an affected facility that is also subject to the requirements of subpart I of 40 CFR Part 75, the permittee may install, certify, maintain, operate and quality-assure the data from a mercury CEMS according to §75.10 and appendices A and B to part 75.
 - (i) Mercury CEMS data collection shall conform to the requirements of §60.49Da(p)(4).
- (g) To demonstrate compliance with an output-based standard, the permittee shall comply with the applicable provisions of §60.49Da(k), and (l) or (m).
- (h) The permittee shall prepare and submit to the Division for approval a unit-specific monitoring plan for each monitoring system, at least 45 days before commencing certification testing of the monitoring systems. The permittee shall comply with the requirements in the plan. The plan must address the requirements in §60.49Da(s)(1) through (6).
- (i) The permittee may request approval from the Division for alternatives to the monitoring requirements in this condition in accordance with WAQSR Ch 5 Sec 2(j)(ix) and (x).

(P60-Da4) RECORDKEEPING [40 CFR 60 Subpart Da §60.52Da and WAQSR Ch 5, Sec 2(g)(ii) & (g)(v)]

The permittee shall maintain records as required by WAQSR Ch 5 Sec 2(g), §60.52Da, and condition F16.

- (a) The permittee shall maintain records of the occurrence and duration of any startup, shutdown, or malfunction in the operation of an affected facility; any malfunction of the air pollution control equipment; or any periods during which a continuous monitoring system or monitoring device is inoperative.
- (b) The permittee shall maintain records of all measurements, including CMS, monitoring device, and performance testing measurements; all CMS performance evaluations; all CMS or monitoring device calibration checks; adjustments and maintenance performed on these systems or devices; and all other information required by the P60 conditions of this permit in a permanent form suitable for inspection. These records shall be retained on-site at the facility for a period of at least five years from the date such records are generated.

(P60-Da5) REPORTING [40 CFR 60 Subpart Da §60.51Da and WAQSR Ch 5, Sec 2(g)(iii) and (iv)]
The permittee shall submit reports as described in WAQSR Ch 5 Sec 2(g), §60.51Da, and conditions F20 and F23.

**WAQSR CHAPTER 5, SECTION 2 NEW SOURCE PERFORMANCE STANDARDS (NSPS) AND
40 CFR PART 60 SUBPART Y REQUIREMENTS FOR COAL PREPARATION PLANTS**

(Subpart Y is provided in Appendix B)

- (P60-Y1) SUBPART Y REQUIREMENTS [40 CFR Part 60 Subpart Y and WAQSR Ch 5, Sec 2]
- (a) The permittee shall meet all requirements of 40 CFR Part 60 Subpart Y and WAQSR Ch 5, Sec 2 as they apply to the affected facilities as defined under §60.250 in coal preparation plants which process more than 181 Mg (200 tons) of coal per day, including: Thermal dryers, pneumatic coal-cleaning equipment (air tables), coal processing and conveying equipment (including breakers and crushers), coal storage systems, coal transfer and loading systems, and open storage piles. This includes the coal bunker-methane vent (source 2).
- (i) The provisions in §60.251, §60.252(a), §60.253(a), §60.254(a), §60.255(a), and §60.256(a) of Subpart Y are applicable to any of the following affected facilities that commenced construction, reconstruction or modification after October 27, 1974, and on or before April 28, 2008: Thermal dryers, pneumatic coal-cleaning equipment (air tables), coal processing and conveying equipment (including breakers and crushers), and coal storage systems, transfer and loading systems. This includes the coal bunker-methane vent (source 2).
- (ii) The provisions in §60.251, §60.252(b)(1) and (c), §60.253(b), §60.254(b), §60.255(b) through (h), §60.256(b) and (c), §60.257, and §60.258 of Subpart Y are applicable to any of the following affected facilities that commenced construction, reconstruction or modification after April 28, 2008, and on or before May 27, 2009: Thermal dryers, pneumatic coal-cleaning equipment (air tables), coal processing and conveying equipment (including breakers and crushers), and coal storage systems, transfer and loading systems.
- (iii) The provisions in §60.251, §60.252(b)(1) through (3), and (c), §60.253(b), §60.254(b) and (c), §60.255(b) through (h), §60.256(b) and (c), §60.257, and §60.258 of Subpart Y are applicable to any of the following affected facilities that commenced construction, reconstruction or modification after May 27, 2009: Thermal dryers, pneumatic coal-cleaning equipment (air tables), coal processing and conveying equipment (including breakers and crushers), coal storage systems, transfer and loading systems, and open storage piles.
- (b) The permittee shall not cause to be discharged into the atmosphere from any coal processing and conveying equipment, coal storage system, or coal transfer and loading system processing coal that was constructed, reconstructed, or modified:
- (i) On or before April 28, 2008, gases which exhibit 20 percent opacity or greater.
- (ii) After April 28, 2008:
- (A) Gases which exhibit 10 percent opacity or greater; except for equipment used in the loading, unloading, and conveying operations of open storage piles is not subject to this opacity limitation; and
- (B) From any mechanical vent on an affected facility, gases which contain particulate matter in excess of 0.023 g/dscm (0.010 gr/dscf).
- (c) The owner or operator of an open storage pile, which includes the equipment used in the loading, unloading, and conveying operations of the affected facility, constructed, reconstructed, or modified after May 27, 2009, must prepare and operate in accordance with a submitted fugitive coal dust emissions control plan that is appropriate for the site conditions as specified in §60.254(c)(1) through (6).
- (d) If emissions testing is required to demonstrate compliance with opacity standards from this subpart, Method 9 and the procedures in §60.11 shall be used to determine opacity, as specified in §60.257.
- (P60-Y2) RECORDKEEPING AND REPORTING [40 CFR Part 60 Subpart Y §60.258 and WAQSR Ch 5, Sec 2(g)(ii) and (g)(v)]
- (a) (i) The permittee shall maintain records of the occurrence and duration of any startup, shutdown, or malfunction in the operation of any affected facility and any malfunction of the associated air pollution control equipment.
- (ii) The owner or operator of a coal preparation and processing plant that commenced construction, reconstruction, or modification after April 28, 2008, shall maintain a logbook (written or electronic) on-site and make it available upon request. The logbook shall record the information specified in §60.258(a).

- (iii) The permittee shall maintain records of all measurements, reports, and other information required by the P60 conditions of this permit, in a permanent form suitable for inspection.
- (iv) These records shall be retained on-site at the facility for a period of at least five years from the date such records are generated.
- (b) The permittee shall comply with any other applicable recordkeeping and reporting requirements of Ch 5, Sec 2 and §60.258.

(P60-Y3) GOOD AIR POLLUTION CONTROL PRACTICE [WAQSR Ch 5, Sec 2(i)(iv)]

At all times, including periods of startup, shutdown, and malfunction, the permittee shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions.

COMPLIANCE CERTIFICATION AND SCHEDULE

Compliance Certification [WAQSR Ch 6, Sec 3(h)(iii)(E)]

- (C1) (a) The permittee shall submit by January 31 each year a certification addressing compliance with the requirements of this permit. The certification shall be submitted as a stand-alone document separate from any monitoring reports required under this permit.
- (b) (i) For the sulfur dioxide emissions inventory, the permittee shall assess compliance with condition F2 by reviewing records kept in accordance with condition F13 and verifying reports were submitted in accordance with condition F19.
- (ii) For fugitive emissions, the permittee shall assess compliance with condition F3 by performing monitoring required by condition F11(a) and reviewing records kept in accordance with condition F17(a).
- (iii) For visible emissions from the boiler, the permittee shall assess compliance with condition F4(a) by performing the monitoring required by condition F9(a).
- (iv) For visible and particulate emissions from the material handling sources, the permittee shall assess compliance with conditions F4(b) and (c), P60-Y1, and F6(a) by performing the monitoring required by condition F9(b).
- (v) For NO_x, SO₂, PM/PM₁₀, CO, VOC, and Hg emissions from the boiler, the permittee shall assess compliance with condition F5 and P60-Da1 by performing the testing required by condition F7 and conducting the monitoring required by conditions F10 and P60-Da3.
- (vi) For the waste ash load-out, the permittee shall assess compliance with condition F6(b) by conducting the monitoring required by condition F11(b) and reviewing records kept in accordance with condition F17(b).
- (vii) For the haul trucks, the permittee shall assess compliance with condition F6(c) by conducting the monitoring required by condition F11(c) and reviewing records kept in accordance with condition F17(c).
- (viii) For ambient monitoring, the permittee shall assess compliance with condition F12 by reviewing records kept in accordance with condition F18 and verifying reports were submitted in accordance with condition F24.
- (ix) For greenhouse gas reporting required by condition F22, the permittee shall verify that reports were submitted in accordance with conditions F22(a) and (b).
- (x) For the iron compound addition project, the permittee shall assess compliance with condition F26 by conducting the monitoring required by condition F9(a) and verifying the report was submitted in accordance with condition F27 until the project deadline.
- (c) The compliance certification shall include:
 - (i) The permit condition or applicable requirement that is the basis of the certification;
 - (ii) The current compliance status;
 - (iii) Whether compliance was continuous or intermittent; and
 - (iv) The methods used for determining compliance.
- (d) For any permit conditions or applicable requirements for which the source is not in compliance, the permittee shall submit with the compliance certification a proposed compliance plan and schedule for Division approval.
- (e) The compliance certification shall be submitted to the Division in accordance with condition G4 of this permit and to the Assistant Regional Administrator, Office of Enforcement, Compliance, and Environmental Justice (8ENF-T), U.S. EPA - Region VIII, 1595 Wynkoop Street, Denver, CO 80202-1129.
- (f) *Determinations of compliance or violations of this permit are not restricted to the monitoring requirements listed in paragraph (b) of this condition; other credible evidence may be used.*

Compliance Schedule [WAQSR Ch 6, Sec 3(h)(iii)(C) and (D)]

- (C2) The permittee shall continue to comply with the applicable requirements with which the permittee has certified that it is already in compliance.
- (C3) The permittee shall comply in a timely manner with applicable requirements that become effective during the term of this permit.

GENERAL PERMIT CONDITIONS

Powers of the Administrator: [W.S. 35-11-110]

- (G1) (a) The Administrator may require the owner or operator of any point source to complete plans and specifications for any application for a permit required by the Wyoming Environmental Quality Act or regulations made pursuant thereto and require the submission of such reports regarding actual or potential violations of the Wyoming Environmental Quality Act or regulations thereunder.
- (b) The Administrator may require the owner or operator of any point source to establish and maintain records; make reports; install, use and maintain monitoring equipment or methods; sample emissions, or provide such other information as may be reasonably required and specified.

Permit Renewal and Expiration: [WAQSR Ch 6, Sec 3(c)(i)(C), (d)(ii), (d)(iv)(B), and (h)(i)(B)][W.S. 35-11-206(f)]

- (G2) This permit is issued for a fixed term of five years. Permit expiration terminates the permittee's right to operate unless a timely and complete renewal application is submitted at least six months prior to the date of permit expiration. If the permittee submits a timely and complete application for renewal, the permittee's failure to have an operating permit is not a violation of WAQSR Chapter 6, Section 3 until the Division takes final action on the renewal application. This protection shall cease to apply after a completeness determination if the applicant fails to submit by the deadline specified in writing by the Division any additional information identified as being needed to process the application.

Duty to Supplement: [WAQSR Ch 6, Sec 3(c)(iii)]

- (G3) The permittee, upon becoming aware that any relevant facts were omitted or incorrect information was submitted in the permit application, shall promptly submit such supplementary facts or corrected information. The permittee shall also provide additional information as necessary to address any requirements that become applicable to the facility after this permit is issued.

Submissions: [WAQSR Ch 6, Sec 3(c)(iv)] [W.S. 35-11-206(c)]

- (G4) Any document submitted shall be certified as being true, accurate, and complete by a responsible official.
- (a) Submissions to the Division.
- (i) Any submissions to the Division including reports, certifications, and emission inventories required under this permit shall be submitted as separate, stand-alone documents and shall be sent to:
- Administrator, Air Quality Division
122 West 25th Street
Cheyenne, Wyoming 82002
- (ii) Unless otherwise noted elsewhere in this permit, a copy of each submission to the Administrator under paragraph (a)(i) of this condition shall be sent to the DEQ Air Quality Contact listed on page 3 of this permit.
- (b) Submissions to EPA.
- (i) Each certification required under condition C1 of this permit shall also be sent to:
- Assistant Regional Administrator
Office of Enforcement, Compliance, and Environmental Justice (8ENF-T)
U.S. EPA - Region VIII
1595 Wynkoop Street
Denver, CO 80202-1129
- (ii) All other required submissions to EPA shall be sent to:
- Office of Partnerships and Regulatory Assistance
Air and Radiation Program (8P-AR)
U.S. EPA - Region VIII
1595 Wynkoop Street
Denver, CO 80202-1129

Changes for Which No Permit Revision Is Required: [WAQSR Ch 6, Sec 3(d)(iii)]

- (G5) The permittee may change operations without a permit revision provided that:
- (a) The change is not a modification under any provision of title I of the Clean Air Act;
 - (b) The change has met the requirements of Chapter 6, Section 2 of the WAQSR and is not a modification under Chapter 5, Section 2 or Chapter 6, Section 4 of the WAQSR and the changes do not exceed the emissions allowed under the permit (whether expressed therein as a rate of emissions or in terms of total emissions); and
 - (c) The permittee provides EPA and the Division with written notification at least 14 days in advance of the proposed change. The permittee, EPA, and the Division shall attach such notice to their copy of the relevant permit. For each such change, the written notification required shall include a brief description of the change within the permitted facility, the date on which the change will occur, any change in emissions, and any permit term or condition that is no longer applicable as a result of the change. The permit shield, if one exists for this permit, shall not apply to any such change made.

Transfer of Ownership or Operation: [WAQSR Ch 6, Sec 3(d)(v)(A)(IV)]

- (G6) A change in ownership or operational control of this facility is treated as an administrative permit amendment if no other change in this permit is necessary and provided that a written agreement containing a specific date for transfer of permit responsibility, coverage, and liability between the current and new permittee has been submitted to the Division.

Reopening for Cause: [WAQSR Ch 6, Sec 3(d)(vii)] [W.S. 35-11-206(f)(ii) and (iv)]

- (G7) The Division will reopen and revise this permit as necessary to remedy deficiencies in the following circumstances:
- (a) Additional applicable requirements under the Clean Air Act or the WAQSR that become applicable to this source if the remaining permit term is three or more years. Such reopening shall be completed not later than 18 months after promulgation of the applicable requirement. No reopening is required if the effective date of the requirement is later than the date on which the permit is due to expire, unless the original permit or any of its terms and conditions have been extended.
 - (b) Additional requirements (including excess emissions requirements) become applicable to an affected source under the acid rain program. Upon approval by EPA, excess emissions offset plans shall be deemed to be incorporated into the permit.
 - (c) The Division or EPA determines that the permit contains a material mistake or that inaccurate statements were made in establishing the emissions standards or other terms or conditions of the permit.
 - (d) The Division or EPA determines that the permit must be revised or revoked to assure compliance with applicable requirements.

Annual Fee Payment: [WAQSR Ch 6, Sec 3(f)(i), (ii), and (vi)] [W.S. 35-11-211]

- (G8) The permittee shall, as a condition of continued operations, submit an annual fee to the Division as established in Chapter 6, Section 3 (f) of the WAQSR. The Division shall give written notice of the amount of fee to be assessed and the basis for such fee assessment annually. The assessed fee is due on receipt of the notice unless the fee assessment is appealed pursuant to W.S. 35-11-211(d). If any part of the fee assessment is not appealed it shall be paid to the Division on receipt of the written notice. Any remaining fee which may be due after completion of the appeal is immediately due and payable upon issuance of the Council's decision. Failure to pay fees owed the Division is a violation of Chapter 6, Section 3 (f) and W.S. 35-11-203 and may be cause for the revocation of this permit.

Annual Emissions Inventories: [WAQSR Ch 6, Sec 3(f)(v)(G)]

- (G9) The permittee shall submit an annual emission inventory for this facility to the Division for fee assessment and compliance determinations within 60 days following the end of the calendar year. The emissions inventory shall be in a format specified by the Division.

Severability Clause: [WAQSR Ch 6, Sec 3(h)(i)(E)]

- (G10) The provisions of this permit are severable, and if any provision of this permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

Compliance: [WAQSR Ch 6, Sec 3(h)(i)(F)(I) and (II)] [W.S. 35-11-203(b)]

- (G11) The permittee must comply with all conditions of this permit. Any permit noncompliance constitutes a violation of the Clean Air Act, Article 2 of the Wyoming Environmental Quality Act, and the WAQSR and is grounds for enforcement action; for permit termination, revocation and reissuance, or modification; or for denial of a permit renewal application. It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

Permit Actions: [WAQSR Ch 6, Sec 3(h)(i)(F)(III)] [W.S. 35-11-206(f)]

- (G12) This permit may be modified, revoked, reopened, and reissued, or terminated for cause. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or of a notification of planned changes or anticipated noncompliance does not stay any permit condition.

Property Rights: [WAQSR Ch 6, Sec 3(h)(i)(F)(IV)]

- (G13) This permit does not convey any property rights of any sort, or any exclusive privilege.

Duty to Provide Information: [WAQSR Ch 6, Sec 3(h)(i)(F)(V)]

- (G14) The permittee shall furnish to the Division, within a reasonable time, any information that the Division may request in writing to determine whether cause exists for modifying, revoking and reissuing, or terminating the permit or to determine compliance with the permit. Upon request, the permittee shall also furnish to the Division copies of records required to be kept by the permit, including information claimed and shown to be confidential under W.S. 35-11-1101 (a) of the Wyoming Environmental Quality Act. Upon request by the Division, the permittee shall also furnish confidential information directly to EPA along with a claim of confidentiality.

Emissions Trading: [WAQSR Ch 6, Sec 3(h)(i)(H)]

- (G15) No permit revision is required, under any approved economic incentives, marketable permits, emissions trading and other similar programs or processes for changes that are provided for in this permit.

Inspection and Entry: [WAQSR Ch 6, Sec 3(h)(iii)(B)] [W.S. 35-11-206(c)]

- (G16) Authorized representatives of the Division, upon presentation of credentials and other documents as may be required by law, shall be given permission to:
- (a) enter upon the permittee's premises where a source is located or emissions related activity is conducted, or where records must be kept under the conditions of this permit;
 - (b) have access to and copy at reasonable times any records that must be kept under the conditions of this permit;
 - (c) inspect at reasonable times any facilities, equipment (including monitoring and air pollution control equipment), practices, or operations regulated or required under this permit;
 - (d) sample or monitor any substances or parameters at any location, during operating hours, for the purpose of assuring compliance with this permit or applicable requirements.

Excess Emissions Due to an Emergency: [WAQSR Ch 6, Sec 3(l)]

- (G17) The permittee may seek to establish that noncompliance with a technology-based emission limitation under this permit was due to an emergency, as defined in Ch 6, Sec 3(l)(i) of the WAQSR. To do so, the permittee shall demonstrate the affirmative defense of emergency through properly signed, contemporaneous operating logs, or other relevant evidence that:
- (a) an emergency occurred and that the permittee can identify the cause(s) of the emergency;
 - (b) the permitted facility was, at the time, being properly operated;
 - (c) during the period of the emergency the permittee took all reasonable steps to minimize levels of emissions that exceeded the emissions standards, or other requirements in this permit;

- (d) The permittee submitted notice of the emergency to the Division within one working day of the time when emission limitations were exceeded due to the emergency. This notice must contain a description of the emergency, any steps taken to mitigate emissions, and corrective actions taken.

Diluting and Concealing Emissions: [WAQSR Ch 1, Sec 4]

- (G18) No person shall cause or permit the installation or use of any device, contrivance, or operational schedule which, without resulting in reduction of the total amount of air contaminant released to the atmosphere, shall dilute or conceal an emission from a source. This condition shall not apply to the control of odors.

Unavoidable Equipment Malfunction: [WAQSR Ch 1, Sec 5]

- (G19) (a) Any source believing that any emissions in excess of established regulation limits or standards resulted from an unavoidable equipment malfunction, shall notify the Division within 24 hours of the incident via telephone, electronic mail, fax, or other similar method. A detailed description of the circumstances of the incident as described in paragraph 5(a)(i)(A) Chapter 1, including a corrective program directed at preventing future such incidents, must be submitted within 14 days of the onset of the incident. The Administrator may extend this 14-day time period for cause.
- (b) The burden of proof is on the owner or operator of the source to provide sufficient information to demonstrate that an unavoidable equipment malfunction occurred.

Fugitive Dust: [WAQSR Ch 3, Sec 2(f)]

- (G20) The permittee shall minimize fugitive dust in compliance with standards in Ch 3, Sec 2(f) of WAQSR for construction/demolition activities, handling and transportation of materials, and agricultural practices.

Carbon Monoxide: [WAQSR Ch 3, Sec 5]

- (G21) The emission of carbon monoxide in stack gases from any stationary source shall be limited as may be necessary to prevent ambient standards from being exceeded.

Asbestos: [WAQSR Ch 3, Sec 8]

- (G22) The permittee shall comply with emission standards for asbestos during abatement, demolition, renovation, manufacturing, spraying and fabricating activities.
- (a) No owner or operator shall build, erect, install, or use any article, machine, equipment, process, or method, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous dilutants to achieve compliance with a visible emissions standard, and the piecemeal carrying out of an operation to avoid coverage by a standard that applies only to operations larger than a specified size.
- (b) All owners and operators conducting an asbestos abatement project, including an abatement project on a residential building, shall be responsible for complying with Federal requirements and State standards for packaging, transportation, and delivery to an approved waste disposal facility as provided in paragraph (m) of Ch 3, Sec 8.
- (c) The permittee shall follow State and Federal standards for any demolition and renovation activities conducted at this facility, including:
- (i) A thorough inspection of the affected facility or part of the facility where the demolition or renovation activity will occur shall be conducted to determine the presence of asbestos, including Category I and Category II non-friable asbestos containing material. The results of the inspection will determine which notification and asbestos abatement procedures are applicable to the activity.
- (ii) The owner or operator shall follow the appropriate notification requirements of Ch 3, Sec 8(i)(ii).
- (iii) The owner or operator shall follow the appropriate procedures for asbestos emissions control, as specified in Chapter 3, Section 8(i)(iii).
- (d) No owner or operator of a facility may install or reinstall on a facility component any insulating materials that contain commercial asbestos if the materials are either molded and friable or wet-applied and friable after drying. The provisions of this paragraph do not apply to spray-applied insulating materials regulated under paragraph (j) of Ch 3, Sec 8.
- (e) The permittee shall comply with all other requirements of WAQSR Ch 3, Sec 8.

Open Burning Restrictions: [WAQSR Ch 10, Sec 2]

- (G23) The permittee conducting an open burn shall comply with all rules and regulations of the Wyoming Department of Environmental Quality, Division of Air Quality, and with the Wyoming Environmental Quality Act.
- (a) No person shall burn prohibited materials using an open burning method, except as may be authorized by permit. *“Prohibited materials”* means substances including, but not limited to; natural or synthetic rubber products, including tires; waste petroleum products, such as oil or used oil filters; insulated wire; plastic products, including polyvinyl chloride (“PVC”) pipe, tubing and connectors; tar, asphalt, asphalt shingles, or tar paper; railroad ties; wood, wood waste, or lumber that is painted or chemically treated; explosives or ammunition; batteries; hazardous waste products; asbestos or asbestos containing materials; or materials which cause dense smoke discharges, excluding refuse and flaring associated with oil and gas well testing, completions and well workovers.
 - (b) No person or organization shall conduct or cause or permit open burning for the disposal of trade wastes, for a salvage operation, for the destruction of fire hazards if so designated by a jurisdictional fire authority, or for fire fighting training, except when it can be shown by a person or organization that such open burning is absolutely necessary and in the public interest. Any person or organization intending to engage in such open burning shall file a request to do so with the Division.

Sulfur Dioxide Emission Trading and Inventory Program [WAQSR Ch 14]

- (G24) Any BART (Best Available Retrofit Technology) eligible facility, or facility which has actual emissions of SO₂ greater than 100 tpy in calendar year 2000 or any subsequent year, shall comply with the applicable requirements of WAQSR Ch 14, Sections 1 through 3, with the exceptions described in sections 2(c) and 3(a).

Stratospheric Ozone Protection Requirements: [40 CFR Part 82]

- (G25) The permittee shall comply with all applicable Stratospheric Ozone Protection Requirements, including but not limited to:
- (a) *Standards for Appliances* [40 CFR Part 82, Subpart F]
The permittee shall comply with the standards for recycling and emission reduction pursuant to 40 CFR Part 82, Subpart F - Recycling and Emissions Reduction, except as provided for motor vehicle air conditioners (MVACs) in Subpart B:
 - (i) Persons opening appliances for maintenance, service, repair, or disposal must comply with the required practices pursuant to §82.156.
 - (ii) Equipment used during the maintenance, service, repair, or disposal of appliances must comply with the standards for recycling and recovery equipment pursuant to §82.158.
 - (iii) Persons performing maintenance, service, repair, or disposal of appliances must be certified by an approved technician certification program pursuant to §82.161.
 - (iv) Persons disposing of small appliances, MVACs, and MVAC-like appliances must comply with record keeping requirements pursuant to §82.166. (“MVAC-like appliance” is defined at §82.152).
 - (v) Persons owning commercial or industrial process refrigeration equipment must comply with the leak repair requirements pursuant to §82.166.
 - (vi) Owners/operators of appliances normally containing 50 or more pounds of refrigerant must keep records of refrigerant purchased and added to such appliances pursuant to §82.166.
 - (vii) The permittee shall comply with all other requirements of Subpart F.
 - (b) *Standards for Motor Vehicle Air Conditioners* [40 CFR Part 82, Subpart B]
If the permittee performs a service on motor (fleet) vehicles when this service involves ozone-depleting substance refrigerant in the MVAC, the permittee is subject to all the applicable requirements as specified in 40 CFR Part 82, Subpart B, Servicing of Motor Vehicle Air Conditioners. The term “motor vehicle” as used in Subpart B does not include a vehicle in which final assembly of the vehicle has not been completed. The term “MVAC” as used in Subpart B does not include the air-tight sealed refrigeration system used as refrigerated cargo, or the system used on passenger buses using HCFC-22 refrigerant.

STATE ONLY PERMIT CONDITIONS

The conditions listed in this section are State only requirements and are not federally enforceable.

Ambient Standards

(S1) The permittee shall operate the emission units described in this permit such that the following ambient standards are not exceeded:

POLLUTANT	STANDARD	CONDITION	WAQSR CH. 2, SEC.
PM ₁₀ particulate matter	50 micrograms per cubic meter	annual arithmetic mean	2 (a)
	150 micrograms per cubic meter	24-hr average concentration with not more than one exceedance per year	
PM _{2.5} particulate matter	15 micrograms per cubic meter	annual arithmetic mean	2 (b)
	35 micrograms per cubic meter	98 th percentile 24-hour average concentration	
Nitrogen dioxide	100 micrograms per cubic meter	annual arithmetic mean	3
Sulfur oxides	60 micrograms per cubic meter	annual arithmetic mean	4
	260 micrograms per cubic meter	max 24-hr concentration with not more than one exceedance per year	
	1300 micrograms per cubic meter	max 3-hr concentration with not more than one exceedance per year	
Carbon monoxide	10 milligrams per cubic meter	max 8-hr concentration with not more than one exceedance per year	5
	40 milligrams per cubic meter	max 1-hr concentration with not more than one exceedance per year	
Ozone	0.08 parts per million	daily maximum 8-hour average	6
Hydrogen sulfide	70 micrograms per cubic meter	½ hour average not to be exceeded more than two times per year	7
	40 micrograms per cubic meter	½ hour average not to be exceeded more than two times in any five consecutive days	
Suspended sulfate	0.25 milligrams SO ₃ per 100 square centimeters per day	maximum annual average	8
	0.50 milligrams SO ₃ per 100 square centimeters per day	maximum 30-day value	
Lead and its compounds	0.15 micrograms per cubic meter	maximum arithmetic 3-month mean concentration for a 3-year period	10

Hydrogen Sulfide: [WAQSR Ch 3, Sec 7]

- (S2) Any exit process gas stream containing hydrogen sulfide which is discharged to the atmosphere from any source shall be vented, incinerated, flared or otherwise disposed of in such a manner that ambient sulfur dioxide and hydrogen sulfide standards are not exceeded.

Odors: [WAQSR Ch 2, Sec 11]

- (S3) (a) The ambient air standard for odors from any source shall be limited to an odor emission at the property line which is undetectable at seven dilutions with odor free air as determined by a scentometer as manufactured by the Barnebey-Cheney Company or any other instrument, device, or technique designated by the Division as producing equivalent results. The occurrence of odors shall be measured so that at least two measurements can be made within a period of one hour, these determinations being separated by at least 15 minutes.
- (b) Odor producing materials shall be stored, transported, and handled in a manner that odors produced from such materials are confined and that accumulation of such materials resulting from spillage or other escape is prevented.

ACID RAIN PERMIT CONDITIONS
ACID RAIN PORTION OF THE OPERATING PERMIT

Issued to: Wygen Station II
 Operated by: Cheyenne Light, Fuel and Power Company
 ORIS code: 56319
 Effective: Same as operating permit

Acid Rain Permit Contents

- AR-1) Statement of Basis.
- AR-2) SO₂ allowances allocated under this permit and NO_x requirements for each affected unit.
- AR-3) Comments, notes and justifications regarding permit decisions and changes made to the permit application forms during the review process, and any additional requirements or conditions.
- AR-4) The permit application submitted for this source, as corrected by the Division. The owners and operators of the source must comply with the standard requirements and special provisions set forth in the application.

AR-1) Statement of Basis:

Statutory and Regulatory Authorities: In accordance with Chapter 11 of the Wyoming Air Quality Standards and Regulations and Titles IV and V of the Clean Air Act, this permit is issued by the Division.

AR-2) SO₂ Allowance Allocations & NO_x Requirements for affected units:

Source 1	SO ₂	Unit will hold sulfur dioxide allowances in accordance with 40 CFR 72.9(c)(1).
	NO _x	There is no applicable Acid Rain emissions limitation for nitrogen oxides for this unit.

AR-3) Comments, Notes and Justifications: None.

AR-4) Permit Application: See Appendix C of this operating permit.

SUMMARY OF SOURCE EMISSION LIMITS AND REQUIREMENTS

Source ID#: 1 Source Description: **B & W Pulverized Coal Fired Boiler**

Pollutant	Emissions Limit/Work Practice Standard	Corresponding Regulation(s)	Testing Requirements	Monitoring Requirements	Recordkeeping Requirements	Reporting Requirements
Particulate	20 percent opacity with one 6-min of not more than 27% per hour [F4 and P60-Da1] 0.012 lb/MMBtu; 15.6 lb/hr; 68 TPY [F5]	WAQSR Ch 6, Sec 2 Permit CT-3030A3 WAQSR Ch 5, Sec 2 and 40 CFR 60 Subpart Da	Annual PM testing [F7]	Continuous opacity monitoring [F10 and P60-Da2] Annual PM testing [F10]	Test records [F14] Visible emissions records [F15]	Test reports [F20] Boilers excess emissions & monitoring system performance reports [F23] Report excess emissions and permit deviations [F25]
SO ₂	0.10 (30-day rolling) lb/MMBtu; 0.12 (3-hr block) lb/MMBtu; 130.0 (30-day rolling) lb/hr; 156.0 (3-hr block) lb/hr; 1.4 (30-day rolling) lb/MW-hr; 569 TPY [F5 and P60-Da1]	WAQSR Ch 6, Sec 2 Permit CT-3030A3 WAQSR Ch 5, Sec 2 and 40 CFR 60 Subpart Da	Testing if required [F8]	Continuous emissions monitoring [F10 and P60-Da2]	Boiler continuous emissions monitoring records [F16]	Test Reports [F20] Boilers excess emissions & monitoring system performance reports [F23] Report excess emissions and permit deviations [F25]
	Title IV Allowances [F1 and AR-2]	WAQSR Ch 6, Sec 3(h); and 40 CFR 73	None	Appendix C	Appendix C	Appendix C
NO _x	0.07 (30-day rolling) lb/MMBtu; 91.0 (30-day rolling) lb/hr; 1.0 (30-day rolling) lb/MW-hr; 399 TPY [F5 and P60-Da1]	WAQSR Ch 6, Sec 2 Permit CT-3030A3 WAQSR Ch 5, Sec 2 and 40 CFR 60 Subpart Da	Testing if required [F8]	Continuous emissions monitoring [F10 and P60-Da2]	Boiler continuous emissions monitoring records [F16]	Test Reports [F20] Boilers excess emissions & monitoring system performance reports [F23] Report excess emissions and permit deviations [F25]
	No applicable Acid Rain emission limitation [AR-2]	40 CFR 76	None	Appendix C	Appendix C	Appendix C
CO	0.15 lb/MMBtu; 195.0 lb/hr; 854 TPY [F5]	WAQSR Ch 6, Sec 2 Permit CT-3030A3	Annual testing [F7]	Annual testing [F10]	Test records [F14]	Test reports [F20] Report excess emissions and permit deviations [F25]
VOCs	0.01 lb/MMBtu; 13.0 lb/hr; 57 TPY [F5]	WAQSR Ch 6, Sec 2 Permit CT-3030A3	Annual testing [F7]	Annual testing [F10]	Test records [F14]	Test reports [F20] Report excess emissions and permit deviations [F25]
Hg	97x10 ⁻⁶ (12-month rolling) lb/MW-hr [F5 and P60-Da1]	WAQSR Ch 6, Sec 2 Permit CT-3030A3 WAQSR Ch 5, Sec 2 and 40 CFR 60 Subpart Da	Testing if required [F8]	Continuous emissions monitoring [F10 and P60-Da3]	Boiler continuous emissions monitoring records [F16]	Test Reports [F20] Boilers compliance & monitoring system performance reports [F23] Report excess emissions and permit deviations [F25]

These tables are intended only to highlight and summarize applicable requirements for each source. The corresponding permit conditions, listed in brackets, contain detailed descriptions of the compliance requirements. Compliance with the summary conditions in these tables may not be sufficient to meet permit requirements. These tables may not reflect all emission sources at this facility.

Source ID#: 2 Source Description: Coal Bunker – Methane Vent

Pollutant	Emissions Limit/Work Practice Standard	Corresponding Regulation(s)	Testing Requirements	Monitoring Requirements	Recordkeeping Requirements	Reporting Requirements
Particulate	Less than 20 % opacity [F4 and P60-Y1] 0.009 gr/dscf; 0.37 lb/hr; 1.6 TPY [F6]	WAQSR Ch 6, Sec 2 Permit CT-3030A3 WAQSR Ch 5, Sec 2 and 40 CFR 60 Subpart Y	Testing if required [F8]	Daily visible observations [F9]	Visible observations records [F15]	Monitoring reports [F21] Report excess emissions and permit deviations [F25]

Source ID#: 3 Source Description: Lime Silo

Pollutant	Emissions Limit/Work Practice Standard	Corresponding Regulation(s)	Testing Requirements	Monitoring Requirements	Recordkeeping Requirements	Reporting Requirements
Particulate	20 % opacity [F4] 0.01 gr/dscf; 0.13 lb/hr; 0.6 TPY [F6]	WAQSR Ch 6, Sec 2 Permit CT-3030A3	Testing if required [F8]	Daily visible observations [F9]	Visible observations records [F15]	Monitoring reports [F21] Report excess emissions and permit deviations [F25]

Source ID#: 4A/4B Source Description: Lime Slaker A/B

Pollutant	Emissions Limit/Work Practice Standard	Corresponding Regulation(s)	Testing Requirements	Monitoring Requirements	Recordkeeping Requirements	Reporting Requirements
Particulate	20 % opacity [F4] 0.01 gr/dscf; 0.03 lb/hr; 0.1 TPY [F6]	WAQSR Ch 6, Sec 2 Waiver wv-9761	Testing if required [F8]	Daily visible observations [F9]	Visible observations records [F15]	Monitoring reports [F21] Report excess emissions and permit deviations [F25]

Source ID#: 5 Source Description: Recycle Ash Storage Silo

Pollutant	Emissions Limit/Work Practice Standard	Corresponding Regulation(s)	Testing Requirements	Monitoring Requirements	Recordkeeping Requirements	Reporting Requirements
Particulate	20 % opacity [F4] 0.01 gr/dscf; 0.02 lb/hr; 0.1 TPY [F6]	WAQSR Ch 6, Sec 2 Waiver wv-9761	Testing if required [F8]	Daily visible observations [F9]	Visible observations records [F15]	Monitoring reports [F21] Report excess emissions and permit deviations [F25]

These tables are intended only to highlight and summarize applicable requirements for each source. The corresponding permit conditions, listed in brackets, contain detailed descriptions of the compliance requirements. Compliance with the summary conditions in these tables may not be sufficient to meet permit requirements. These tables may not reflect all emission sources at this facility.

Source ID#: **6A/6B** Source Description: **Recycle Ash Mix Tank A/B**

Pollutant	Emissions Limit / Work Practice Standard	Corresponding Regulation(s)	Testing Requirements	Monitoring Requirements	Recordkeeping Requirements	Reporting Requirements
Particulate	20 % opacity [F4] 0.01 gr/dscf; 0.03 lb/hr; 0.1 TPY [F6]	WAQSR Ch 6, Sec 2 Waiver wv-9761	Testing if required [F8]	Daily visible observations [F9]	Visible observations records [F15]	Monitoring reports [F21] Report excess emissions and permit deviations [F25]

Source ID#: **7** Source Description: **Ash Silo**

Pollutant	Emissions Limit / Work Practice Standard	Corresponding Regulation(s)	Testing Requirements	Monitoring Requirements	Recordkeeping Requirements	Reporting Requirements
Particulate	20 % opacity [F4] 0.01 gr/dscf; 0.05 lb/hr; 0.2 TPY [F6]	WAQSR Ch 6, Sec 2 Permit CT-3030A3	Testing if required [F8]	Daily visible observations [F9]	Visible observations records [F15]	Monitoring reports [F21] Report excess emissions and permit deviations [F25]

Source ID#: **8A/8B** Source Description: **Ash Exhauster A/B**

Pollutant	Emissions Limit / Work Practice Standard	Corresponding Regulation(s)	Testing Requirements	Monitoring Requirements	Recordkeeping Requirements	Reporting Requirements
Particulate	20 % opacity [F4] 0.01 gr/dscf; 0.10 lb/hr; 0.4 TPY [F6]	WAQSR Ch 6, Sec 2 Permit CT-3030A3	Testing if required [F8]	Daily visible observations [F9]	Visible observations records [F15]	Monitoring reports [F21] Report excess emissions and permit deviations [F25]

These tables are intended only to highlight and summarize applicable requirements for each source. The corresponding permit conditions, listed in brackets, contain detailed descriptions of the compliance requirements. Compliance with the summary conditions in these tables may not be sufficient to meet permit requirements. These tables may not reflect all emission sources at this facility.

ABBREVIATIONS

ACFM	Actual cubic feet per minute
AQD	Air Quality Division
BACT	Best available control technology (see Definitions)
Btu	British Thermal Unit
CAA	Clean Air Act
CAM	Compliance Assurance Monitoring
C.F.R.	Code of Federal Regulations
CO	Carbon monoxide
°F	Degrees Fahrenheit
DEQ	Wyoming Department of Environmental Quality
EPA	United States Environmental Protection Agency (see Definitions)
ESP	Electrostatic Precipitator
g/hp-hr	Gram(s) per horsepower hour
gal	Gallon(s)
gr	Grain(s)
H ₂ S	Hydrogen sulfide
HAP(s)	Hazardous air pollutant(s)
hp	Horsepower
hr	Hour(s)
lb	Pound(s)
M	Thousand
MACT	Maximum available control technology (see Definitions)
mfr	Manufacturer
mg	Milligram(s)
MM	Million
MVACs	Motor vehicle air conditioners
N/A	Not applicable
NMHC(s)	Non-methane hydrocarbon(s)
NO _x	Oxides of nitrogen
O ₂	Oxygen
OPP	Operating Permit Program
PM	Particulate matter
PM ₁₀	Particulate matter less than or equal to a nominal diameter of 10 micrometers
ppmv	Parts per million (by volume)
ppmw	Parts per million (by weight)
QIP	Quality Improvement Plan
SCF	Standard cubic foot (feet)
SCFD	Standard cubic foot (feet) per day
SCM	Standard cubic meter(s)
SIC	Standard Industrial Classification
SO ₂	Sulfur dioxide
SO _x	Oxides of sulfur
TBD	To be determined
TPD	Ton(s) per day
TPH	Ton(s) per hour
TPY	Tons per year
U.S.C.	United States Code
µg	Microgram(s)
VOC(s)	Volatile organic compound(s)
W.S.	Wyoming Statute
WAQSR	Wyoming Air Quality Standards & Regulations (see Definitions)

DEFINITIONS

"Act" means the Clean Air Act, as amended, 42 U.S.C. 7401, *et seq.*

"Administrator" means Administrator of the Air Quality Division, Wyoming Department of Environmental Quality.

"Applicable requirement" means all of the following as they apply to emissions units at a source subject to Chapter 6, Section 3 of the WAQSR (including requirements with future effective compliance dates that have been promulgated or approved by the EPA or the State through rulemaking at the time of issuance of the operating permit):

- (a) Any standard or other requirement provided for in the Wyoming implementation plan approved or promulgated by EPA under title I of the Act that implements the relevant requirements of the Act, including any revisions to the plan promulgated in 40 C.F.R. Part 52;
- (b) Any standards or requirements in the WAQSR which are not a part of the approved Wyoming implementation plan and are not federally enforceable;
- (c) Any term or condition of any preconstruction permits issued pursuant to regulations approved or promulgated through rulemaking under title I, including parts C or D of the Act and including Chapter 5, Section 2 and Chapter 6, Sections 2 and 4 of the WAQSR;
- (d) Any standard or other requirement promulgated under Section 111 of the Act, including Section 111(d) and Chapter 5, Section 2 of the WAQSR;
- (e) Any standard or other requirement under Section 112 of the Act, including any requirement concerning accident prevention under Section 112(r)(7) of the Act and including any regulations promulgated by EPA and the State pursuant to Section 112 of the Act;
- (f) Any standard or other requirement of the acid rain program under title IV of the Act or the regulations promulgated thereunder;
- (g) Any requirements established pursuant to Section 504(b) or Section 114(a)(3) of the Act concerning enhanced monitoring and compliance certifications;
- (h) Any standard or other requirement governing solid waste incineration, under Section 129 of the Act;
- (i) Any standard or other requirement for consumer and commercial products, under Section 183(e) of the Act (having to do with the release of volatile organic compounds under ozone control requirements);
- (j) Any standard or other requirement of the regulations promulgated to protect stratospheric ozone under title VI of the Act, unless the EPA has determined that such requirements need not be contained in a title V permit;
- (k) Any national ambient air quality standard or increment or visibility requirement under part C of title I of the Act, but only as it would apply to temporary sources permitted pursuant to Section 504(e) of the Act; and
- (l) Any state ambient air quality standard or increment or visibility requirement of the WAQSR.
- (m) Nothing under paragraphs (A) through (L) above shall be construed as affecting the allowance program and Phase II compliance schedule under the acid rain provision of Title IV of the Act.

"BACT" or "Best available control technology" means an emission limitation (including a visible emission standard) based on the maximum degree of reduction of each pollutant subject to regulation under the WAQSR or regulation under the Federal Clean Air Act, which would be emitted from or which results for any proposed major emitting facility or major modification which the Administrator, on a case-by-case basis, taking into account energy, environmental, and economic impacts and other costs, determines is achievable for such source or modification through application or production processes and available methods, systems, and techniques, including fuel cleaning or treatment or innovative fuel combustion techniques for control of such pollutant. If the Administrator determines that technological or economic limitations on the application of measurement methodology to a particular class of sources would make the imposition of an emission standard infeasible, he may instead prescribe a design,

equipment, work practice or operational standard or combination thereof to satisfy the requirement of Best Available Control Technology. Such standard shall, to the degree possible, set forth the emission reduction achievable by implementation of such design, equipment, work practice, or operation and shall provide for compliance by means which achieve equivalent results. Application of BACT shall not result in emissions in excess of those allowed under Chapter 5, Section 2 of the WAQSR and any other new source performance standard or national emission standards for hazardous air pollutants promulgated by EPA but not yet adopted by the state.

"Department" means the Wyoming Department of Environmental Quality or its Director.

"Director" means the Director of the Wyoming Department of Environmental Quality.

"Division" means the Air Quality Division of the Wyoming Department of Environmental Quality or its Administrator.

"Emergency" means any situation arising from sudden and reasonably unforeseeable events beyond the control of the source, including acts of God, which situation requires immediate corrective action to restore normal operation, and that causes the source to exceed a technology-based emission limitation under the permit, due to unavoidable increases in emissions attributable to the emergency. An emergency shall not include noncompliance to the extent caused by improperly designed equipment, lack of preventative maintenance, careless or improper operation, or operator error.

"EPA" means the Administrator of the U.S. Environmental Protection Agency or the Administrator's designee.

"Fuel-burning equipment" means any furnace, boiler apparatus, stack, or appurtenances thereto used in the process of burning fuel or other combustible material for the purpose of producing heat or power by indirect heat transfer.

"Fugitive emissions" means those emissions which could not reasonably pass through a stack chimney, vent, or other functionally equivalent opening.

"Insignificant activities" means those activities which are incidental to the facility's primary business activity and which result in emissions of less than one ton per year of a regulated pollutant not included in the Section 112 (b) list of hazardous air pollutants or emissions less than 1000 pounds per year of a pollutant regulated pursuant to listing under Section 112 (b) of the Act provided, however, such emission levels of hazardous air pollutants do not exceed exemptions based on insignificant emission levels established by EPA through rulemaking for modification under Section 112 (g) of the Act.

"MACT" or "Maximum achievable control technology" means the maximum degree of reduction in emissions that is deemed achievable for new sources in a category or subcategory that shall not be less stringent than the emission control that is achieved in practice by the best controlled similar source, as determined by the Administrator. Emission standards promulgated for existing sources in a category or subcategory may be less stringent than standards for new sources in the same category or subcategory but shall not be less stringent, and may be more stringent than:

- (a) the average emission limitation achieved by the best performing 12 percent of the existing sources (for which the Administrator has emission information), excluding those sources that have, within 18 months before the emission standard is proposed or within 30 months before such standard is promulgated, whichever is later, first achieved a level of emission rate or emission reduction which complies, or would comply if the source is not subject to such standard, with the lowest achievable emission rate applicable to the source category and prevailing at the time, in the category or subcategory for categories and subcategories with 30 or more sources, or
- (b) the average emission limitation achieved by the best performing five sources (for which the Administrator has or could reasonably obtain emissions information) in the category or subcategory for categories or subcategories with fewer than 30 sources.

"Modification" means any physical change in, or change in the method of operation of, an affected facility which increases the amount of any air pollutant (to which any state standards applies) emitted by such facility or which results in the emission of any such air pollutant not previously emitted.

"Permittee" means the person or entity to whom a Chapter 6, Section 3 permit is issued.

"Potential to emit" means the maximum capacity of a stationary source to emit any air pollutant under its physical and operational design. Any physical or operational limitation on the capacity of a source to emit an air pollutant,

including air pollution control equipment and restrictions on hours of operation or on the type or amount of material combusted, stored or processed, shall be treated as part of its design if the limitation is enforceable by EPA and the Division. This term does not alter or affect the use of this term for any other purposes under the Act, or the term "capacity factor" as used in title IV of the Act or the regulations promulgated thereunder.

"Regulated air pollutant" means the following:

- (a) Nitrogen oxides (NO_x) or any volatile organic compound;
- (b) Any pollutant for which a national ambient air quality standard has been promulgated;
- (c) Any pollutant that is subject to any standard established in Chapter 5, Section 2 of the WAQSR or Section 111 of the Act;
- (d) Any Class I or II substance subject to a standard promulgated under or established by title VI of the Act; or
- (e) Any pollutant subject to a standard promulgated under Section 112 or other requirements established under Section 112 of the Act, including Sections 112(g), (j), and (r) of the Act, including the following:
 - (i) Any pollutant subject to requirements under Section 112(j) of the Act. If EPA fails to promulgate a standard by the date established pursuant to Section 112(e) of the Act, any pollutant for which a subject source would be major shall be considered to be regulated on the date 18 months after the applicable date established pursuant to Section 112(e) of the Act; and
 - (ii) Any pollutant for which the requirements of Section 112(g)(2) of the Act have been met, but only with respect to the individual source subject to Section 112(g)(2) requirement.
- (f) Pollutants regulated solely under Section 112(r) of the Act are to be regulated only with respect to the requirements of Section 112(r) for permits issued under this Chapter 6, Section 3 of the WAQSR.

"Renewal" means the process by which a permit is reissued at the end of its term.

"Responsible official" means one of the following:

- (a) For a corporation:
 - (i) A president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation; or
 - (ii) A duly authorized representative of such person if the representative is responsible for the overall operation of one or more manufacturing, production, or operating facilities applying for or subject to a permit and either:
 - (A) the facilities employ more than 250 persons or have gross annual sales or expenditures exceeding \$25 million (in second quarter 1980 dollars); or
 - (B) the delegation of authority to such representative is approved in advance by the Division;
- (b) For a partnership or sole proprietorship: a general partner or the proprietor, respectively;
- (c) For a municipality, State, Federal, or other public agency: Either a principal executive officer or ranking elected official. For the purposes of this part, a principal executive officer of a federal agency includes the chief executive officer having responsibility for the overall operations of a principal geographic unit of the agency; or
- (d) For affected sources:
 - (i) The designated representative or alternate designated representative in so far as actions, standards, requirements, or prohibitions under title IV of the Act or the regulations promulgated thereunder are concerned; and
 - (ii) The designated representative, alternate designated representative, or responsible official under Chapter 6, Section 3 (b)(xxvi) of the WAQSR for all other purposes under this section.

"WAQSR" means the Wyoming Air Quality Standards and Regulations promulgated under the Wyoming Environmental Quality Act, W.S. §35-11-101, *et seq.*



APPENDIX A
40 CFR 60 SUBPART Da



Subpart Da—Standards of Performance for Electric Utility Steam Generating Units for Which Construction is Commenced After September 18, 1978

Source: 72 FR 32722, June 13, 2007, unless otherwise noted.

§60.40Da Applicability and designation of affected facility.

(a) Except as specified in paragraph (e) of this section, the affected facility to which this subpart applies is each electric utility steam generating unit:

(1) That is capable of combusting more than 73 megawatts (MW) (250 million British thermal units per hour (MMBtu/hr)) heat input of fossil fuel (either alone or in combination with any other fuel); and

(2) For which construction, modification, or reconstruction is commenced after September 18, 1978.

(b) An IGCC electric utility steam generating unit (both the stationary combustion turbine and any associated duct burners) is subject to this part and is not subject to subpart GG or KKKK of this part if both of the conditions specified in paragraphs (b)(1) and (2) of this section are met.

(1) The IGCC electric utility steam generating unit is capable of combusting more than 73 MW (250 MMBtu/hr) heat input of fossil fuel (either alone or in combination with any other fuel); and

(2) The IGCC electric utility steam generating unit commenced construction, modification, or reconstruction after February 28, 2005.

(c) Any change to an existing fossil-fuel-fired steam generating unit to accommodate the use of combustible materials, other than fossil fuels, shall not bring that unit under the applicability of this subpart.

(d) Any change to an existing steam generating unit originally designed to fire gaseous or liquid fossil fuels, to accommodate the use of any other fuel (fossil or nonfossil) shall not bring that unit under the applicability of this subpart.

(e) Applicability of the requirement of this subpart to an electric utility combined cycle gas turbine other than an IGCC electric utility steam generating unit is as specified in paragraphs (e)(1) and (2) of this section.

(1) Heat recovery steam generators used with duct burners and associated with an electric utility combined cycle gas turbine that are capable of combusting more than 73 MW (250 MMBtu/hr) heat input of fossil fuel are subject to this subpart except in cases when the heat recovery steam generator meets the applicability requirements and is subject to subpart KKKK of this part.

(2) For heat recovery steam generators use with duct burners subject to this subpart, only emissions resulting from the combustion of fuels in the steam generating unit (i.e. duct burners) are subject to the standards under this

subpart. (The emissions resulting from the combustion of fuels in the stationary combustion turbine engine are subject to subpart GG or KKK, as applicable, of this part).

[72 FR 32722, June 13, 2007, as amended at 74 FR 5078, Jan. 28, 2009]

§60.41Da Definitions.

As used in this subpart, all terms not defined herein shall have the meaning given them in the Act and in subpart A of this part.

Anthracite means coal that is classified as anthracite according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

Available purchase power means the lesser of the following:

(a) The sum of available system capacity in all neighboring companies.

(b) The sum of the rated capacities of the power interconnection devices between the principal company and all neighboring companies, minus the sum of the electric power load on these interconnections.

(c) The rated capacity of the power transmission lines between the power interconnection devices and the electric generating units (the unit in the principal company that has the malfunctioning flue gas desulfurization system and the unit(s) in the neighboring company supplying replacement electrical power) less the electric power load on these transmission lines.

Available system capacity means the capacity determined by subtracting the system load and the system emergency reserves from the net system capacity.

Biomass means plant materials and animal waste.

Bituminous coal means coal that is classified as bituminous according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

Boiler operating day for units constructed, reconstructed, or modified on or before February 28, 2005, means a 24-hour period during which fossil fuel is combusted in a steam-generating unit for the entire 24 hours. For units constructed, reconstructed, or modified after February 28, 2005, *boiler operating day* means a 24-hour period between 12 midnight and the following midnight during which any fuel is combusted at any time in the steam-generating unit. It is not necessary for fuel to be combusted the entire 24-hour period.

Coal means all solid fuels classified as anthracite, bituminous, subbituminous, or lignite by the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17) and coal refuse.

Synthetic fuels derived from coal for the purpose of creating useful heat, including but not limited to solvent-refined coal, gasified coal (not meeting the definition of natural gas), coal-oil mixtures, and coal-water mixtures are included in this definition for the purposes of this subpart.

Coal-fired electric utility steam generating unit means an electric utility steam generating unit that burns coal, coal refuse, or a synthetic gas derived from coal either exclusively, in any combination together, or in any combination with other fuels in any amount.

Coal refuse means waste products of coal mining, physical coal cleaning, and coal preparation operations (e.g. culm, gob, etc.) containing coal, matrix material, clay, and other organic and inorganic material.

Cogeneration, also known as "combined heat and power," means a steam-generating unit that simultaneously produces both electric (or mechanical) and useful thermal energy from the same primary energy source.

Combined cycle gas turbine means a stationary turbine combustion system where heat from the turbine exhaust gases is recovered by a steam generating unit.

Dry flue gas desulfurization technology or *dry FGD* means a sulfur dioxide control system that is located downstream of the steam generating unit and removes sulfur oxides (SO₂) from the combustion gases of the steam generating unit by contacting the combustion gases with an alkaline reagent and water, whether introduced separately or as a premixed slurry or solution and forming a dry powder material. This definition includes devices where the dry powder material is subsequently converted to another form. Alkaline slurries or solutions used in dry FGD technology include, but are not limited to, lime and sodium.

Duct burner means a device that combusts fuel and that is placed in the exhaust duct from another source, such as a stationary gas turbine, internal combustion engine, kiln, etc., to allow the firing of additional fuel to heat the exhaust gases before the exhaust gases enter a heat recovery steam generating unit.

Electric utility combined cycle gas turbine means any combined cycle gas turbine used for electric generation that is constructed for the purpose of supplying more than one-third of its potential electric output capacity and more than 25 MW net-electrical output to any utility power distribution system for sale. Any steam distribution system that is constructed for the purpose of providing steam to a steam electric generator that would produce electrical power for sale is also considered in determining the electrical energy output capacity of the affected facility.

Electric utility company means the largest interconnected organization, business, or governmental entity that generates electric power for sale (e.g., a holding company with operating subsidiary companies).

Electric utility steam-generating unit means any steam electric generating unit that is constructed for the purpose of supplying more than one-third of its potential electric output capacity and more than 25 MW net-electrical output to any utility power distribution system for sale. Also, any steam supplied to a steam distribution system for the purpose of providing steam to a steam-electric generator that would produce electrical energy for sale is considered in determining the electrical energy output capacity of the affected facility.

Electrostatic precipitator or *ESP* means an add-on air pollution control device used to capture particulate matter (PM) by charging the particles using an electrostatic field, collecting the particles using a grounded collecting surface, and transporting the particles into a hopper.

Emergency condition means that period of time when:

(1) The electric generation output of an affected facility with a malfunctioning flue gas desulfurization system cannot be reduced or electrical output must be increased because:

(i) All available system capacity in the principal company interconnected with the affected facility is being operated, and

(ii) All available purchase power interconnected with the affected facility is being obtained, or

(2) The electric generation demand is being shifted as quickly as possible from an affected facility with a malfunctioning flue gas desulfurization system to one or more electrical generating units held in reserve by the principal company or by a neighboring company, or

(3) An affected facility with a malfunctioning flue gas desulfurization system becomes the only available unit to maintain a part or all of the principal company's system emergency reserves and the unit is operated in spinning reserve at the lowest practical electric generation load consistent with not causing significant physical damage to the unit. If the unit is operated at a higher load to meet load demand, an emergency condition would not exist unless the conditions under paragraph (1) of this definition apply.

Emission limitation means any emissions limit or operating limit.

Emission rate period means any calendar month included in a 12-month rolling average period.

Federally enforceable means all limitations and conditions that are enforceable by the Administrator, including the requirements of 40 CFR parts 60 and 61, requirements within

any applicable State implementation plan, and any permit requirements established under 40 CFR 52.21 or under 40 CFR 51.18 and 51.24.

Fossil fuel means natural gas, petroleum, coal, and any form of solid, liquid, or gaseous fuel derived from such material for the purpose of creating useful heat.

Gaseous fuel means any fuel derived from coal or petroleum that is present as a gas at standard conditions and includes, but is not limited to, refinery fuel gas, process gas, coke-oven gas, synthetic gas, and gasified coal.

Gross output means the gross useful work performed by the steam generated and, for an IGCC electric utility steam generating unit, the work performed by the stationary combustion turbines. For a unit generating only electricity, the gross useful work performed is the gross electrical output from the unit's turbine/generator sets. For a cogeneration unit, the gross useful work performed is the gross electrical or mechanical output plus 75 percent of the useful thermal output measured relative to ISO conditions that is not used to generate additional electrical or mechanical output or to enhance the performance of the unit (i.e., steam delivered to an industrial process).

24-hour period means the period of time between 12:01 a.m. and 12:00 midnight.

Integrated gasification combined cycle electric utility steam generating unit or *IGCC electric utility steam generating unit* means an electric utility combined cycle gas turbine that is designed to burn fuels containing 50 percent (by heat input) or more solid-derived fuel not meeting the definition of natural gas. No solid fuel is directly burned in the unit during operation.

Interconnected means that two or more electric generating units are electrically tied together by a network of power transmission lines, and other power transmission equipment.

ISO conditions means a temperature of 288 Kelvin, a relative humidity of 60 percent, and a pressure of 101.3 kilopascals.

Lignite means coal that is classified as lignite A or B according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

Natural gas means:

(1) A naturally occurring mixture of hydrocarbon and nonhydrocarbon gases found in geologic formations beneath the earth's surface, of which the principal constituent is methane; or

(2) Liquid petroleum gas, as defined by the American Society of Testing and Materials in ASTM D1835 (incorporated by reference, see §60.17); or

(3) A mixture of hydrocarbons that maintains a gaseous state at ISO conditions. Additionally, natural gas must either be

composed of at least 70 percent methane by volume or have a gross calorific value between 34 and 43 megajoules (MJ) per dry standard cubic meter (910 and 1,150 Btu per dry standard cubic foot).

Neighboring company means any one of those electric utility companies with one or more electric power interconnections to the principal company and which have geographically adjoining service areas.

Net-electric output means the gross electric sales to the utility power distribution system minus purchased power on a calendar year basis.

Net system capacity means the sum of the net electric generating capability (not necessarily equal to rated capacity) of all electric generating equipment owned by an electric utility company (including steam generating units, internal combustion engines, gas turbines, nuclear units, hydroelectric units, and all other electric generating equipment) plus firm contractual purchases that are interconnected to the affected facility that has the malfunctioning flue gas desulfurization system. The electric generating capability of equipment under multiple ownership is prorated based on ownership unless the proportional entitlement to electric output is otherwise established by contractual arrangement.

Noncontinental area means the State of Hawaii, the Virgin Islands, Guam, American Samoa, the Commonwealth of Puerto Rico, or the Northern Mariana Islands.

Petroleum means crude oil or a fuel derived from crude oil, including, but not limited to, distillate oil, and residual oil.

Potential combustion concentration means the theoretical emissions (nanograms per joule (ng/J), lb/MMBtu heat input) that would result from combustion of a fuel in an uncleaned state without emission control systems) and:

(1) For particulate matter (PM) is:

(i) 3,000 ng/J (7.0 lb/MMBtu) heat input for solid fuel; and

(ii) 73 ng/J (0.17 lb/MMBtu) heat input for liquid fuels.

(2) For sulfur dioxide (SO₂) is determined under §60.50Da(c).

(3) For nitrogen oxides (NO_x) is:

(i) 290 ng/J (0.67 lb/MMBtu) heat input for gaseous fuels;

(ii) 310 ng/J (0.72 lb/MMBtu) heat input for liquid fuels; and

(iii) 990 ng/J (2.30 lb/MMBtu) heat input for solid fuels.

Potential electrical output capacity means 33 percent of the maximum design heat input capacity of the steam generating unit, divided by 3,413 Btu/KWh, divided by 1,000 kWh/MWh, and multiplied by 8,760 hr/yr (e.g., a steam generating unit with a 100 MW

(340 MMBtu/hr) fossil-fuel heat input capacity would have a 289,080 MWh 12 month potential electrical output capacity). For electric utility combined cycle gas turbines the potential electrical output capacity is determined on the basis of the fossil-fuel firing capacity of the steam generator exclusive of the heat input and electrical power contribution by the gas turbine.

Principal company means the electric utility company or companies which own the affected facility.

Resource recovery unit means a facility that combusts more than 75 percent non-fossil fuel on a quarterly (calendar) heat input basis.

Responsible official means responsible official as defined in 40 CFR 70.2.

Solid-derived fuel means any solid, liquid, or gaseous fuel derived from solid fuel for the purpose of creating useful heat and includes, but is not limited to, solvent refined coal, liquified coal, synthetic gas, gasified coal, gasified petroleum coke, gasified biomass, and gasified tire derived fuel.

Spare flue gas desulfurization system module means a separate system of SO₂ emission control equipment capable of treating an amount of flue gas equal to the total amount of flue gas generated by an affected facility when operated at maximum capacity divided by the total number of nonspare flue gas desulfurization modules in the system.

Spinning reserve means the sum of the unutilized net generating capability of all units of the electric utility company that are synchronized to the power distribution system and that are capable of immediately accepting additional load. The electric generating capability of equipment under multiple ownership is prorated based on ownership unless the proportional entitlement to electric output is otherwise established by contractual arrangement.

Steam generating unit means any furnace, boiler, or other device used for combusting fuel for the purpose of producing steam (including fossil-fuel-fired steam generators associated with combined cycle gas turbines; nuclear steam generators are not included).

Subbituminous coal means coal that is classified as subbituminous A, B, or C according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, see §60.17).

System emergency reserves means an amount of electric generating capacity equivalent to the rated capacity of the single largest electric generating unit in the electric utility company (including steam generating units, internal combustion engines, gas turbines, nuclear units, hydroelectric units, and all other electric generating equipment) which is interconnected with the affected facility that has the malfunctioning flue gas desulfurization system. The electric generating capability of

equipment under multiple ownership is prorated based on ownership unless the proportional entitlement to electric output is otherwise established by contractual arrangement.

System load means the entire electric demand of an electric utility company's service area interconnected with the affected facility that has the malfunctioning flue gas desulfurization system plus firm contractual sales to other electric utility companies. Sales to other electric utility companies (e.g., emergency power) not on a firm contractual basis may also be included in the system load when no available system capacity exists in the electric utility company to which the power is supplied for sale.

Wet flue gas desulfurization technology or *wet FGD* means a SO₂ control system that is located downstream of the steam generating unit and removes sulfur oxides from the combustion gases of the steam generating unit by contacting the combustion gases with an alkaline slurry or solution and forming a liquid material. This definition applies to devices where the aqueous liquid material product of this contact is subsequently converted to other forms. Alkaline reagents used in wet FGD technology include, but are not limited to, lime, limestone, and sodium.

[72 FR 32722, June 13, 2007, as amended at 74 FR 5079, Jan. 28, 2009]

§60.42Da Standard for particulate matter (PM).

(a) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility for which construction, reconstruction, or modification commenced before or on February 28, 2005, any gases that contain PM in excess of:

- (1) 13 ng/J (0.03 lb/MMBtu) heat input derived from the combustion of solid, liquid, or gaseous fuel;
- (2) 1 percent of the potential combustion concentration (99 percent reduction) when combusting solid fuel; and
- (3) 30 percent of potential combustion concentration (70 percent reduction) when combusting liquid fuel.

(b) On and after the date the initial PM performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility any gases which exhibit greater than 20 percent opacity (6-minute average), except for one 6-minute period per hour of not more than 27 percent opacity. Owners and operators of an affected facility that elect to install, calibrate, maintain, and

operate a continuous emissions monitoring system (CEMS) for measuring PM emissions according to the requirements of this subpart are exempt from the opacity standard specified in this paragraph b.

(c) Except as provided in paragraph (d) of this section, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification after February 28, 2005 shall cause to be discharged into the atmosphere from that affected facility any gases that contain PM in excess of either:

- (1) 18 ng/J (0.14 lb/MWh) gross energy output; or
- (2) 6.4 ng/J (0.015 lb/MMBtu) heat input derived from the combustion of solid, liquid, or gaseous fuel.

(d) As an alternative to meeting the requirements of paragraph (c) of this section, the owner or operator of an affected facility for which construction, reconstruction, or modification commenced after February 28, 2005, may elect to meet the requirements of this paragraph. On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility shall cause to be discharged into the atmosphere from that affected facility for which construction, reconstruction, or modification commenced after February 28, 2005, any gases that contain PM in excess of:

- (1) 13 ng/J (0.03 lb/MMBtu) heat input derived from the combustion of solid, liquid, or gaseous fuel, and
- (2) 0.1 percent of the combustion concentration determined according to the procedure in §60.48Da(o)(5) (99.9 percent reduction) for an affected facility for which construction or reconstruction commenced after February 28, 2005 when combusting solid, liquid, or gaseous fuel, or
- (3) 0.2 percent of the combustion concentration determined according to the procedure in §60.48Da(o)(5) (99.8 percent reduction) for an affected facility for which modification commenced after February 28, 2005 when combusting solid, liquid, or gaseous fuel.

[72 FR 32722, June 13, 2007, as amended at 74 FR 5079, Jan. 28, 2009]

§60.43Da Standard for sulfur dioxide (SO₂).

(a) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility which combusts solid fuel or

solid-derived fuel and for which construction, reconstruction, or modification commenced before or on February 28, 2005, except as provided under paragraphs (c), (d), (f) or (h) of this section, any gases that contain SO₂ in excess of:

(1) 520 ng/J (1.20 lb/MMBtu) heat input and 10 percent of the potential combustion concentration (90 percent reduction); or

(2) 30 percent of the potential combustion concentration (70 percent reduction), when emissions are less than 260 ng/J (0.60 lb/MMBtu) heat input.

(b) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility which combusts liquid or gaseous fuels (except for liquid or gaseous fuels derived from solid fuels and as provided under paragraphs (e) or (h) of this section) and for which construction, reconstruction, or modification commenced before or on February 28, 2005, any gases that contain SO₂ in excess of:

(1) 340 ng/J (0.80 lb/MMBtu) heat input and 10 percent of the potential combustion concentration (90 percent reduction); or

(2) 100 percent of the potential combustion concentration (zero percent reduction) when emissions are less than 86 ng/J (0.20 lb/MMBtu) heat input.

(c) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility which combusts solid solvent refined coal (SRC-1) any gases that contain SO₂ in excess of 520 ng/J (1.20 lb/MMBtu) heat input and 15 percent of the potential combustion concentration (85 percent reduction) except as provided under paragraph (f) of this section; compliance with the emission limitation is determined on a 30-day rolling average basis and compliance with the percent reduction requirement is determined on a 24-hour basis.

(d) Sulfur dioxide emissions are limited to 520 ng/J (1.20 lb/MMBtu) heat input from any affected facility which:

- (1) Combusts 100 percent anthracite;
- (2) Is classified as a resource recovery unit; or
- (3) Is located in a noncontinental area and combusts solid fuel or solid-derived fuel.

(e) Sulfur dioxide emissions are limited to 340 ng/J (0.80 lb/MMBtu) heat input from any affected facility which is located in a noncontinental area and combusts liquid or gaseous fuels (excluding solid-derived fuels).

(f) The emission reduction requirements under this section do not apply to any affected facility that is operated under an SO₂ commercial demonstration permit issued by the Administrator in accordance with the provisions of §60.47Da.

(g) Compliance with the emission limitation and percent reduction requirements under this section are both determined on a 30-day rolling average basis except as provided under paragraph (c) of this section.

(h) When different fuels are combusted simultaneously, the applicable standard is determined by proration using the following formula:

(1) If emissions of SO₂ to the atmosphere are greater than 260 ng/J (0.60 lb/MMBtu) heat input

$$E_s = (340x + 520y) / 100$$

and

$$\%P_s = 10$$

(2) If emissions of SO₂ to the atmosphere are equal to or less than 260 ng/J (0.60 lb/MMBtu) heat input:

$$E_s = (340x + 520y) / 100$$

and

$$\%P_s = (10x + 30y) / 100$$

Where:

E_s = Prorated SO₂ emission limit (ng/J heat input);

%P_s = Percentage of potential SO₂ emission allowed;

x = Percentage of total heat input derived from the combustion of liquid or gaseous fuels (excluding solid-derived fuels); and

y = Percentage of total heat input derived from the combustion of solid fuel (including solid-derived fuels).

(i) Except as provided in paragraphs (j) and (k) of this section, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification commenced after February 28, 2005 shall cause to be discharged into the atmosphere from that affected facility, any gases that contain SO₂ in excess of the applicable emission limitation specified in paragraphs (i)(1) through (3) of this section.

(1) For an affected facility for which construction commenced after February 28, 2005, any gases that contain SO₂ in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output on a 30-day rolling average basis; or

(ii) 5 percent of the potential combustion concentration (95 percent reduction) on a 30-day rolling average basis.

(2) For an affected facility for which reconstruction commenced after February 28, 2005, any gases that contain SO₂ in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output on a 30-day rolling average basis;

(ii) 65 ng/J (0.15 lb/MMBtu) heat input on a 30-day rolling average basis; or

(iii) 5 percent of the potential combustion concentration (95 percent reduction) on a 30-day rolling average basis.

(3) For an affected facility for which modification commenced after February 28, 2005, any gases that contain SO₂ in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output on a 30-day rolling average basis;

(ii) 65 ng/J (0.15 lb/MMBtu) heat input on a 30-day rolling average basis; or

(iii) 10 percent of the potential combustion concentration (90 percent reduction) on a 30-day rolling average basis.

(j) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification commenced after February 28, 2005, and that burns 75 percent or more (by heat input) coal refuse on a 12-month rolling average basis, shall cause to be discharged into the atmosphere from that affected facility any gases that contain SO₂ in excess of the applicable emission limitation specified in paragraphs (j)(1) through (3) of this section.

(1) For an affected facility for which construction commenced after February 28, 2005, any gases that contain SO₂ in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output on a 30-day rolling average basis; or

(ii) 6 percent of the potential combustion concentration (94 percent reduction) on a 30-day rolling average basis.

(2) For an affected facility for which reconstruction commenced after February 28, 2005, any gases that contain SO₂ in excess of either:

(i) 180 ng/J (1.4 lb/MWh) gross energy output on a 30-day rolling average basis;

(ii) 65 ng/J (0.15 lb/MMBtu) heat input on a 30-day rolling average basis; or

(iii) 6 percent of the potential combustion concentration (94 percent reduction) on a 30-day rolling average basis.

(3) For an affected facility for which modification commenced after February 28, 2005, any gases that contain SO₂ in excess of either:

- (i) 180 ng/J (1.4 lb/MWh) gross energy output on a 30-day rolling average basis;
 - (ii) 65 ng/J (0.15 lb/MMBtu) heat input on a 30-day rolling average basis; or
 - (iii) 10 percent of the potential combustion concentration (90 percent reduction) on a 30-day rolling average basis.
- (k) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility located in a noncontinental area that commenced construction, reconstruction, or modification commenced after February 28, 2005, shall cause to be discharged into the atmosphere from that

affected facility any gases that contain SO₂ in excess of the applicable emission limitation specified in paragraphs (k)(1) and (2) of this section.

(1) For an affected facility that burns solid or solid-derived fuel, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain SO₂ in excess of 520 ng/J (1.2 lb/MMBtu) heat input on a 30-day rolling average basis.

(2) For an affected facility that burns other than solid or solid-derived fuel, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain SO₂ in excess of if the affected facility or 230 ng/J (0.54 lb/MMBtu) heat input on a 30-day rolling average basis.

§60.44Da Standard for nitrogen oxides (NO_x).

(a) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility, except as provided under paragraphs (b), (d), (e), and (f) of this section, any gases that contain NO_x (expressed as NO₂) in excess of the following emission limits, based on a 30-day rolling average basis, except as provided under §60.48Da(j)(1):

(1) NO_x emission limits.

Fuel type	Emission limit for heat input	
	ng/J	lb/MMBtu
Gaseous fuels:		
Coal-derived fuels	210	0.50
All other fuels	86	0.20
Liquid fuels:		
Coal-derived fuels	210	0.50
Shale oil	210	0.50
All other fuels	130	0.30
Solid fuels:		
Coal-derived fuels	210	0.50
Any fuel containing more than 25%, by weight, coal refuse	(i)	(i)
Any fuel containing more than 25%, by weight, lignite if the lignite is mined in North Dakota, South Dakota, or Montana, and is combusted in a slag tap furnace ²	340	0.80
Any fuel containing more than 25%, by weight, lignite not subject to the 340 ng/J heat input emission limit ²	260	0.60
Subbituminous coal	210	0.50
Bituminous coal	260	0.60
Anthracite coal	260	0.60
All other fuels	260	0.60

¹Exempt from NO_x standards and NO_x monitoring requirements.

²Any fuel containing less than 25%, by weight, lignite is not prorated but its percentage is added to the percentage of the predominant fuel.

(2) NO_x reduction requirement.

Fuel type	Percent reduction of potential combustion concentration
Gaseous fuels	25
Liquid fuels	30
Solid fuels	65

(b) The emission limitations under paragraph (a) of this section do not apply to any affected facility which is combusting coal-derived liquid fuel and is operating under a commercial demonstration permit issued by the Administrator in accordance with the provisions of §60.47Da.

(c) Except as provided under paragraphs (d), (e), and (f) of this section, when two or more fuels are combusted simultaneously, the applicable standard is determined by proration using the following formula

$$E_n = (86w + 130x + 210y + 260z + 340v) / 100$$

Where:

E_n = Applicable standard for NO_x when multiple fuels are combusted simultaneously (ng/J heat input);

w = Percentage of total heat input derived from the combustion of fuels subject to the 86 ng/J heat input standard;

x = Percentage of total heat input derived from the combustion of fuels subject to the 130 ng/J heat input standard;

y = Percentage of total heat input derived from the combustion of fuels subject to the 210 ng/J heat input standard;

z = Percentage of total heat input derived from the combustion of fuels subject to the 260 ng/J heat input standard; and

v = Percentage of total heat input delivered from the combustion of fuels subject to the 340 ng/J heat input standard.

(d)(1) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction after July 9, 1997, but before or on February 28, 2005 shall cause to be discharged into the atmosphere any gases that contain NO_x (expressed as NO₂) in excess of 200 ng/J (1.6 lb/MWh) gross energy output, based on a 30-day rolling average basis, except as provided under §60.48Da(k).

(2) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of affected facility for which reconstruction commenced after July 9, 1997, but before or on February 28, 2005 shall cause to be discharged into the atmosphere any gases that contain NO_x (expressed as NO₂) in excess of 65 ng/J (0.15 lb/MMBtu) heat input, based on a 30-day rolling average basis.

(e) Except for an IGCC electric utility steam generating unit meeting the requirements of paragraph (f) of this section, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator of an affected facility that commenced construction, reconstruction, or modification after February 28, 2005 shall cause to be discharged into the atmosphere from that affected facility any gases that contain NO_x (expressed as NO₂) in excess of the applicable emission limitation specified in paragraphs (e)(1) through (3) of this section.

(1) For an affected facility for which construction commenced after February 28, 2005, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain NO_x (expressed as NO₂) in excess of 130 ng/J (1.0 lb/MWh) gross energy output on a 30-day rolling average basis, except as provided under §60.48Da(k).

(2) For an affected facility for which reconstruction commenced after February 28, 2005, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain NO_x (expressed as NO₂) in excess of either:

- (i) 130 ng/J (1.0 lb/MWh) gross energy output on a 30-day rolling average basis; or
- (ii) 47 ng/J (0.11 lb/MMBtu) heat input on a 30-day rolling average basis.

(3) For an affected facility for which modification commenced after February 28, 2005, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain NO_x (expressed as NO₂) in excess of either:

- (i) 180 ng/J (1.4 lb/MWh) gross energy output on a 30-day rolling average basis; or
- (ii) 65 ng/J (0.15 lb/MMBtu) heat input on a 30-day rolling average basis.

(f) On and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, the owner or operator of an IGCC electric utility steam generating unit subject to the provisions of this subpart and for which construction, reconstruction, or modification commenced after February 28, 2005, shall meet the requirements specified in paragraphs (f)(1) through (3) of this section.

(1) Except as provided for in paragraphs (f)(2) and (3) of this section, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain NO_x (expressed as NO₂) in excess of 130 ng/J (1.0 lb/MWh) gross energy output on a 30-day rolling average basis.

(2) When burning liquid fuel exclusively or in combination with solid-derived fuel such that the liquid fuel contributes 50 percent or more of the total heat input to the combined cycle combustion turbine, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain NO_x

(expressed as NO₂) in excess of 190 ng/J (1.5 lb/MWh) gross energy output on a 30-day rolling average basis.

(3) In cases when during a 30-day rolling average compliance period liquid fuel is burned in such a manner to meet the conditions in paragraph (f)(2) of this section for only a portion of the clock hours in the 30-day period, the owner or operator shall not cause to be discharged into the atmosphere any gases that contain NO_x (expressed as NO₂) in excess of the computed weighted-average emissions limit based on the proportion of gross energy output (in MWh) generated during the compliance period for each of emissions limits in paragraphs (f)(1) and (2) of this section.

§60.45Da Standard for mercury (Hg).

(a) For each coal-fired electric utility steam generating unit other than an IGCC electric utility steam generating unit, on and after the date on which the initial performance test is completed or required to be completed under §60.8, whichever date comes first, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility for which construction, modification, or reconstruction commenced after January 30, 2004, any gases that contain mercury (Hg) emissions in excess of each Hg emissions limit in paragraphs (a)(1) through (5) of this section that applies to you. The Hg emissions limits in paragraphs (a)(1) through (5) of this section are based on a 12-month rolling average basis using the procedures in §60.50Da(h).

(1) For each coal-fired electric utility steam generating unit that burns only bituminous coal, you must not discharge into the atmosphere any gases from a new affected source that contain Hg in excess of 20×10^{-6} pound per megawatt hour (lb/MWh) or 0.020 lb/gigawatt-hour (GWh) on an output basis. The International System of Units (SI) equivalent is 0.0025 ng/J.

(2) For each coal-fired electric utility steam generating unit that burns only subbituminous coal:

(i) If your unit is located in a county-level geographical area receiving greater than 25 inches per year (in/yr) mean annual precipitation, based on the most recent publicly available U.S. Department of Agriculture 30-year data, you must not discharge into the atmosphere any gases from a new affected source that contain Hg in excess of 66×10^{-6} lb/MWh or 0.066 lb/GWh on an output basis. The SI equivalent is 0.0083 ng/J.

(ii) If your unit is located in a county-level geographical area receiving less than or equal to 25 in/yr mean annual precipitation, based on the most recent publicly available U.S. Department of Agriculture 30-year data, you must not discharge into the atmosphere any gases from a new affected source that contain

Hg in excess of 97×10^{-6} lb/MWh or 0.097 lb/GWh on an output basis. The SI equivalent is 0.0122 ng/J.

(3) For each coal-fired electric utility steam generating unit that burns only lignite, you must not discharge into the atmosphere any gases from a new affected source that contain Hg in excess of 175×10^{-6} lb/MWh or 0.175 lb/GWh on an output basis. The SI equivalent is 0.0221 ng/J.

(4) For each coal-burning electric utility steam generating unit that burns only coal refuse, you must not discharge into the atmosphere any gases from a new affected source that contain Hg in excess of 16×10^{-6} lb/MWh or 0.016 lb/GWh on an output basis. The SI equivalent is 0.0020 ng/J.

(5) For each coal-fired electric utility steam generating unit that burns a blend of coals from different coal ranks (i.e., bituminous coal, subbituminous coal, lignite) or a blend of coal and coal refuse, you must not discharge into the atmosphere any gases from a new affected source that contain Hg in excess of the unit-specific Hg emissions limit established according to paragraph (a)(5)(i) or (ii) of this section, as applicable to the affected unit.

(i) If you operate a coal-fired electric utility steam generating unit that burns a blend of coals from different coal ranks or a blend of coal and coal refuse, you must not discharge into the atmosphere any gases from a new affected source that contain Hg in excess of the computed weighted Hg emissions limit based on the Btu, MWh, or MJ contributed by each coal rank burned during the compliance period and its applicable Hg emissions limit in paragraphs (a)(1) through (4) of this section as determined using Equation 1 in this section. For each affected source, you must comply with the weighted Hg emissions limit calculated using Equation 1 in this section based on the total Hg emissions from the unit and the total Btu, MWh, or MJ contributed by all fuels burned during the compliance period.

$$EL_b = \frac{\sum_{i=1}^n EL_i(HH_i)}{\sum_{i=1}^n HH_i} \quad (\text{Eq. 1})$$

Where:

EL_b = Total allowable Hg in lb/MWh that can be emitted to the atmosphere from any affected source being averaged according to this paragraph.

EL_i = Hg emissions limit for the subcategory i (coal rank) that applies to affected source, lb/MWh;

HH_i = For each affected source, the Btu, MWh, or MJ contributed by the corresponding subcategory i (coal rank) burned during the compliance period; and

n = Number of subcategories (coal ranks) being averaged for an affected source.

(ii) If you operate a coal-fired electric utility steam generating unit that burns a blend of coals from different coal ranks or a blend of coal and coal refuse together with one or more non-regulated, supplementary fuels, you must not discharge into the atmosphere any gases from a new affected source that contain Hg in excess of the computed weighted Hg emission limit based on the Btu, MWh, or MJ contributed by each coal rank burned during the compliance period and its applicable Hg emissions limit in paragraphs (a)(1) through (4) of this section as determined using Equation 1 in this section. For each affected source. You must comply with the weighted Hg emissions limit calculated using Equation 1 in this section based on the total Hg emissions from the unit contributed by both regulated and nonregulated fuels burned during the compliance period and the total Btu, MWh, or MJ contributed by both regulated and nonregulated fuels burned during the compliance period.

(b) For each IGCC electric utility steam generating unit, on and after the date on which the initial performance test required to be conducted under §60.8 is completed, no owner or operator subject to the provisions of this subpart shall cause to be discharged into the atmosphere from any affected facility for which construction, modification, or reconstruction commenced after January 30,

2004, any gases that contain Hg emissions in excess of 20×10^{-6} lb/MWh or 0.020 lb/GWh on an output basis. The SI equivalent is 0.0025 ng/J. This Hg emissions limit is based on a 12-month rolling average basis using the procedures in §60.50Da(h).

§60.46Da [Reserved]

§60.47Da Commercial demonstration permit.

(a) An owner or operator of an affected facility proposing to demonstrate an emerging technology may apply to the Administrator for a commercial demonstration permit. The Administrator will issue a commercial demonstration permit in accordance with paragraph (e) of this section. Commercial demonstration permits may be issued only by the Administrator, and this authority will not be delegated.

(b) An owner or operator of an affected facility that combusts solid solvent refined coal (SRC-I) and who is issued a commercial demonstration permit by the Administrator is not subject to the SO₂ emission reduction requirements under §60.43Da(c) but must, as a minimum, reduce SO₂ emissions to 20 percent of the potential combustion concentration (80 percent reduction) for each 24-hour period of steam generator operation and to less than 520

ng/J (1.20 lb/MMBtu) heat input on a 30-day rolling average basis.

(c) An owner or operator of a fluidized bed combustion electric utility steam generator (atmospheric or pressurized) who is issued a commercial demonstration permit by the Administrator is not subject to the SO₂ emission reduction requirements under §60.43Da(a) but must, as a minimum, reduce SO₂ emissions to 15 percent of the potential combustion concentration (85 percent reduction) on a 30-day rolling average basis and to less than 520 ng/J (1.20 lb/MMBtu) heat input on a 30-day rolling average basis.

(d) The owner or operator of an affected facility that combusts coal-derived liquid fuel and who is issued a commercial demonstration permit by the Administrator is not subject to the applicable NO_x emission limitation and percent reduction under §60.44Da(a) but must, as a minimum, reduce emissions to less than 300 ng/J (0.70 lb/MMBtu) heat input on a 30-day rolling average basis.

(e) Commercial demonstration permits may not exceed the following equivalent MW electrical generation capacity for any one technology category, and the total equivalent MW electrical generation capacity for all commercial demonstration plants may not exceed 15,000 MW.

Technology	Pollutant	Equivalent electrical capacity (MW electrical output)
Solid solvent refined coal (SCR I)	SO ₂	6,000–10,000
Fluidized bed combustion (atmospheric)	SO ₂	400–3,000
Fluidized bed combustion (pressurized)	SO ₂	400–1,200
Coal liquification	NO _x	750–10,000
Total allowable for all technologies		15,000

§60.48Da Compliance provisions.

(a) Compliance with the PM emission limitation under §60.42Da(a)(1) constitutes compliance with the percent reduction requirements for PM under §60.42Da(a)(2) and (3).

(b) Compliance with the NO_x emission limitation under §60.44Da(a)(1) constitutes compliance with the percent reduction requirements under §60.44Da(a)(2).

(c) The PM emission standards under §60.42Da and the NO_x emission standards under §60.44Da apply at all times except during periods of startup, shutdown, or malfunction. The sulfur dioxide emission standards under §60.43Da apply at all times except during periods of startup, shutdown, or when both emergency conditions exist and the procedures under paragraph (d) of this section are implemented.

(d) During emergency conditions in the principal company, an affected facility with a malfunctioning flue gas desulfurization system may be operated if SO₂ emissions are minimized by:

(1) Operating all operable flue gas desulfurization system modules, and bringing back into operation any malfunctioned module as soon as repairs are completed,

(2) Bypassing flue gases around only those flue gas desulfurization system modules that have been taken out of operation because they were incapable of any SO₂ emission reduction or which would have suffered significant physical damage if they had remained in operation, and

(3) Designing, constructing, and operating a spare flue gas desulfurization system module for an affected facility larger than 365 MW (1,250 MMBtu/hr) heat input (approximately 125 MW electrical output capacity). The Administrator may at his discretion require the owner or operator within 60 days of notification to demonstrate spare module capability. To demonstrate this capability, the owner or operator must demonstrate compliance with the appropriate requirements under paragraph under §60.43Da(a), (b), (d), (e), and (h) for any period of operation lasting from 24 hours to 30 days when:

(i) Any one flue gas desulfurization module is not operated,

(ii) The affected facility is operating at the maximum heat input rate,

(iii) The fuel fired during the 24-hour to 30-day period is representative of the type and average sulfur content of fuel used over a typical 30-day period, and

(iv) The owner or operator has given the Administrator at least 30 days notice of the date and period of time over which the demonstration will be performed.

(e) After the initial performance test required under §60.8, compliance with the SO₂ emission limitations and percentage reduction requirements under §60.43Da and the NO_x emission limitations under §60.44Da is based on the average emission rate for 30 successive boiler operating days. A separate performance test is completed at the end of each boiler operating day after the initial performance test, and a new 30 day average emission rate for both SO₂ and NO_x and a new percent reduction for SO₂ are calculated to show compliance with the standards.

(f) For the initial performance test required under §60.8, compliance with the SO₂ emission limitations and percent reduction requirements under §60.43Da and the NO_x emission limitation under §60.44Da is based on the average emission rates for SO₂, NO_x, and percent reduction for SO₂ for the first 30 successive boiler operating days. The initial performance test is the only test in which at least 30 days prior notice is required unless otherwise specified by the Administrator. The initial performance test is to be scheduled so that the first boiler operating day of the 30 successive boiler operating days is completed within 60 days after achieving the maximum production rate at which the affected facility will be operated, but not later than 180 days after initial startup of the facility.

(g) The owner or operator of an affected facility subject to emission limitations in this subpart shall determine compliance as follows:

(1) Compliance with applicable 30-day rolling average SO₂ and NO_x emission limitations is determined by calculating the arithmetic average of all hourly emission rates for SO₂ and NO_x for the 30 successive boiler operating days, except for data obtained during startup, shutdown, malfunction (NO_x only), or emergency conditions (SO₂ only).

(2) Compliance with applicable SO₂ percentage reduction requirements is determined based on the average inlet and outlet SO₂ emission rates for the 30 successive boiler operating days.

(3) Compliance with applicable daily average PM emission limitations is determined by calculating the arithmetic average of all hourly emission rates for PM each boiler operating day, except for data obtained during startup, shutdown, and malfunction. Averages are only calculated for boiler operating days that have valid data for at least 18 hours of unit operation during which the standard applies. Instead, all of the valid hourly emission rates of the operating day(s) not meeting the minimum 18 hours valid data daily average requirement are averaged with all of the valid hourly emission rates of the next boiler operating day with 18 hours or more of valid PM CEMS data to determine compliance.

(h) If an owner or operator has not obtained the minimum quantity of emission data as required under §60.49Da of this subpart, compliance of the affected facility with the emission requirements under §§60.43Da and 60.44Da of this subpart for the day on which the 30-day period ends may be determined by the Administrator by following the applicable procedures in section 7 of Method 19 of appendix A of this part.

(i) Compliance provisions for sources subject to §60.44Da(d)(1), (e)(1), (e)(2)(i), (e)(3)(i), or (f). The owner or operator of an affected facility subject to §60.44Da(d)(1), (e)(1), (e)(2)(i), (e)(3)(i), or (f) shall calculate NO_x

emissions as 1.194×10^{-7} lb/scf-ppm times the average hourly NO_x output concentration in ppm (measured according to the provisions of §60.49Da(c)), times the average hourly flow rate (measured in scfh, according to the provisions of §60.49Da(l) or §60.49Da(m)), divided by the average hourly gross energy output (measured according to the provisions of §60.49Da(k)). Alternatively, for oil-fired and gas-fired units, NO_x emissions may be calculated by multiplying the hourly NO_x emission rate in lb/MMBtu (measured by the CEMS required under §§60.49Da(c) and (d)), by the hourly heat input rate (measured according to the provisions of §60.49Da(n)), and dividing the result by the average gross energy output (measured according to the provisions of §60.49Da(k)).

(j) Compliance provisions for duct burners subject to §60.44Da(a)(1). To determine compliance with the emissions limits for NO_x required by §60.44Da(a) for duct burners used in combined cycle systems, either of the procedures described in paragraph (j)(1) or (2) of this section may be used:

(1) The owner or operator of an affected duct burner shall conduct the performance test required under §60.8 using the appropriate methods in appendix A of this part. Compliance with the emissions limits under §60.44Da(a)(1) is determined on the average of three (nominal 1-hour) runs for the initial and subsequent performance tests. During the performance test, one sampling site shall be located in the exhaust of the turbine prior to the duct burner. A second sampling site shall be located at the outlet from the heat recovery steam generating unit. Measurements shall be taken at both sampling sites during the performance test; or

(2) The owner or operator of an affected duct burner may elect to determine compliance by using the CEMS specified under §60.49Da for measuring NO_x and oxygen (O₂) (or carbon dioxide (CO₂)) and meet the requirements of §60.49Da. Alternatively, data from a NO_x emission rate (i.e., NO_x-diluent) CEMS certified according to the provisions of §75.20(c) of this chapter and appendix A to part 75 of this chapter, and meeting the quality assurance requirements of §75.21 of this chapter and appendix B to part 75 of this chapter, may be used, with the following caveats. Data used to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter. The sampling site shall be located at the outlet from the steam generating unit. The NO_x emission rate at the outlet from the steam generating unit shall constitute the NO_x emission rate from the duct burner of the combined-cycle system.

(k) Compliance provisions for duct burners subject to §60.44Da(d)(1) or (e)(1). To determine compliance with the emission

limitation for NO_x required by §60.44Da(d)(1) or (e)(1) for duct burners used in combined cycle systems, either of the procedures described in paragraphs (k)(1) and (2) of this section may be used:

(1) The owner or operator of an affected duct burner used in combined cycle systems shall determine compliance with the applicable NO_x emission limitation in §60.44Da(d)(1) or (e)(1) as follows:

(i) The emission rate (E) of NO_x shall be computed using Equation 2 in this section:

$$E = \left[(C_{sg} \times Q_{sg}) - (C_{te} \times Q_{te}) \right] / (O_{sg} \times h) \quad (\text{Eq. 2})$$

Where:

E = Emission rate of NO_x from the duct burner, ng/J (lb/MWh) gross output;

C_{sg} = Average hourly concentration of NO_x exiting the steam generating unit, ng/dscm (lb/dscf);

C_{te} = Average hourly concentration of NO_x in the turbine exhaust upstream from duct burner, ng/dscm (lb/dscf);

Q_{sg} = Average hourly volumetric flow rate of exhaust gas from steam generating unit, dscm/hr (dscf/hr);

Q_{te} = Average hourly volumetric flow rate of exhaust gas from combustion turbine, dscm/hr (dscf/hr);

O_{sg} = Average hourly gross energy output from steam generating unit, J (MWh); and

h = Average hourly fraction of the total heat input to the steam generating unit derived from the combustion of fuel in the affected duct burner.

(ii) Method 7E of appendix A of this part shall be used to determine the NO_x concentrations (C_{sg} and C_{te}). Method 2, 2F or 2G of appendix A of this part, as appropriate, shall be used to determine the volumetric flow rates (Q_{sg} and Q_{te}) of the exhaust gases. The volumetric flow rate measurements shall be taken at the same time as the concentration measurements.

(iii) The owner or operator shall develop, demonstrate, and provide information satisfactory to the Administrator to determine the average hourly gross energy output from the steam generating unit, and the average hourly percentage of the total heat input to the steam generating unit derived from the combustion of fuel in the affected duct burner.

(iv) Compliance with the applicable NO_x emission limitation in §60.44Da(d)(1) or (e)(1) is determined by the three-run average (nominal 1-hour runs) for the initial and subsequent performance tests.

(2) The owner or operator of an affected duct burner used in a combined cycle system may elect to determine compliance with the applicable NO_x emission limitation in §60.44Da(d)(1) or (e)(1) on a 30-day rolling average basis as indicated in paragraphs (k)(2)(i) through (iv) of this section.

(i) The emission rate (E) of NO_x shall be computed using Equation 3 in this section:

$$E = (C_{sg} \times Q_{sg}) / O_{cc} \quad (\text{Eq. 3})$$

Where:

E = Emission rate of NO_x from the duct burner, ng/J (lb/MWh) gross output;

C_{sg} = Average hourly concentration of NO_x exiting the steam generating unit, ng/dscm (lb/dscf);

Q_{sg} = Average hourly volumetric flow rate of exhaust gas from steam generating unit, dscm/hr (dscf/hr); and

O_{cc} = Average hourly gross energy output from entire combined cycle unit, J (MWh).

(ii) The CEMS specified under §60.49Da for measuring NO_x and O₂ (or CO₂) shall be used to determine the average hourly NO_x concentrations (C_{sg}). The continuous flow monitoring system specified in §60.49Da(l) or §60.49Da(m) shall be used to determine the volumetric flow rate (Q_{sg}) of the exhaust gas. If the option to use the flow monitoring system in §60.49Da(m) is selected, the flow rate data used to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter. The sampling site shall be located at the outlet from the steam generating unit.

(iii) The continuous monitoring system specified under §60.49Da(k) for measuring and determining gross energy output shall be used to determine the average hourly gross energy output from the entire combined cycle unit (O_{cc}), which is the combined output from the combustion turbine and the steam generating unit.

(iv) The owner or operator may, in lieu of installing, operating, and recording data from the continuous flow monitoring system specified in §60.49Da(l), determine the mass rate (lb/hr) of NO_x emissions by installing, operating, and maintaining continuous fuel flowmeters following the appropriate measurements procedures specified in appendix D of part 75 of this chapter. If this compliance option is selected, the emission rate (E) of NO_x shall be computed using Equation 4 in this section:

$$E = (ER_{sg} \times H_{cc}) / O_{cc} \quad (\text{Eq. 4})$$

Where:

E = Emission rate of NO_x from the duct burner, ng/J (lb/MWh) gross output;

ER_{sg} = Average hourly emission rate of NO_x exiting the steam generating unit heat input calculated using appropriate F factor as described in Method 19 of appendix A of this part, ng/J (lb/MMBtu);

H_{cc} = Average hourly heat input rate of entire combined cycle unit, J/hr (MMBtu/hr); and

O_{cc} = Average hourly gross energy output from entire combined cycle unit, J (MWh).

(3) When an affected duct burner steam generating unit utilizes a common steam turbine with one or more affected duct burner steam generating units, the owner or operator shall either:

(i) Determine compliance with the applicable NO_x emissions limits by measuring the emissions combined with the emissions from the other unit(s) utilizing the common steam turbine; or

(ii) Develop, demonstrate, and provide information satisfactory to the Administrator on methods for apportioning the combined gross energy output from the steam turbine for each of the affected duct burners. The Administrator may approve such demonstrated substitute methods for apportioning the combined gross energy output measured at the steam turbine whenever the demonstration ensures accurate estimation of emissions regulated under this part.

(l) *Compliance provisions for sources subject to §60.45Da.* The owner or operator of an affected facility subject to §60.45Da (new sources constructed or reconstructed after January 30, 2004) shall calculate the Hg emission rate (lb/MWh) for each calendar month of the year, using hourly Hg concentrations measured according to the provisions of §60.49Da(p) in conjunction with hourly stack gas volumetric flow rates measured according to the provisions of §60.49Da(l) or (m), and hourly gross electrical outputs, determined according to the provisions in §60.49Da(k). Compliance with the applicable standard under §60.45Da is determined on a 12-month rolling average basis.

(m) *Compliance provisions for sources subject to §60.43Da(i)(1)(i), (i)(2)(i), (i)(3)(i), (j)(1)(i), (j)(2)(i), or (j)(3)(i).* The owner or operator of an affected facility subject to §60.43Da(i)(1)(i), (i)(2)(i), (i)(3)(i), (j)(1)(i), (j)(2)(i), or (j)(3)(i) shall calculate SO₂ emissions as 1.660 × 10⁻⁷ lb/scf-ppm times the average hourly SO₂ output concentration in ppm (measured according to the provisions of §60.49Da(b)), times the average hourly flow rate (measured according to the provisions of §60.49Da(l) or §60.49Da(m)), divided by the average hourly gross energy output (measured according to the provisions of §60.49Da(k)). Alternatively, for oil-fired and gas-fired units, SO₂ emissions may be calculated by multiplying the hourly SO₂ emission rate (in lb/MMBtu), measured by the CEMS required under §60.49Da, by the hourly heat input rate (measured according to the provisions of §60.49Da(n)), and dividing the result by the average gross energy output (measured according to the provisions of §60.49Da(k)).

(n) *Compliance provisions for sources subject to §60.42Da(c)(1).* The owner or operator of an affected facility subject to §60.42Da(c)(1) shall calculate PM emissions by multiplying the average hourly PM output concentration (measured according to the provisions of §60.49Da(i)), by the average hourly flow rate (measured according to the provisions of §60.49Da(l) or §60.49Da(m)), and divided by the average hourly gross energy output (measured according to the provisions of §60.49Da(k)). Compliance with the emission limit is determined by calculating the arithmetic average of the hourly emission rates computed for each boiler operating day.

(o) *Compliance provisions for sources subject to §60.42Da(c)(2) or (d).* Except as provided for in paragraph (p) of this section, the owner or operator of an affected facility for which construction, reconstruction, or modification commenced after February 28, 2005, shall demonstrate compliance with each applicable emission limit according to the requirements in paragraphs (o)(1) through (o)(5) of this section.

(1) You must conduct a performance test to demonstrate initial compliance with the applicable PM emissions limit in §60.42Da(c)(2) or (d) by the applicable date specified in §60.8(a). Thereafter, you must conduct each subsequent performance test within 12 calendar months following the date the previous performance test was required to be conducted. You must conduct each performance test according to the requirements in §60.8 using the test methods and procedures in §60.50Da. The owner or operator of an affected facility that has not operated for 60 consecutive calendar days prior to the date that the subsequent performance test would have been required had the unit been operating is not required to perform the subsequent performance test until 30 calendar days after the next boiler operating day. Requests for additional 30 day extensions shall be granted by the relevant air division or office director of the appropriate Regional Office of the U.S. EPA.

(2) You must monitor the performance of each electrostatic precipitator or fabric filter (baghouse) operated to comply with the applicable PM emissions limit in §60.42Da(c)(2) or (d) using a continuous opacity monitoring system (COMS) according to the requirements in paragraphs (o)(2)(i) through (vi) unless you elect to comply with one of the alternatives provided in paragraphs (o)(3) and (o)(4) of this section, as applicable to your control device.

(i) Each COMS must meet Performance Specification 1 in 40 CFR part 60, appendix B.

(ii) You must comply with the quality assurance requirements in paragraphs (o)(2)(ii)(A) through (E) of this section.

(A) You must automatically (intrinsic to the opacity monitor) check the zero and upscale (span) calibration drifts at least once daily. For a particular COMS, the acceptable range of zero and upscale calibration materials is as defined in the applicable version of Performance Specification I in 40 CFR part 60, appendix B.

(B) You must adjust the zero and span whenever the 24-hour zero drift or 24-hour span drift exceeds 4 percent opacity. The COMS must allow for the amount of excess zero and span drift measured at the 24-hour interval checks to be recorded and quantified. The optical surfaces exposed to the effluent gases must be cleaned prior to performing the zero and span drift adjustments, except for systems using automatic zero adjustments. For systems using automatic zero adjustments, the optical surfaces must be cleaned when the cumulative automatic zero compensation exceeds 4 percent opacity.

(C) You must apply a method for producing a simulated zero opacity condition and an upscale (span) opacity condition using a certified neutral density filter or other related technique to produce a known obscuration of the light beam. All procedures applied must provide a system check of the analyzer internal optical surfaces and all electronic circuitry including the lamp and photodetector assembly.

(D) Except during periods of system breakdowns, repairs, calibration checks, and zero and span adjustments, the COMS must be in continuous operation and must complete a minimum of one cycle of sampling and analyzing for each successive 10 second period and one cycle of data recording for each successive 6-minute period.

(E) You must reduce all data from the COMS to 6-minute averages. Six-minute opacity averages must be calculated from 36 or more data points equally spaced over each 6-minute period. Data recorded during periods of system breakdowns, repairs, calibration checks, and zero and span adjustments must not be included in the data averages. An arithmetic or integrated average of all data may be used.

(iii) During each performance test conducted according to paragraph (o)(1) of this section, you must establish an opacity baseline level. The value of the opacity baseline level is determined by averaging all of the 6-minute average opacity values (reported to the nearest 0.1 percent opacity) from the COMS measurements recorded during each of the test run intervals conducted for the performance test, and then adding 2.5 percent opacity to your calculated average opacity value for all of the test runs. If your opacity baseline level is less than 5.0 percent, then the opacity baseline level is set at 5.0 percent.

(iv) You must evaluate the preceding 24-hour average opacity level measured by the COMS each boiler operating day excluding periods of

affected facility startup, shutdown, or malfunction. If the measured 24-hour average opacity emission level is greater than the baseline opacity level determined in paragraph (o)(2)(iii) of this section, you must initiate investigation of the relevant equipment and control systems within 24 hours of the first discovery of the high opacity incident and take the appropriate corrective action as soon as practicable to adjust control settings or repair equipment to reduce the measured 24-hour average opacity to a level below the baseline opacity level. In cases when a wet scrubber is used in combination with another PM control device that serves as the primary PM control device, the wet scrubber must be maintained and operated.

(v) You must record the opacity measurements, calculations performed, and any corrective actions taken. The record of corrective action taken must include the date and time during which the measured 24-hour average opacity was greater than baseline opacity level, and the date, time, and description of the corrective action.

(vi) If the measured 24-hour average opacity for your affected facility remains at a level greater than the opacity baseline level after 7 boiler operating days, then you must conduct a new PM performance test according to paragraph (o)(1) of this section and establish a new opacity baseline value according to paragraph (o)(2) of this section. This new performance test must be conducted within 60 days of the date that the measured 24-hour average opacity was first determined to exceed the baseline opacity level unless a waiver is granted by the permitting authority.

(3) As an alternative to complying with the requirements of paragraph (o)(2) of this section, an owner or operator may elect to monitor the performance of an electrostatic precipitator (ESP) operated to comply with the applicable PM emissions limit in §60.42Da(c)(2) or (d) using an ESP predictive model developed in accordance with the requirements in paragraphs (o)(3)(i) through (v) of this section.

(i) You must calibrate the ESP predictive model with each PM control device used to comply with the applicable PM emissions limit in §60.42Da(c)(2) or (d) operating under normal conditions. In cases when a wet scrubber is used in combination with an ESP to comply with the PM emissions limit, the wet scrubber must be maintained and operated.

(ii) You must develop a site-specific monitoring plan that includes a description of the ESP predictive model used, the model input parameters, and the procedures and criteria for establishing monitoring parameter baseline levels indicative of compliance with the PM emissions limit. You must submit the site-specific monitoring plan for approval by the permitting authority. For reference purposes in preparing the monitoring plan, see

the OAQPS "Compliance Assurance Monitoring (CAM) Protocol for an Electrostatic Precipitator (ESP) Controlling Particulate Matter (PM) Emissions from a Coal-Fired Boiler." This document is available from the U.S. Environmental Protection Agency (U.S. EPA); Office of Air Quality Planning and Standards; Sector Policies and Programs Division; Measurement Policy Group (D243-02), Research Triangle Park, NC 27711. This document is also available on the Technology Transfer Network (TTN) under Emission Measurement Center Continuous Emission Monitoring.

(iii) You must run the ESP predictive model using the applicable input data each boiler operating day and evaluate the model output for the preceding boiler operating day excluding periods of affected facility startup, shutdown, or malfunction. If the values for one or more of the model parameters exceed the applicable baseline levels determined according to your approved site-specific monitoring plan, you must initiate investigation of the relevant equipment and control systems within 24 hours of the first discovery of a model parameter deviation and, take the appropriate corrective action as soon as practicable to adjust control settings or repair equipment to return the model output to within the applicable baseline levels.

(iv) You must record the ESP predictive model inputs and outputs and any corrective actions taken. The record of corrective action taken must include the date and time during which the model output values exceeded the applicable baseline levels, and the date, time, and description of the corrective action.

(v) If after 7 consecutive days a model parameter continues to exceed the applicable baseline level, then you must conduct a new PM performance test according to paragraph (o)(1) of this section. This new performance test must be conducted within 60 calendar days of the date that the model parameter was first determined to exceed its baseline level unless a waiver is granted by the permitting authority.

(4) As an alternative to complying with the requirements of paragraph (o)(2) of this section, an owner or operator may elect to monitor the performance of a fabric filter (baghouse) operated to comply with the applicable PM emissions limit in §60.42Da(c)(2) or (d) by using a bag leak detection system according to the requirements in paragraphs (o)(4)(i) through (v) of this section.

(i) Each bag leak detection system must meet the specifications and requirements in paragraphs (o)(4)(i)(A) through (H) of this section.

(A) The bag leak detection system must be certified by the manufacturer to be capable of detecting PM emissions at concentrations of 1 milligram per actual cubic meter (0.00044 grains per actual cubic foot) or less.

(B) The bag leak detection system sensor must provide output of relative PM loadings. The owner or operator must continuously record the output from the bag leak detection system using electronic or other means (e.g. , using a strip chart recorder or a data logger.)

(C) The bag leak detection system must be equipped with an alarm system that will react when the system detects an increase in relative particulate loading over the alarm set point established according to paragraph (o)(4)(i)(D) of this section, and the alarm must be located such that it can be noticed by the appropriate plant personnel.

(D) In the initial adjustment of the bag leak detection system, you must establish, at a minimum, the baseline output by adjusting the sensitivity (range) and the averaging period of the device, the alarm set points, and the alarm delay time.

(E) Following initial adjustment, you must not adjust the averaging period, alarm set point, or alarm delay time without approval from the permitting authority except as provided in paragraph (d)(1)(vi) of this section.

(F) Once per quarter, you may adjust the sensitivity of the bag leak detection system to account for seasonal effects, including temperature and humidity, according to the procedures identified in the site-specific monitoring plan required by paragraph (o)(4)(ii) of this section.

(G) You must install the bag leak detection sensor downstream of the fabric filter and upstream of any wet scrubber.

(H) Where multiple detectors are required, the system's instrumentation and alarm may be shared among detectors.

(i) You must develop and submit to the permitting authority for approval a site-specific monitoring plan for each bag leak detection system. You must operate and maintain the bag leak detection system according to the site-specific monitoring plan at all times. Each monitoring plan must describe the items in paragraphs (o)(4)(ii)(A) through (F) of this section.

(A) Installation of the bag leak detection system;

(B) Initial and periodic adjustment of the bag leak detection system, including how the alarm set-point will be established;

(C) Operation of the bag leak detection system, including quality assurance procedures;

(D) How the bag leak detection system will be maintained, including a routine maintenance schedule and spare parts inventory list;

(E) How the bag leak detection system output will be recorded and stored; and

(F) Corrective action procedures as specified in paragraph (o)(4)(iii) of this section. In approving the site-specific monitoring plan, the permitting authority may allow owners and operators more than 3 hours to alleviate a

specific condition that causes an alarm if the owner or operator identifies in the monitoring plan this specific condition as one that could lead to an alarm, adequately explains why it is not feasible to alleviate this condition within 3 hours of the time the alarm occurs, and demonstrates that the requested time will ensure alleviation of this condition as expeditiously as practicable.

(iii) For each bag leak detection system, you must initiate procedures to determine the cause of every alarm within 1 hour of the alarm. Except as provided in paragraph (o)(4)(ii)(F) of this section, you must alleviate the cause of the alarm within 3 hours of the alarm by taking whatever corrective action(s) are necessary. Corrective actions may include, but are not limited to the following:

(A) Inspecting the fabric filter for air leaks, torn or broken bags or filter media, or any other condition that may cause an increase in particulate emissions;

(B) Sealing off defective bags or filter media;

(C) Replacing defective bags or filter media or otherwise repairing the control device;

(D) Sealing off a defective fabric filter compartment;

(E) Cleaning the bag leak detection system probe or otherwise repairing the bag leak detection system; or

(F) Shutting down the process producing the particulate emissions.

(iv) You must maintain records of the information specified in paragraphs (o)(4)(iv)(A) through (C) of this section for each bag leak detection system.

(A) Records of the bag leak detection system output;

(B) Records of bag leak detection system adjustments, including the date and time of the adjustment, the initial bag leak detection system settings, and the final bag leak detection system settings; and

(C) The date and time of all bag leak detection system alarms, the time that procedures to determine the cause of the alarm were initiated, if procedures were initiated within 1 hour of the alarm, the cause of the alarm, an explanation of the actions taken, the date and time the cause of the alarm was alleviated, and if the alarm was alleviated within 3 hours of the alarm.

(v) If after any period composed of 30 boiler operating days during which the alarm rate exceeds 5 percent of the process operating time (excluding control device or process startup, shutdown, and malfunction), then you must conduct a new PM performance test according to paragraph (o)(1) of this section. This new performance test must be conducted within 60 calendar days of the date that the alarm rate was first determined to exceed 5 percent limit unless a waiver is granted by the permitting authority.

(5) An owner or operator of a modified affected facility electing to meet the emission limitations in §60.42Da(d) shall determine the percent reduction in PM by using the emission rate for PM determined by the performance test conducted according to the requirements in paragraph (o)(1) of this section and the ash content on a mass basis of the fuel burned during each performance test run as determined by analysis of the fuel as fired.

(p) As an alternative to meeting the compliance provisions specified in paragraph (o) of this section, an owner or operator may elect to install, evaluate, maintain, and operate a CEMS measuring PM emissions discharged from the affected facility to the atmosphere and record the output of the system as specified in paragraphs (p)(1) through (p)(8) of this section.

(1) The owner or operator shall submit a written notification to the Administrator of intent to demonstrate compliance with this subpart by using a CEMS measuring PM. This notification shall be sent at least 30 calendar days before the initial startup of the monitor for compliance determination purposes. The owner or operator may discontinue operation of the monitor and instead return to demonstration of compliance with this subpart according to the requirements in paragraph (o) of this section by submitting written notification to the Administrator of such intent at least 30 calendar days before shutdown of the monitor for compliance determination purposes.

(2) Each CEMS shall be installed, evaluated, operated, and maintained according to the requirements in §60.49Da(v).

(3) The initial performance evaluation shall be completed no later than 180 days after the date of initial startup of the affected facility, as specified under §60.8 of subpart A of this part or within 180 days of the date of notification to the Administrator required under paragraph (p)(1) of this section, whichever is later.

(4) Compliance with the applicable emissions limit shall be determined based on the 24-hour daily (block) average of the hourly arithmetic average emissions concentrations using the continuous monitoring system outlet data. The 24-hour block arithmetic average emission concentration shall be calculated using EPA Reference Method 19 of appendix A of this part, section 4.1.

(5) At a minimum, valid CEMS hourly averages shall be obtained for 75 percent of all operating hours on a 30-day rolling average basis. Beginning on January 1, 2012, valid CEMS hourly averages shall be obtained for 90 percent of all operating hours on a 30-day rolling average basis.

(i) At least two data points per hour shall be used to calculate each 1-hour arithmetic average.

(ii) [Reserved]

(6) The 1-hour arithmetic averages required shall be expressed in ng/J, MMBtu/hr, or lb/MWh and shall be used to calculate the boiler operating day daily arithmetic average emission concentrations. The 1-hour arithmetic averages shall be calculated using the data points required under §60.13(e)(2) of subpart A of this part.

(7) All valid CEMS data shall be used in calculating average emission concentrations even if the minimum CEMS data requirements of paragraph (j)(5) of this section are not met.

(8) When PM emissions data are not obtained because of CEMS breakdowns, repairs, calibration checks, and zero and span adjustments, emissions data shall be obtained by using other monitoring systems as approved by the Administrator or EPA Reference Method 19 of appendix A of this part to provide, as necessary, valid emissions data for a minimum of 90 percent (only 75 percent is required prior to January 1, 2012) of all operating hours per 30-day rolling average.

(q) *Compliance provisions for sources subject to §60.42Da(b)*. An owner or operator of an affected facility subject to the opacity standard in §60.42Da(b) shall monitor the opacity of emissions discharged from the affected facility to the atmosphere according to the requirements in §60.49Da(a), as applicable to the affected facility.

[72 FR 32722, June 13, 2007, as amended at 74 FR 5079, Jan. 28, 2009; 76 FR 3522, Jan. 20, 2011]

§60.49Da Emission monitoring.

(a) An owner or operator of an affected facility subject to the opacity standard in §60.42Da(b) shall monitor the opacity of emissions discharged from the affected facility to the atmosphere according to the applicable requirements in paragraphs (a)(1) through (3) of this section.

(1) Except as provided for in paragraph (a)(2) of this section, the owner or operator of an affected facility, shall install, calibrate, maintain, and operate a COMS, and record the output of the system, for measuring the opacity of emissions discharged to the atmosphere. If opacity interference due to water droplets exists in the stack (for example, from the use of an FGD system), the opacity is monitored upstream of the interference (at the inlet to the FGD system). If opacity interference is experienced at all locations (both at the inlet and outlet of the SO₂ control system), alternate parameters indicative of the PM control system's performance and/or good combustion are monitored (subject to the approval of the Administrator).

(2) As an alternative to the monitoring requirements in paragraph (a)(1) of this section, an owner or operator of an affected facility that meets the conditions in either paragraph (a)(2)(i), (ii), or (iii) of this section may elect to monitor opacity as specified in paragraph (a)(3) of this section.

(i) The affected facility uses a fabric filter (baghouse) to meet the standards in §60.42Da and a bag leak detection system is installed and operated according to the requirements in paragraphs §60.48Da(o)(4)(i) through (v);

(ii) The affected facility burns only gaseous or liquid fuels (excluding residual oil) with potential SO₂ emissions rates of 26 ng/J (0.060 lb/MMBtu) or less, and does not use a post-combustion technology to reduce emissions of SO₂ or PM; or

(iii) The affected facility meets all of the conditions specified in paragraphs (a)(2)(iii)(A) through (C) of this section.

(A) No post-combustion technology (except a wet scrubber) is used for reducing PM, SO₂, or carbon monoxide (CO) emissions;

(B) Only natural gas, gaseous fuels, or fuel oils that contain less than or equal to 0.30 weight percent sulfur are burned; and

(C) Emissions of CO discharged to the atmosphere are maintained at levels less than or equal to 1.4 lb/MWh on a boiler operating day average basis as demonstrated by the use of a CEMS measuring CO emissions according to the procedures specified in paragraph (u) of this section.

(3) The owner or operators of an affected facility that meets the conditions in paragraph (a)(2) of this section may, as an alternative to using a COMS, elect to monitor visible emissions using the applicable procedures specified in paragraphs (a)(3)(i) through (iv) of this section. The opacity performance test requirement in paragraph (a)(3)(i) must be conducted by April 29, 2011, within 45 days after stopping use of an existing COMS, or within 180 days after initial startup of the facility, whichever is later. The permitting authority may exempt owners or operators of affected facilities burning only natural gas from the opacity monitoring requirements.

(i) The owner or operator shall conduct a performance test using Method 9 of appendix A-4 of this part and the procedures in §60.11. If during the initial 60 minutes of the observation all the 6-minute averages are less than 10 percent and all the individual 15-second observations are less than or equal to 20 percent, then the observation period may be reduced from 3 hours to 60 minutes.

(ii) Except as provided in paragraph (a)(3)(iii) or (iv) of this section, the owner or operator shall conduct subsequent Method 9 of appendix A-4 of this part performance tests using the procedures in paragraph (a)(3)(i) of this section according to the applicable schedule in paragraphs (a)(3)(ii)(A) through (a)(3)(ii)(D) of this section, as determined by the most recent Method 9 of appendix A-4 of this part performance test results.

(A) If no visible emissions are observed, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 12 calendar months from the date that

the most recent performance test was conducted;

(B) If visible emissions are observed but the maximum 6-minute average opacity is less than or equal to 5 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 6 calendar months from the date that the most recent performance test was conducted;

(C) If the maximum 6-minute average opacity is greater than 5 percent but less than or equal to 10 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 3 calendar months from the date that the most recent performance test was conducted; or

(D) If the maximum 6-minute average opacity is greater than 10 percent, a subsequent Method 9 of appendix A-4 of this part performance test must be completed within 45 calendar days from the date that the most recent performance test was conducted.

(iii) If the maximum 6-minute opacity is less than 10 percent during the most recent Method 9 of appendix A-4 of this part performance test, the owner or operator may, as an alternative to performing subsequent Method 9 of appendix A-4 of this part performance tests, elect to perform subsequent monitoring using Method 22 of appendix A-7 of this part according to the procedures specified in paragraphs (a)(3)(iii)(A) and (B) of this section.

(A) The owner or operator shall conduct 10 minute observations (during normal operation) each operating day the affected facility fires fuel for which an opacity standard is applicable using Method 22 of appendix A-7 of this part and demonstrate that the sum of the occurrences of any visible emissions is not in excess of 5 percent of the observation period (i.e., 30 seconds per 10 minute period). If the sum of the occurrence of any visible emissions is greater than 30 seconds during the initial 10 minute observation, immediately conduct a 30 minute observation. If the sum of the occurrence of visible emissions is greater than 5 percent of the observation period (i.e., 90 seconds per 30 minute period), the owner or operator shall either document and adjust the operation of the facility and demonstrate within 24 hours that the sum of the occurrence of visible emissions is equal to or less than 5 percent during a 30 minute observation (i.e., 90 seconds) or conduct a new Method 9 of appendix A-4 of this part performance test using the procedures in paragraph (a)(3)(i) of this section within 45 calendar days according to the requirements in §60.50Da(b)(3).

(B) If no visible emissions are observed for 30 operating days during which an opacity standard is applicable, observations can be reduced to once every 7 operating days during which an opacity standard is applicable. If any visible emissions are observed, daily observations shall be resumed.

(iv) If the maximum 6-minute opacity is less than 10 percent during the most recent Method 9 of appendix A-4 of this part performance test, the owner or operator may, as an alternative to performing subsequent Method 9 of appendix A-4 performance tests, elect to perform subsequent monitoring using a digital opacity compliance system according to a site-specific monitoring plan approved by the Administrator. The observations shall be similar, but not necessarily identical, to the requirements in paragraph (a)(3)(iii) of this section. For reference purposes in preparing the monitoring plan, see OAQPS "Determination of Visible Emission Opacity from Stationary Sources Using Computer-Based Photographic Analysis Systems." This document is available from the U.S. Environmental Protection Agency (U.S. EPA); Office of Air Quality and Planning Standards; Sector Policies and Programs Division; Measurement Policy Group (D243-02), Research Triangle Park, NC 27711. This document is also available on the Technology Transfer Network (TTN) under Emission Measurement Center Preliminary Methods.

(b) The owner or operator of an affected facility shall install, calibrate, maintain, and operate a CEMS, and record the output of the system, for measuring SO₂ emissions, except where natural gas is the only fuel combusted, as follows:

(1) Sulfur dioxide emissions are monitored at both the inlet and outlet of the SO₂ control device.

(2) For a facility that qualifies under the numerical limit provisions of §60.43Da(d), (i), (j), or (k) SO₂ emissions are only monitored as discharged to the atmosphere.

(3) An "as fired" fuel monitoring system (upstream of coal pulverizers) meeting the requirements of Method 19 of appendix A of this part may be used to determine potential SO₂ emissions in place of a continuous SO₂ emission monitor at the inlet to the SO₂ control device as required under paragraph (b)(1) of this section.

(4) If the owner or operator has installed and certified a SO₂ CEMS according to the requirements of §75.20(c)(1) of this chapter and appendix A to part 75 of this chapter, and is continuing to meet the ongoing quality assurance requirements of §75.21 of this chapter and appendix B to part 75 of this chapter, that CEMS may be used to meet the requirements of this section, provided that:

(i) A CO₂ or O₂ continuous monitoring system is installed, calibrated, maintained and operated at the same location, according to paragraph (d) of this section; and

(ii) For sources subject to an SO₂ emission limit in lb/MMBtu under §60.43Da:

(A) When relative accuracy testing is conducted, SO₂ concentration data and CO₂ (or O₂) data are collected simultaneously; and

(B) In addition to meeting the applicable SO₂ and CO₂ (or O₂) relative accuracy

specifications in Figure 2 of appendix B to part 75 of this chapter, the relative accuracy (RA) standard in section 13.2 of Performance Specification 2 in appendix B to this part is met when the RA is calculated on a lb/MMBtu basis; and

(iii) The reporting requirements of §60.51Da are met. The SO₂ and, if required, CO₂ (or O₂) data reported to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of part 75 of this chapter, nor shall the SO₂ data have been bias adjusted according to the procedures of part 75 of this chapter.

(c)(1) The owner or operator of an affected facility shall install, calibrate, maintain, and operate a CEMS, and record the output of the system, for measuring NO_x emissions discharged to the atmosphere; or

(2) If the owner or operator has installed a NO_x emission rate CEMS to meet the requirements of part 75 of this chapter and is continuing to meet the ongoing requirements of part 75 of this chapter, that CEMS may be used to meet the requirements of this section, except that the owner or operator shall also meet the requirements of §60.51Da. Data reported to meet the requirements of §60.51Da shall not include data substituted using the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter.

(d) The owner or operator of an affected facility not complying with an output based limit shall install, calibrate, maintain, and operate a CEMS, and record the output of the system, for measuring the O₂ or carbon dioxide (CO₂) content of the flue gases at each location where SO₂ or NO_x emissions are monitored. For affected facilities subject to a lb/MMBtu SO₂ emission limit under §60.43Da, if the owner or operator has installed and certified a CO₂ or O₂ monitoring system according to §75.20(c) of this chapter and appendix A to part 75 of this chapter and the monitoring system continues to meet the applicable quality-assurance provisions of §75.21 of this chapter and appendix B to part 75 of this chapter, that CEMS may be used together with the part 75 SO₂ concentration monitoring system described in paragraph (b) of this section, to determine the SO₂ emission rate in lb/MMBtu. SO₂ data used to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter.

(e) The CEMS under paragraphs (b), (c), and (d) of this section are operated and data recorded during all periods of operation of the affected facility including periods of startup, shutdown, malfunction or emergency conditions, except for CEMS breakdowns,

repairs, calibration checks, and zero and span adjustments.

(f)(1) For units that began construction, reconstruction, or modification on or before February 28, 2005, the owner or operator shall obtain emission data for at least 18 hours in at least 22 out of 30 successive boiler operating days. If this minimum data requirement cannot be met with CEMS, the owner or operator shall supplement emission data with other monitoring systems approved by the Administrator or the reference methods and procedures as described in paragraph (h) of this section.

(2) For units that began construction, reconstruction, or modification after February 28, 2005, the owner or operator shall obtain emission data for at least 90 percent of all operating hours for each 30 successive boiler operating days. If this minimum data requirement cannot be met with a CEMS, the owner or operator shall supplement emission data with other monitoring systems approved by the Administrator or the reference methods and procedures as described in paragraph (h) of this section.

(g) The 1-hour averages required under paragraph §60.13(h) are expressed in ng/J (lb/MMBtu) heat input and used to calculate the average emission rates under §60.48Da. The 1-hour averages are calculated using the data points required under §60.13(h)(2).

(h) When it becomes necessary to supplement CEMS data to meet the minimum data requirements in paragraph (f) of this section, the owner or operator shall use the reference methods and procedures as specified in this paragraph. Acceptable alternative methods and procedures are given in paragraph (j) of this section.

(1) Method 6 of appendix A of this part shall be used to determine the SO₂ concentration at the same location as the SO₂ monitor. Samples shall be taken at 60-minute intervals. The sampling time and sample volume for each sample shall be at least 20 minutes and 0.020 dscm (0.71 dscf). Each sample represents a 1-hour average.

(2) Method 7 of appendix A of this part shall be used to determine the NO_x concentration at the same location as the NO_x monitor. Samples shall be taken at 30-minute intervals. The arithmetic average of two consecutive samples represents a 1-hour average.

(3) The emission rate correction factor, integrated bag sampling and analysis procedure of Method 3B of appendix A of this part shall be used to determine the O₂ or CO₂ concentration at the same location as the O₂ or CO₂ monitor. Samples shall be taken for at least 30 minutes in each hour. Each sample represents a 1-hour average.

(4) The procedures in Method 19 of appendix A of this part shall be used to compute each 1-hour average concentration in ng/J (lb/MMBtu) heat input.

(i) The owner or operator shall use methods and procedures in this paragraph to conduct monitoring system performance evaluations under §60.13(c) and calibration checks under §60.13(d). Acceptable alternative methods and procedures are given in paragraph (j) of this section.

(1) Methods 3B, 6, and 7 of appendix A of this part shall be used to determine O₂, SO₂, and NO_x concentrations, respectively.

(2) SO₂ or NO_x (NO), as applicable, shall be used for preparing the calibration gas mixtures (in N₂, as applicable) under Performance Specification 2 of appendix B of this part.

(3) For affected facilities burning only fossil fuel, the span value for a COMS is between 60 and 80 percent. Span values for a CEMS measuring NO_x shall be determined using one of the following procedures:

(i) Except as provided under paragraph (i)(3)(ii) of this section, NO_x span values shall be determined as follows:

Fossil fuel	Span values for NO _x (ppm)
Gas	500.
Liquid	500.
Solid	1,000.
Combination	500 (x + y) + 1,000z.

Where:

x = Fraction of total heat input derived from gaseous fossil fuel,

y = Fraction of total heat input derived from liquid fossil fuel, and

z = Fraction of total heat input derived from solid fossil fuel.

(ii) As an alternative to meeting the requirements of paragraph (i)(3)(i) of this section, the owner or operator of an affected facility may elect to use the NO_x span values determined according to section 2.1.2 in appendix A to part 75 of this chapter.

(4) All span values computed under paragraph (i)(3)(i) of this section for burning combinations of fossil fuels are rounded to the nearest 500 ppm. Span values computed under paragraph (i)(3)(ii) of this section shall be rounded off according to section 2.1.2 in appendix A to part 75 of this chapter.

(5) For affected facilities burning fossil fuel, alone or in combination with non-fossil fuel and determining span values under paragraph (i)(3)(i) of this section, the span value of the SO₂ CEMS at the inlet to the SO₂ control device is 125 percent of the maximum estimated hourly potential emissions of the fuel fired, and the outlet of the SO₂ control device is 50 percent of maximum estimated hourly potential emissions of the fuel fired. For affected facilities determining span values under paragraph (i)(3)(ii) of this section, SO₂ span values shall be determined according to section 2.1.1 in appendix A to part 75 of this chapter.

(j) The owner or operator may use the following as alternatives to the reference methods and procedures specified in this section:

(1) For Method 6 of appendix A of this part, Method 6A or 6B (whenever Methods 6 and 3 or 3B of appendix A of this part data are used) or 6C of appendix A of this part may be used. Each Method 6B of appendix A of this part sample obtained over 24 hours represents 24 1-hour averages. If Method 6A or 6B of appendix A of this part is used under paragraph (i) of this section, the conditions under §60.48Da(d)(1) apply; these conditions do not apply under paragraph (h) of this section.

(2) For Method 7 of appendix A of this part, Method 7A, 7C, 7D, or 7E of appendix A of this part may be used. If Method 7C, 7D, or 7E of appendix A of this part is used, the sampling time for each run shall be 1 hour.

(3) For Method 3 of appendix A of this part, Method 3A or 3B of appendix A of this part may be used if the sampling time is 1 hour.

(4) For Method 3B of appendix A of this part, Method 3A of appendix A of this part may be used.

(k) The procedures specified in paragraphs (k)(1) through (3) of this section shall be used to determine gross output for sources demonstrating compliance with the output-based standard under §§60.42Da(c), 60.43Da(i), 60.43Da(j), 60.44Da(d)(1), and 60.44Da(e).

(1) The owner or operator of an affected facility with electricity generation shall install, calibrate, maintain, and operate a wattmeter; measure gross electrical output in MWh on a continuous basis; and record the output of the monitor.

(2) The owner or operator of an affected facility with process steam generation shall install, calibrate, maintain, and operate meters for steam flow, temperature, and pressure; measure gross process steam output in joules per hour (or Btu per hour) on a continuous basis; and record the output of the monitor.

(3) For affected facilities generating process steam in combination with electrical generation, the gross energy output is determined from the gross electrical output measured in accordance with paragraph (k)(1) of this section plus 75 percent of the gross thermal output (measured relative to ISO conditions) of the process steam measured in accordance with paragraph (k)(2) of this section.

(l) The owner or operator of an affected facility demonstrating compliance with an output-based standard under §60.42Da, §60.43Da, §60.44Da, or §60.45Da shall install, certify, operate, and maintain a continuous flow monitoring system meeting the requirements of Performance Specification 6 of appendix B of this part and the CD assessment, RATA and reporting provisions of

procedure 1 of appendix F of this part, and record the output of the system, for measuring the volumetric flow rate of exhaust gases discharged to the atmosphere; or

(m) Alternatively, data from a continuous flow monitoring system certified according to the requirements of §75.20(c) of this chapter and appendix A to part 75 of this chapter, and continuing to meet the applicable quality control and quality assurance requirements of §75.21 of this chapter and appendix B to part 75 of this chapter, may be used. Flow rate data reported to meet the requirements of §60.51Da shall not include substitute data values derived from the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter.

(n) Gas-fired and oil-fired units. The owner or operator of an affected unit that qualifies as a gas-fired or oil-fired unit, as defined in 40 CFR 72.2, may use, as an alternative to the requirements specified in either paragraph (l) or (m) of this section, a fuel flow monitoring system certified and operated according to the requirements of appendix D of part 75 of this chapter.

(o) The owner or operator of a duct burner, as described in §60.41Da, which is subject to the NO_x standards of §60.44Da(a)(1), (d)(1), or (e)(1) is not required to install or operate a CEMS to measure NO_x emissions; a wattmeter to measure gross electrical output; meters to measure steam flow, temperature, and pressure; and a continuous flow monitoring system to measure the flow of exhaust gases discharged to the atmosphere.

(p) The owner or operator of an affected facility demonstrating compliance with an Hg limit in §60.45Da shall install and operate a CEMS to measure and record the concentration of Hg in the exhaust gases from each stack according to the requirements in paragraphs (p)(1) through (p)(3) of this section. Alternatively, for an affected facility that is also subject to the requirements of subpart I of part 75 of this chapter, the owner or operator may install, certify, maintain, operate and quality-assure the data from a Hg CEMS according to §75.10 of this chapter and appendices A and B to part 75 of this chapter, in lieu of following the procedures in paragraphs (p)(1) through (p)(3) of this section.

(1) The owner or operator must install, operate, and maintain each CEMS according to Performance Specification 12A in appendix B to this part.

(2) The owner or operator must conduct a performance evaluation of each CEMS according to the requirements of §60.13 and Performance Specification 12A in appendix B to this part.

(3) The owner or operator must operate each CEMS according to the requirements in paragraphs (p)(3)(i) through (iv) of this section.

(i) As specified in §60.13(e)(2), each CEMS must complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period.

(ii) The owner or operator must reduce CEMS data as specified in §60.13(h).

(iii) The owner or operator shall use all valid data points collected during the hour to calculate the hourly average Hg concentration.

(iv) The owner or operator must record the results of each required certification and quality assurance test of the CEMS.

(4) Mercury CEMS data collection must conform to paragraphs (p)(4)(i) through (iv) of this section.

(i) For each calendar month in which the affected unit operates, valid hourly Hg concentration data, stack gas volumetric flow rate data, moisture data (if required), and electrical output data (i.e., valid data for all of these parameters) shall be obtained for at least 75 percent of the unit operating hours in the month.

(ii) Data reported to meet the requirements of this subpart shall not include hours of unit startup, shutdown, or malfunction. In addition, for an affected facility that is also subject to subpart I of part 75 of this chapter, data reported to meet the requirements of this subpart shall not include data substituted using the missing data procedures in subpart D of part 75 of this chapter, nor shall the data have been bias adjusted according to the procedures of part 75 of this chapter.

(iii) If valid data are obtained for less than 75 percent of the unit operating hours in a month, you must discard the data collected in that month and replace the data with the mean of the individual monthly emission rate values determined in the last 12 months. In the 12-month rolling average calculation, this substitute Hg emission rate shall be weighted according to the number of unit operating hours in the month for which the data capture requirement of §60.49Da(p)(4)(i) was not met.

(iv) Notwithstanding the requirements of paragraph (p)(4)(iii) of this section, if valid data are obtained for less than 75 percent of the unit operating hours in another month in that same 12-month rolling average cycle, discard the data collected in that month and replace the data with the highest individual monthly emission rate determined in the last 12 months. In the 12-month rolling average calculation, this substitute Hg emission rate shall be weighted according to the number of unit operating hours in the month for which the data capture requirement of §60.49Da(p)(4)(i) was not met.

(q) As an alternative to the CEMS required in paragraph (p) of this section, the owner or operator may use a sorbent trap monitoring system (as defined in §72.2 of this chapter) to monitor Hg concentration, according to the

procedures described in §75.15 of this chapter and appendix K to part 75 of this chapter.

(r) For Hg CEMS that measure Hg concentration on a dry basis or for sorbent trap monitoring systems, the emissions data must be corrected for the stack gas moisture content. A certified continuous moisture monitoring system that meets the requirements of §75.11(b) of this chapter is acceptable for this purpose. Alternatively, the appropriate default moisture value, as specified in §75.11(b) or §75.12(b) of this chapter, may be used.

(s) The owner or operator shall prepare and submit to the Administrator for approval a unit-specific monitoring plan for each monitoring system, at least 45 days before commencing certification testing of the monitoring systems. The owner or operator shall comply with the requirements in your plan. The plan must address the requirements in paragraphs (s)(1) through (6) of this section.

(1) Installation of the CEMS sampling probe or other interface at a measurement location relative to each affected process unit such that the measurement is representative of the exhaust emissions (e.g., on or downstream of the last control device);

(2) Performance and equipment specifications for the sample interface, the pollutant concentration or parametric signal analyzer, and the data collection and reduction systems;

(3) Performance evaluation procedures and acceptance criteria (e.g., calibrations, relative accuracy test audits (RATA), etc.);

(4) Ongoing operation and maintenance procedures in accordance with the general requirements of §60.13(d) or part 75 of this chapter (as applicable);

(5) Ongoing data quality assurance procedures in accordance with the general requirements of §60.13 or part 75 of this chapter (as applicable); and

(6) Ongoing recordkeeping and reporting procedures in accordance with the requirements of this subpart.

(t) The owner or operator of an affected facility demonstrating compliance with the output-based emissions limitation under §60.42Da(c)(1) shall install, certify, operate, and maintain a CEMS for measuring PM emissions according to the requirements of paragraph (v) of this section. An owner or operator of an affected facility demonstrating compliance with the input-based emission limitation in §60.42Da(a)(1) or §60.42Da(c)(2) may install, certify, operate, and maintain a CEMS for measuring PM emissions according to the requirements of paragraph (v) of this section.

(u) The owner or operator of an affected facility using a CEMS measuring CO emissions to meet requirements of this subpart shall meet the requirements specified in paragraphs (u)(1) through (4) of this section.

(1) You must monitor CO emissions using a CEMS according to the procedures specified in paragraphs (u)(1)(i) through (iv) of this section.

(i) The CO CEMS must be installed, certified, maintained, and operated according to the provisions in §60.58b(i)(3) of subpart Eb of this part.

(ii) Each 1-hour CO emissions average is calculated using the data points generated by the CO CEMS expressed in parts per million by volume corrected to 3 percent oxygen (dry basis).

(iii) At a minimum, valid 1-hour CO emissions averages must be obtained for at least 90 percent of the operating hours on a 30-day rolling average basis. The 1-hour averages are calculated using the data points required in §60.13(h)(2).

(iv) Quarterly accuracy determinations and daily calibration drift tests for the CO CEMS must be performed in accordance with procedure I in appendix F of this part.

(2) You must calculate the 1-hour average CO emissions levels for each boiler operating day by multiplying the average hourly CO output concentration measured by the CO CEMS times the corresponding average hourly flue gas flow rate and divided by the corresponding average hourly useful energy output from the affected facility. The 24-hour average CO emission level is determined by calculating the arithmetic average of the hourly CO emission levels computed for each boiler operating day.

(3) You must evaluate the preceding 24-hour average CO emission level each boiler operating day excluding periods of affected facility startup, shutdown, or malfunction. If the 24-hour average CO emission level is greater than 1.4 lb/MWh, you must initiate investigation of the relevant equipment and control systems within 24 hours of the first discovery of the high emission incident and, take the appropriate corrective action as soon as practicable to adjust control settings or repair equipment to reduce the 24-hour average CO emission level to 1.4 lb/MWh or less.

(4) You must record the CO measurements and calculations performed according to paragraph (u)(3) of this section and any corrective actions taken. The record of corrective action taken must include the date and time during which the 24-hour average CO emission level was greater than 1.4 lb/MWh, and the date, time, and description of the corrective action.

(v) The owner or operator of an affected facility using a CEMS measuring PM emissions to meet requirements of this subpart shall install, certify, operate, and maintain the CEMS as specified in paragraphs (v)(1) through (v)(4) of this section.

(1) The owner or operator shall conduct a performance evaluation of the CEMS

according to the applicable requirements of §60.13, Performance Specification 11 in appendix B of this part, and procedure 2 in appendix F of this part.

(2) During each PM correlation testing run of the CEMS required by Performance Specification 11 in appendix B of this part, PM and O₂ (or CO₂) data shall be collected concurrently (or within a 30- to 60-minute period) by both the CEMS and performance tests conducted using the following test methods.

(i) For PM, Method 5 or 5B of appendix A-3 of this part or Method 17 of appendix A-6 of this part shall be used; and

(ii) For O₂ (or CO₂), Method 3A or 3B of appendix A-2 of this part, as applicable shall be used.

(3) Quarterly accuracy determinations and daily calibration drift tests shall be performed in accordance with procedure 2 in appendix F of this part. Relative Response Audit's must be performed annually and Response Correlation Audits must be performed every 3 years.

(4) After July 1, 2011, within 90 days after the date of completing each performance evaluation required by paragraph (v) of this section, the owner or operator of the affected facility must either submit the test data to EPA by successfully entering the data electronically into EPA's WebFIRE data base available at <http://cfpub.epa.gov/ourweb/index.cfm?action=fire.main> or mail a copy to: United States Environmental Protection Agency; Energy Strategies Group; 109 TW Alexander DR; Mail Code: D243-01; RTP, NC 27711.

(w) The owner or operator using a SO₂, NO_x, CO₂, and O₂ CEMS to meet the requirements of this subpart shall install, certify, operate, and maintain the CEMS as specified in paragraphs (w)(1) through (w)(5) of this section.

(1) Except as provided for under paragraphs (w)(2), (w)(3), and (w)(4) of this section, each SO₂, NO_x, CO₂, and O₂ CEMS required under paragraphs (b) through (d) of this section shall be installed, certified, and operated in accordance with the applicable procedures in Performance Specification 2 or 3 in appendix B to this part or according to the procedures in appendices A and B to part 75 of this chapter. Daily calibration drift assessments and quarterly accuracy determinations shall be done in accordance with Procedure 1 in appendix F to this part, and a data assessment report (DAR), prepared according to section 7 of Procedure 1 in appendix F to this part, shall be submitted with each compliance report required under §60.51Da.

(2) As an alternative to meeting the requirements of paragraph (w)(1) of this section, an owner or operator may elect to implement the following alternative data accuracy assessment procedures. For all required CO₂ and O₂ CEMS and for SO₂ and NO_x CEMS with span values greater than or equal to 100 ppm, the daily calibration error

test and calibration adjustment procedures described in sections 2.1.1 and 2.1.3 of appendix B to part 75 of this chapter may be followed instead of the CD assessment procedures in Procedure 1, section 4.1 of appendix F of this part. If this option is selected, the data validation and out-of-control provisions in sections 2.1.4 and 2.1.5 of appendix B to part 75 of this chapter shall be followed instead of the excessive CD and out-of-control criteria in Procedure 1, section 4.3 of appendix F to this part. For the purposes of data validation under this subpart, the excessive CD and out-of-control criteria in Procedure 1, section 4.3 of appendix F to this part shall apply to SO₂ and NO_x span values less than 100 ppm;

(3) As an alternative to meeting the requirements of paragraph (w)(1) of this section, an owner or operator may elect to may elect to implement the following alternative data accuracy assessment procedures. For all required CO₂ and O₂ CEMS and for SO₂ and NO_x CEMS with span values greater than 30 ppm, quarterly linearity checks may be performed in accordance with section 2.2.1 of appendix B to part 75 of this chapter, instead of performing the cylinder gas audits (CGAs) described in Procedure 1, section 5.1.2 of appendix F to this part. If this option is selected: The frequency of the linearity checks shall be as specified in section 2.2.1 of appendix B to part 75 of this chapter; the applicable linearity specifications in section 3.2 of appendix A to part 75 of this chapter shall be met; the data validation and out-of-control criteria in section 2.2.3 of appendix B to part 75 of this chapter shall be followed instead of the excessive audit inaccuracy and out-of-control criteria in Procedure 1, section 5.2 of appendix F to this part; and the grace period provisions in section 2.2.4 of appendix B to part 75 of this chapter shall apply. For the purposes of data validation under this subpart, the cylinder gas audits described in Procedure 1, section 5.1.2 of appendix F to this part shall be performed for SO₂ and NO_x span values less than or equal to 30 ppm;

(4) As an alternative to meeting the requirements of paragraph (w)(1) of this section, an owner or operator may elect to may elect to implement the following alternative data accuracy assessment procedures. For SO₂, CO₂, and O₂ CEMS and for NO_x CEMS, RATAs may be performed in accordance with section 2.3 of appendix B to part 75 of this chapter instead of following the procedures described in Procedure 1, section 5.1.1 of appendix F to this part. If this option is selected: The frequency of each RATA shall be as specified in section 2.3.1 of appendix B to part 75 of this chapter; the applicable relative accuracy specifications shown in Figure 2 in appendix B to part 75 of this chapter shall be met; the data validation and out-of-control criteria in section 2.3.2 of appendix B to part 75 of this chapter shall be followed instead of the excessive audit

inaccuracy and out-of-control criteria in Procedure 1, section 5.2 of appendix F to this part; and the grace period provisions in section 2.3.3 of appendix B to part 75 of this chapter shall apply. For the purposes of data validation under this subpart, the relative accuracy specification in section 13.2 of Performance Specification 2 in appendix B to this part shall be met on a lb/MMBtu basis for SO₂ (regardless of the SO₂ emission level during the RATA), and for NO_x when the average NO_x emission rate measured by the reference method during the RATA is less than 0.100 lb/MMBtu;

(5) If the owner or operator elects to implement the alternative data assessment procedures described in paragraphs (w)(2) through (w)(4) of this section, each data assessment report shall include a summary of the results of all of the RATAs, linearity checks, CGAs, and calibration error or drift assessments required by paragraphs (w)(2) through (w)(4) of this section.

[72 FR 32722, June 13, 2007, as amended at 74 FR 5081, Jan. 28, 2009; 76 FR 3523, Jan. 20, 2011]

§60.50Da Compliance determination procedures and methods.

(a) In conducting the performance tests required in §60.8, the owner or operator shall use as reference methods and procedures the methods in appendix A of this part or the methods and procedures as specified in this section, except as provided in §60.8(b). Section 60.8(f) does not apply to this section for SO₂ and NO_x. Acceptable alternative methods are given in paragraph (e) of this section.

(b) The owner or operator shall determine compliance with the PM standards in §60.42Da as follows:

(1) The dry basis *F* factor (O₂) procedures in Method 19 of appendix A of this part shall be used to compute the emission rate of PM.

(2) For the particular matter concentration, Method 5 of appendix A of this part shall be used at affected facilities without wet FGD systems and Method 5B of appendix A of this part shall be used after wet FGD systems.

(i) The sampling time and sample volume for each run shall be at least 120 minutes and 1.70 dscm (60 dscf). The probe and filter holder heating system in the sampling train may be set to provide an average gas temperature of no greater than 160±14 °C (320±25 °F).

(ii) For each particulate run, the emission rate correction factor, integrated or grab sampling and analysis procedures of Method 3B of appendix A of this part shall be used to determine the O₂ concentration. The O₂ sample shall be obtained simultaneously with, and at the same traverse points as, the particulate run. If the particulate run has more than 12 traverse points, the O₂ traverse points may be reduced to 12 provided that Method 1 of appendix A of this part is used to locate the 12 O₂ traverse points. If the grab sampling procedure is used,

the O₂ concentration for the run shall be the arithmetic mean of the sample O₂ concentrations at all traverse points.

(3) Method 9 of appendix A of this part and the procedures in §60.11 shall be used to determine opacity.

(c) The owner or operator shall determine compliance with the SO₂ standards in §60.43Da as follows:

(1) The percent of potential SO₂ emissions (%Ps) to the atmosphere shall be computed using the following equation:

$$\%P_s = [(100 - \%R_f) (100 - \%R_g)] / 100$$

Where:

%Ps = Percent of potential SO₂ emissions, percent;

%Rf = Percent reduction from fuel pretreatment, percent; and

%Rg = Percent reduction by SO₂ control system, percent.

(2) The procedures in Method 19 of appendix A of this part may be used to determine percent reduction (%R_f) of sulfur by such processes as fuel pretreatment (physical coal cleaning, hydrodesulfurization of fuel oil, etc.), coal pulverizers, and bottom and fly ash interactions. This determination is optional.

(3) The procedures in Method 19 of appendix A of this part shall be used to determine the percent SO₂ reduction (%R_g) of any SO₂ control system. Alternatively, a combination of an "as fired" fuel monitor and emission rates measured after the control system, following the procedures in Method 19 of appendix A of this part, may be used if the percent reduction is calculated using the average emission rate from the SO₂ control device and the average SO₂ input rate from the "as fired" fuel analysis for 30 successive boiler operating days.

(4) The appropriate procedures in Method 19 of appendix A of this part shall be used to determine the emission rate.

(5) The CEMS in §60.49Da(b) and (d) shall be used to determine the concentrations of SO₂ and CO₂ or O₂.

(d) The owner or operator shall determine compliance with the NO_x standard in §60.44Da as follows:

(1) The appropriate procedures in Method 19 of appendix A of this part shall be used to determine the emission rate of NO_x.

(2) The continuous monitoring system in §60.49Da(c) and (d) shall be used to determine the concentrations of NO_x and CO₂ or O₂.

(e) The owner or operator may use the following as alternatives to the reference methods and procedures specified in this section:

(1) For Method 5 or 5B of appendix A-3 of this part, Method 17 of appendix A-6 of this part may be used at facilities with or without

wet FGD systems if the stack temperature at the sampling location does not exceed an average temperature of 160 °C (320 °F). The procedures of sections 8.1 and 11.1 of Method 5B of appendix A-3 of this part may be used in Method 17 of appendix A-6 of this part only if it is used after wet FGD systems. Method 17 of appendix A-6 of this part shall not be used after wet FGD systems if the effluent is saturated or laden with water droplets.

(2) The F_g factor (CO₂) procedures in Method 19 of appendix A of this part may be used to compute the emission rate of PM under the stipulations of §60.46(d)(1). The CO₂ shall be determined in the same manner as the O₂ concentration.

(f) Electric utility combined cycle gas turbines that are not designed to burn fuels containing 50 percent (by heat input) or more solid derived fuel not meeting the definition of natural gas are performance tested for PM, SO₂, and NO_x using the procedures of Method 19 of appendix A-7 of this part. The SO₂ and NO_x emission rates calculations from the gas turbine used in Method 19 of appendix A-7 of this part are determined when the gas turbine is performance tested under subpart GG of this part. The potential uncontrolled PM emission rate from a gas turbine is defined as 17 ng/l (0.04 lb/MMBtu) heat input.

(g) For the purposes of determining compliance with the emission limits in §60.45Da, the owner or operator of an electric utility steam generating unit which is also a cogeneration unit shall use the procedures in paragraphs (g)(1) and (2) of this section to calculate emission rates based on electrical output to the grid plus 75 percent of the equivalent electrical energy (measured relative to ISO conditions) in the unit's process stream.

(1) All conversions from Btu/hr unit input to MW unit output must use equivalents found in 40 CFR 60.40(a)(1) for electric utilities (i.e., 250 MMBtu/hr input to an electric utility steam generating unit is equivalent to 73 MW input to the electric utility steam generating unit); 73 MW input to the electric utility steam generating unit is equivalent to 25 MW output from the boiler electric utility steam generating unit; therefore, 250 MMBtu input to the electric utility steam generating unit is equivalent to 25 MW output from the electric utility steam generating unit).

(2) Use the Equation 5 in this section to determine the cogeneration Hg emission rate over a specific compliance period.

$$ER_{\text{cogen}} = M / (V_{\text{grid}} + 0.75 \times V_{\text{process}}) \quad (\text{Eq. 5})$$

Where:

ER_{cogen} = Cogeneration Hg emission rate over a compliance period in lb/MWh;

E = Mass of Hg emitted from the stack over the same compliance period (lb);

V_{grid} = Amount of energy sent to the grid over the same compliance period (MWh); and

V_{process} = Amount of energy converted to steam for process use over the same compliance period (MWh).

(h) The owner or operator shall determine compliance with the Hg limit in §60.45Da according to the procedures in paragraphs (h)(1) through (3) of this section.

(1) The initial performance test shall be commenced by the applicable date specified in §60.8(a). The required CEMS must be certified prior to commencing the test. The performance test consists of collecting hourly Hg emission data (lb/MWh) with the CEMS for 12 successive months of unit operation (excluding hours of unit startup, shutdown and malfunction). The average Hg emission rate is calculated for each month, and then the weighted, 12-month average Hg emission rate is calculated according to paragraph (h)(2) or (h)(3) of this section, as applicable. If, for any month in the initial performance test, the minimum data capture requirement in §60.49Da(p)(4)(i) is not met, the owner or operator shall report a substitute Hg emission rate for that month, as follows. For the first such month, the substitute monthly Hg emission rate shall be the arithmetic average of all valid hourly Hg emission rates recorded to date. For any subsequent month(s) with insufficient data capture, the substitute monthly Hg emission rate shall be the highest valid hourly Hg emission rate recorded to date. When the 12-month average Hg emission rate for the initial performance test is calculated, for each month in which there was insufficient data capture, the substitute monthly Hg emission rate shall be weighted according to the number of unit operating hours in that month. Following the initial performance test, the owner or operator shall demonstrate compliance by calculating the weighted average of all monthly Hg emission rates (in lb/MWh) for each 12 successive calendar months, excluding data obtained during startup, shutdown, or malfunction.

(2) If a CEMS is used to demonstrate compliance, follow the procedures in paragraphs (h)(2)(i) through (iii) of this section to determine the 12-month rolling average.

(i) Calculate the total mass of Hg emissions over a month (M), in lb, using either Equation 6 in paragraph (h)(2)(i)(A) of this section or Equation 7 in paragraph (h)(2)(i)(B) of this section, in conjunction with Equation 8 in paragraph (h)(2)(i)(C) of this section.

(A) If the Hg CEMS measures Hg concentration on a wet basis, use Equation 6 below to calculate the Hg mass emissions for each valid hour:

$$E_h = K_{Ch} Q_h t_h \quad (\text{Eq. 6})$$

Where:

E_h = Hg mass emissions for the hour, (lb);

K = Units conversion constant, 6.24×10^{-11} lb-scm/ μ gm-scf;

C_h = Hourly Hg concentration, wet basis, (μ gm/scm);

Q_h = Hourly stack gas volumetric flow rate, (scfh); and

t_h = Unit operating time, i.e., the fraction of the hour for which the unit operated. For example, t_h = 0.50 for a half-hour of unit operation and 1.00 for a full hour of operation.

(B) If the Hg CEMS measures Hg concentration on a dry basis, use Equation 7 below to calculate the Hg mass emissions for each valid hour:

$$E_h = KC_h Q_h t_h (1 - B_{ws}) \quad (\text{Eq. 7})$$

Where:

E_h = Hg mass emissions for the hour, (lb);

K = Units conversion constant, 6.24×10^{-11} lb-scm/ μ gm-scf;

C_h = Hourly Hg concentration, dry basis, (μ gm/dscm);

Q_h = Hourly stack gas volumetric flow rate, (scfh);

t_h = Unit operating time, i.e., the fraction of the hour for which the unit operated; and

B_{ws} = Stack gas moisture content, expressed as a decimal fraction (e.g., for 8 percent H₂O, B_{ws} = 0.08).

(C) Use Equation 8, below, to calculate M, the total mass of Hg emitted for the month, by summing the hourly masses derived from Equation 6 or 7 (as applicable):

$$M = \sum_{h=1}^n E_h \quad (\text{Eq. 8})$$

Where:

M = Total Hg mass emissions for the month, (lb);

E_h = Hg mass emissions for hour "h", from Equation 6 or 7 of this section, (lb); and

n = Number of unit operating hours in the month with valid CE and electrical output data, excluding hours of unit startup, shutdown and malfunction.

(ii) Calculate the monthly Hg emission rate on an output basis (lb/MWh) using Equation 9, below. For a cogeneration unit, use Equation 5 in paragraph (g) of this section instead.

$$ER = M / P \quad (\text{Eq. 9})$$

Where:

ER = Monthly Hg emission rate, (lb/MWh);

M = Total mass of Hg emissions for the month, from Equation 8, above, (lb); and

P = Total electrical output for the month, for the hours used to calculate M, (MWh).

(iii) Until 12 monthly Hg emission rates have been accumulated, calculate and report only the monthly averages. Then, for each subsequent calendar month, use Equation 10 below to calculate the 12-month rolling average as a weighted average of the Hg emission rate for the current month and the Hg emission rates for the previous 11 months,

with one exception. Calendar months in which the unit does not operate (zero unit operating hours) shall not be included in the 12-month rolling average.

$$E_{avg} = \frac{\sum_{i=1}^{12} (ER_i \times n_i)}{\sum_{i=1}^{12} n_i} \quad (\text{Eq. 10})$$

Where:

E_{avg} = Weighted 12-month rolling average Hg emission rate, (lb/MWh);

ER_i = Monthly Hg emission rate, for month "i", (lb/MWh); and

n = Number of unit operating hours in month "i" with valid CEM and electrical output data, excluding hours of unit startup, shutdown, and malfunction.

(3) If a sorbent trap monitoring system is used in lieu of a Hg CEMS, as described in §75.15 of this chapter and in appendix K to part 75 of this chapter, calculate the monthly Hg emission rates using Equations 7 through 9 of this section, except that for a particular pair of sorbent traps, C_h in Equation 7 shall be the flow-proportional average Hg concentration measured over the data collection period.

(i) Daily calibration drift (CD) tests and quarterly accuracy determinations shall be performed for Hg CEMS in accordance with Procedure 1 of appendix F to this part. For the CD assessments, you may use either elemental mercury or mercuric chloride (Hg^o HgCl₂) standards. The four quarterly accuracy determinations shall consist of one RATA and three measurement error (ME) tests using HgCl₂ standards, as described in section 8.3 of Performance Specification 12-A in appendix B to this part (note: Hg^o standards may be used if the Hg monitor does not have a converter). Alternatively, the owner or operator may implement the applicable daily, weekly, quarterly, and annual quality assurance (QA) requirements for Hg CEMS in appendix B to part 75 of this chapter, in lieu of the QA procedures in appendices B and F to this part. Annual RATA of sorbent trap monitoring systems shall be performed in accordance with appendices A and B to part 75 of this chapter, and all other quality assurance requirements specified in appendix K to part 75 of this chapter shall be met for sorbent trap monitoring systems.

[72 FR 32722, June 13, 2007, as amended at 74 FR 5083, Jan. 28, 2009]

§60.51Da Reporting requirements.

(a) For SO₂, NO_x, PM, and Hg emissions, the performance test data from the initial and subsequent performance test and from the performance evaluation of the continuous monitors (including the transmissometer) are submitted to the Administrator.

(b) For SO₂ and NO_x the following information is reported to the Administrator for each 24-hour period.

(1) Calendar date.

(2) The average SO₂ and NO_x emission rates (ng/J, lb/MMBtu, or lb/MWh) for each 30 successive boiler operating days, ending with the last 30-day period in the quarter; reasons for non-compliance with the emission standards; and, description of corrective actions taken.

(3) For owners or operators of affected facilities complying with the percent reduction requirement, percent reduction of the potential combustion concentration of SO₂ for each 30 successive boiler operating days, ending with the last 30-day period in the quarter; reasons for non-compliance with the standard; and, description of corrective actions taken.

(4) Identification of the boiler operating days for which pollutant or diluent data have not been obtained by an approved method for at least 75 percent of the hours of operation of the facility; justification for not obtaining sufficient data; and description of corrective actions taken.

(5) Identification of the times when emissions data have been excluded from the calculation of average emission rates because of startup, shutdown, malfunction (NO_x only), emergency conditions (SO₂ only), or other reasons, and justification for excluding data for reasons other than startup, shutdown, malfunction, or emergency conditions.

(6) Identification of "F" factor used for calculations, method of determination, and type of fuel combusted.

(7) Identification of times when hourly averages have been obtained based on manual sampling methods.

(8) Identification of the times when the pollutant concentration exceeded full span of the CEMS.

(9) Description of any modifications to CEMS which could affect the ability of the CEMS to comply with Performance Specifications 2 or 3.

(c) If the minimum quantity of emission data as required by §60.49Da is not obtained for any 30 successive boiler operating days, the following information obtained under the requirements of §60.48Da(h) is reported to the Administrator for that 30-day period:

(1) The number of hourly averages available for outlet emission rates (n_o) and inlet emission rates (n_i) as applicable.

(2) The standard deviation of hourly averages for outlet emission rates (s_o) and inlet emission rates (s_i) as applicable.

(3) The lower confidence limit for the mean outlet emission rate (E_o*) and the upper confidence limit for the mean inlet emission rate (E_i*) as applicable.

(4) The applicable potential combustion concentration.

(5) The ratio of the upper confidence limit for the mean outlet emission rate (E_o*) and the allowable emission rate (E_{std}) as applicable.

(d) If any standards under §60.43Da are exceeded during emergency conditions

because of control system malfunction, the owner or operator of the affected facility shall submit a signed statement:

(1) Indicating if emergency conditions existed and requirements under §60.48Da(d) were met during each period, and

(2) Listing the following information:

(i) Time periods the emergency condition existed;

(ii) Electrical output and demand on the owner or operator's electric utility system and the affected facility;

(iii) Amount of power purchased from interconnected neighboring utility companies during the emergency period;

(iv) Percent reduction in emissions achieved;

(v) Atmospheric emission rate (ng/l) of the pollutant discharged; and

(vi) Actions taken to correct control system malfunction.

(e) If fuel pretreatment credit toward the SO₂ emission standard under §60.43Da is claimed, the owner or operator of the affected facility shall submit a signed statement:

(1) Indicating what percentage cleaning credit was taken for the calendar quarter, and whether the credit was determined in accordance with the provisions of §60.50Da and Method 19 of appendix A of this part; and

(2) Listing the quantity, heat content, and date each pretreated fuel shipment was received during the previous quarter; the name and location of the fuel pretreatment facility; and the total quantity and total heat content of all fuels received at the affected facility during the previous quarter.

(f) For any periods for which opacity, SO₂ or NO_x emissions data are not available, the owner or operator of the affected facility shall submit a signed statement indicating if any changes were made in operation of the emission control system during the period of data unavailability. Operations of the control system and affected facility during periods of data unavailability are to be compared with operation of the control system and affected facility before and following the period of data unavailability.

(g) For Hg, the following information shall be reported to the Administrator:

(1) Company name and address;

(2) Date of report and beginning and ending dates of the reporting period;

(3) The applicable Hg emission limit (lb/MWh); and

(4) For each month in the reporting period:

(i) The number of unit operating hours;

(ii) The number of unit operating hours with valid data for Hg concentration, stack gas flow rate, moisture (if required), and electrical output;

(iii) The monthly Hg emission rate (lb/MWh);

(iv) The number of hours of valid data excluded from the calculation of the monthly Hg emission rate, due to unit startup, shutdown and malfunction; and

(v) The 12-month rolling average Hg emission rate (lb/MWh); and

(5) The data assessment report (DAR) required by appendix F to this part, or an equivalent summary of QA test results if the QA of part 75 of this chapter are implemented.

(h) The owner or operator of the affected facility shall submit a signed statement indicating whether:

(1) The required CEMS calibration, span, and drift checks or other periodic audits have or have not been performed as specified.

(2) The data used to show compliance was or was not obtained in accordance with approved methods and procedures of this part and is representative of plant performance.

(3) The minimum data requirements have or have not been met; or, the minimum data requirements have not been met for errors that were unavoidable.

(4) Compliance with the standards has or has not been achieved during the reporting period.

(i) For the purposes of the reports required under §60.7, periods of excess emissions are defined as all 6-minute periods during which the average opacity exceeds the applicable opacity standards under §60.42Da(b). Opacity levels in excess of the applicable opacity standard and the date of such excesses are to be submitted to the Administrator each calendar quarter.

(j) The owner or operator of an affected facility shall submit the written reports required under this section and subpart A to the Administrator semiannually for each six-month period. All semiannual reports shall be postmarked by the 30th day following the end of each six-month period.

(k) The owner or operator of an affected facility may submit electronic quarterly reports for SO₂ and/or NO_x and/or opacity and/or Hg in lieu of submitting the written reports required under paragraphs (b), (g), and (i) of this section. The format of each quarterly electronic report shall be coordinated with the permitting authority. The electronic report(s) shall be submitted no later than 30 days after the end of the calendar quarter and shall be accompanied by a certification statement from the owner or operator, indicating whether compliance with the applicable emission standards and minimum data requirements of this subpart was achieved during the reporting period. Before submitting reports in the electronic format, the owner or operator shall coordinate with the permitting authority to

obtain their agreement to submit reports in this alternative format.

[72 FR 32722, June 13, 2007, as amended at 74 FR 5083, Jan. 28, 2009]

§60.52Da Recordkeeping requirements.

(a) The owner or operator of an affected facility subject to the emissions limitations in §60.45Da shall provide notifications in accordance with §60.7(a) and shall maintain records of all information needed to demonstrate compliance including performance tests, monitoring data, fuel analyses, and calculations, consistent with the requirements of §60.7(f).

(b) The owner or operator of an affected facility subject to the opacity limits in §60.42Da(b) that elects to monitor emissions according to the requirements in §60.49Da(a)(3) shall maintain records according to the requirements specified in paragraphs (b)(1) through (3) of this section, as applicable to the visible emissions monitoring method used.

(1) For each performance test conducted using Method 9 of appendix A-4 of this part, the owner or operator shall keep the records including the information specified in paragraphs (b)(1)(i) through (iii) of this section.

(i) Dates and time intervals of all opacity observation periods;

(ii) Name, affiliation, and copy of current visible emission reading certification for each visible emission observer participating in the performance test; and

(iii) Copies of all visible emission observer opacity field data sheets;

(2) For each performance test conducted using Method 22 of appendix A-4 of this part, the owner or operator shall keep the records including the information specified in paragraphs (b)(2)(i) through (iv) of this section.

(i) Dates and time intervals of all visible emissions observation periods;


(ii) Name and affiliation for each visible emission observer participating in the performance test;

(iii) Copies of all visible emission observer opacity field data sheets; and

(iv) Documentation of any adjustments made and the time the adjustments were completed to the affected facility operation by the owner or operator to demonstrate compliance with the applicable monitoring requirements.

(3) For each digital opacity compliance system, the owner or operator shall maintain records and submit reports according to the requirements specified in the site-specific monitoring plan approved by the Administrator.

[74 FR 5083, Jan. 28, 2009]



APPENDIX B
40 CFR 60 SUBPART Y

Subpart Y—Standards of Performance for Coal Preparation and Processing Plants

Source: 74 FR 51977, Oct. 8, 2009, unless otherwise noted.

§60.250 Applicability and designation of affected facility.

(a) The provisions of this subpart apply to affected facilities in coal preparation and processing plants that process more than 181 megagrams (Mg) (200 tons) of coal per day.

(b) The provisions in §60.251, §60.252(a), §60.253(a), §60.254(a), §60.255(a), and §60.256(a) of this subpart are applicable to any of the following affected facilities that commenced construction, reconstruction or modification after October 27, 1974, and on or before April 28, 2008: Thermal dryers, pneumatic coal-cleaning equipment (air tables), coal processing and conveying equipment (including breakers and crushers), and coal storage systems, transfer and loading systems.

(c) The provisions in §60.251, §60.252(b)(1) and (c), §60.253(b), §60.254(b), §60.255(b) through (h), §60.256(b) and (c), §60.257, and §60.258 of this subpart are applicable to any of the following affected facilities that commenced construction, reconstruction or modification after April 28, 2008, and on or before May 27, 2009: Thermal dryers, pneumatic coal-cleaning equipment (air tables), coal processing and conveying equipment (including breakers and crushers), and coal storage systems, transfer and loading systems.

(d) The provisions in §60.251, §60.252(b)(1) through (3), and (c), §60.253(b), §60.254(b) and (c), §60.255(b) through (h), §60.256(b) and (c), §60.257, and §60.258 of this subpart are applicable to any of the following affected facilities that commenced construction, reconstruction or modification after May 27, 2009: Thermal dryers, pneumatic coal-cleaning equipment (air tables), coal processing and conveying equipment (including breakers and crushers), coal storage systems, transfer and loading systems, and open storage piles.

§60.251 Definitions.

As used in this subpart, all terms not defined herein have the meaning given them in the Clean Air Act (Act) and in subpart A of this part.

(a) *Anthracite* means coal that is classified as anthracite according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, *see* §60.17).

(b) *Bag leak detection system* means a system that is capable of continuously

monitoring relative particulate matter (dust loadings) in the exhaust of a fabric filter to detect bag leaks and other upset conditions. A bag leak detection system includes, but is not limited to, an instrument that operates on triboelectric, light scattering, light transmittance, or other effect to continuously monitor relative particulate matter loadings.

(c) *Bituminous coal* means solid fossil fuel classified as bituminous coal by ASTM D388 (incorporated by reference— *see* §60.17).

(d) *Coal* means:

(1) For units constructed, reconstructed, or modified on or before May 27, 2009, all solid fossil fuels classified as anthracite, bituminous, subbituminous, or lignite by ASTM D388 (incorporated by reference— *see* §60.17).

(2) For units constructed, reconstructed, or modified after May 27, 2009, all solid fossil fuels classified as anthracite, bituminous, subbituminous, or lignite by ASTM D388 (incorporated by reference— *see* §60.17), and coal refuse.

(e) *Coal preparation and processing plant* means any facility (excluding underground mining operations) which prepares coal by one or more of the following processes: breaking, crushing, screening, wet or dry cleaning, and thermal drying.

(f) *Coal processing and conveying equipment* means any machinery used to reduce the size of coal or to separate coal from refuse, and the equipment used to convey coal to or remove coal and refuse from the machinery. This includes, but is not limited to, breakers, crushers, screens, and conveyor belts. Equipment located at the mine face is not considered to be part of the coal preparation and processing plant.

(g) *Coal refuse* means waste products of coal mining, physical coal cleaning, and coal preparation operations (*e.g.* culm, gob, *etc.*) containing coal, matrix material, clay, and other organic and inorganic material.

(h) *Coal storage system* means any facility used to store coal except for open storage piles.

(i) *Design controlled potential PM emissions rate* means the theoretical particulate matter (PM) emissions (Mg) that would result from the operation of a control device at its design emissions rate (grams per dry standard cubic meter (g/dscm)), multiplied by the maximum design flow rate (dry standard cubic meter per minute (dscm/min)), multiplied by 60 (minutes per hour (min/hr)), multiplied by 8,760 (hours per year (hr/yr)), divided by 1,000,000 (megagrams per gram (Mg/g)).

(j) *Indirect thermal dryer* means a thermal dryer that reduces the moisture content of coal through indirect heating of the coal through contact with a heat transfer medium. If the source of heat (the source of combustion or furnace) is subject to another subpart of this part, then the furnace and the associated emissions are not part of the affected facility. However, if the source of heat is not subject to another subpart of this part, then the furnace and the associated emissions are part of the affected facility.

(k) *Lignite* means coal that is classified as lignite A or B according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, *see* §60.17).

(l) *Mechanical vent* means any vent that uses a powered mechanical drive (machine) to induce air flow.

(m) *Open storage pile* means any facility, including storage area, that is not enclosed that is used to store coal, including the equipment used in the loading, unloading, and conveying operations of the facility.

(n) *Operating day* means a 24-hour period between 12 midnight and the following midnight during which coal is prepared or processed at any time by the affected facility. It is not necessary that coal be prepared or processed the entire 24-hour period.

(o) *Pneumatic coal-cleaning equipment* means:

(1) For units constructed, reconstructed, or modified on or before May 27, 2009, any facility which classifies bituminous coal by size or separates bituminous coal from refuse by application of air stream(s).

(2) For units constructed, reconstructed, or modified after May 27, 2009, any facility which classifies coal by size or separates coal from refuse by application of air stream(s).

(p) *Potential combustion concentration* means the theoretical emissions (nanograms per joule (ng/J) or pounds per million British thermal units (lb/MMBtu) heat input) that would result from combustion of a fuel in an uncleaned state without emission control systems, as determined using Method 19 of appendix A-7 of this part.

(q) *Subbituminous coal* means coal that is classified as subbituminous A, B, or C according to the American Society of Testing and Materials in ASTM D388 (incorporated by reference, *see* §60.17).

(r) *Thermal dryer* means:

(1) For units constructed, reconstructed, or modified on or before May 27, 2009, any

facility in which the moisture content of bituminous coal is reduced by contact with a heated gas stream which is exhausted to the atmosphere.

(2) For units constructed, reconstructed, or modified after May 27, 2009, any facility in which the moisture content of coal is reduced by either contact with a heated gas stream which is exhausted to the atmosphere or through indirect heating of the coal through contact with a heated heat transfer medium.

(s) *Transfer and loading system* means any facility used to transfer and load coal for shipment.

§60.252 Standards for thermal dryers.

(a) On and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of a thermal dryer constructed, reconstructed, or modified on or before April 28, 2008, subject to the provisions of this subpart must meet the requirements in paragraphs (a)(1) and (a)(2) of this section.

(1) The owner or operator shall not cause to be discharged into the atmosphere from the thermal dryer any gases which contain PM in excess of 0.070 g/dscm (0.031 grains per dry standard cubic feet (gr/dscf)); and

(2) The owner or operator shall not cause to be discharged into the atmosphere from the thermal dryer any gases which exhibit 20 percent opacity or greater.

(b) Except as provided in paragraph (c) of this section, on and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of a thermal dryer constructed, reconstructed, or modified after April 28, 2008, subject to the provisions of this subpart must meet the applicable standards for PM and opacity, as specified in paragraph (b)(1) of this section. In addition, and except as provided in paragraph (c) of this section, on and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of a thermal dryer constructed, reconstructed, or modified after May 29, 2009, subject to the provisions of this subpart must also meet the applicable standards for sulfur dioxide (SO₂), and combined nitrogen oxides (NO_x) and carbon monoxide (CO) as specified in paragraphs (b)(2) and (b)(3) of this section.

(1) The owner or operator must meet the requirements for PM emissions in paragraphs (b)(1)(i) through (iii) of this section, as applicable to the affected facility.

(i) For each thermal dryer constructed or reconstructed after April 28, 2008, the owner or operator must meet the requirements of (b)(1)(i)(A) and (b)(1)(i)(B).

(A) The owner or operator must not cause to be discharged into the atmosphere from the thermal dryer any gases that contain PM in excess of 0.023 g/dscm (0.010 grains per dry standard cubic feet (gr/dscf)); and

(B) The owner or operator must not cause to be discharged into the atmosphere from the thermal dryer any gases that exhibit 10 percent opacity or greater.

(ii) For each thermal dryer modified after April 28, 2008, the owner or operator must meet the requirements of paragraphs (b)(1)(ii)(A) and (b)(1)(ii)(B) of this section.

(A) The owner or operator must not cause to be discharged to the atmosphere from the affected facility any gases which contain PM in excess of 0.070 g/dscm (0.031 gr/dscf); and

(B) The owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases which exhibit 20 percent opacity or greater.

(2) Except as provided in paragraph (b)(2)(iii) of this section, for each thermal dryer constructed, reconstructed, or modified after May 27, 2009, the owner or operator must meet the requirements for SO₂ emissions in either paragraph (b)(2)(i) or (b)(2)(ii) of this section.

(i) The owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases that contain SO₂ in excess of 85 ng/J (0.20 lb/MMBtu) heat input; or

(ii) The owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases that either contain SO₂ in excess of 520 ng/J (1.20 lb/MMBtu) heat input or contain SO₂ in excess of 10 percent of the potential combustion concentration (*i.e.*, the facility must achieve at least a 90 percent reduction of the potential combustion concentration and may not exceed a maximum emissions rate of 1.2 lb/MMBtu (520 ng/J)).

(iii) Thermal dryers that receive all of their thermal input from a source other than coal or residual oil, that receive all of their thermal input from a source subject to an SO₂ limit under another subpart of this part, or that use waste heat or residual from the combustion of coal or residual oil as their only thermal input are not subject to the SO₂ limits of this section.

(3) Except as provided in paragraph (b)(3)(iii) of this section, the owner or

operator must meet the requirements for combined NO_x and CO emissions in paragraph (b)(3)(i) or (b)(3)(ii) of this section, as applicable to the affected facility.

(i) For each thermal dryer constructed after May 27, 2009, the owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases which contain a combined concentration of NO_x and CO in excess of 280 ng/J (0.65 lb/MMBtu) heat input.

(ii) For each thermal dryer reconstructed or modified after May 27, 2009, the owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases which contain combined concentration of NO_x and CO in excess of 430 ng/J (1.0 lb/MMBtu) heat input.

(iii) Thermal dryers that receive all of their thermal input from a source other than coal or residual oil, that receive all of their thermal input from a source subject to a NO_x limit and/or CO limit under another subpart of this part, or that use waste heat or residual from the combustion of coal or residual oil as their only thermal input, are not subject to the combined NO_x and CO limits of this section.

(c) Thermal dryers receiving all of their thermal input from an affected facility covered under another 40 CFR Part 60 subpart must meet the applicable requirements in that subpart but are not subject to the requirements in this subpart.

§60.253 Standards for pneumatic coal-cleaning equipment.

(a) On and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of pneumatic coal-cleaning equipment constructed, reconstructed, or modified on or before April 28, 2008, must meet the requirements of paragraphs (a)(1) and (a)(2) of this section.

(1) The owner or operator must not cause to be discharged into the atmosphere from the pneumatic coal-cleaning equipment any gases that contain PM in excess of 0.040 g/dscm (0.017 gr/dscf); and

(2) The owner or operator must not cause to be discharged into the atmosphere from the pneumatic coal-cleaning equipment any gases that exhibit 10 percent opacity or greater.

(b) On and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of pneumatic coal-cleaning equipment constructed, reconstructed, or modified

after April 28, 2008, must meet the requirements in paragraphs (b)(1) and (b)(2) of this section.

(1) The owner or operator must not cause to be discharged into the atmosphere from the pneumatic coal-cleaning equipment any gases that contain PM in excess of 0.023 g/dscm (0.010 gr/dscf); and

(2) The owner or operator must not cause to be discharged into the atmosphere from the pneumatic coal-cleaning equipment any gases that exhibit greater than 5 percent opacity.

§60.254 Standards for coal processing and conveying equipment, coal storage systems, transfer and loading systems, and open storage piles.

(a) On and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator shall not cause to be discharged into the atmosphere from any coal processing and conveying equipment, coal storage system, or coal transfer and loading system processing coal constructed, reconstructed, or modified on or before April 28, 2008, gases which exhibit 20 percent opacity or greater.

(b) On and after the date on which the performance test is conducted or required to be completed under §60.8, whichever date comes first, an owner or operator of any coal processing and conveying equipment, coal storage system, or coal transfer and loading system processing coal constructed, reconstructed, or modified after April 28, 2008, must meet the requirements in paragraphs (b)(1) through (3) of this section, as applicable to the affected facility.

(1) Except as provided in paragraph (b)(3) of this section, the owner or operator must not cause to be discharged into the atmosphere from the affected facility any gases which exhibit 10 percent opacity or greater.

(2) The owner or operator must not cause to be discharged into the atmosphere from any mechanical vent on an affected facility gases which contain particulate matter in excess of 0.023 g/dscm (0.010 gr/dscf).

(3) Equipment used in the loading, unloading, and conveying operations of open storage piles are not subject to the opacity limitations of paragraph (b)(1) of this section.

(c) The owner or operator of an open storage pile, which includes the equipment used in the loading, unloading, and conveying operations of the affected facility, constructed, reconstructed, or modified after May 27, 2009, must prepare

and operate in accordance with a submitted fugitive coal dust emissions control plan that is appropriate for the site conditions as specified in paragraphs (c)(1) through (6) of this section.

(1) The fugitive coal dust emissions control plan must identify and describe the control measures the owner or operator will use to minimize fugitive coal dust emissions from each open storage pile.

(2) For open coal storage piles, the fugitive coal dust emissions control plan must require that one or more of the following control measures be used to minimize to the greatest extent practicable fugitive coal dust: Locating the source inside a partial enclosure, installing and operating a water spray or fogging system, applying appropriate chemical dust suppression agents on the source (when the provisions of paragraph (c)(6) of this section are met), use of a wind barrier, compaction, or use of a vegetative cover. The owner or operator must select, for inclusion in the fugitive coal dust emissions control plan, the control measure or measures listed in this paragraph that are most appropriate for site conditions. The plan must also explain how the measure or measures selected are applicable and appropriate for site conditions. In addition, the plan must be revised as needed to reflect any changing conditions at the source.

(3) Any owner or operator of an affected facility that is required to have a fugitive coal dust emissions control plan may petition the Administrator to approve, for inclusion in the plan for the affected facility, alternative control measures other than those specified in paragraph (c)(2) of this section as specified in paragraphs (c)(3)(i) through (iv) of this section.

(i) The petition must include a description of the alternative control measures, a copy of the fugitive coal dust emissions control plan for the affected facility that includes the alternative control measures, and information sufficient for EPA to evaluate the demonstrations required by paragraph (c)(3)(ii) of this section.

(ii) The owner or operator must either demonstrate that the fugitive coal dust emissions control plan that includes the alternate control measures will provide equivalent overall environmental protection or demonstrate that it is either economically or technically infeasible for the affected facility to use the control measures specifically identified in paragraph (c)(2).

(iii) While the petition is pending, the owner or operator must comply with the fugitive coal dust emissions control plan including the alternative control measures

submitted with the petition. Operation in accordance with the plan submitted with the petition shall be deemed to constitute compliance with the requirement to operate in accordance with a fugitive coal dust emissions control plan that contains one of the control measures specifically identified in paragraph (c)(2) of this section while the petition is pending.

(iv) If the petition is approved by the Administrator, the alternative control measures will be approved for inclusion in the fugitive coal dust emissions control plan for the affected facility. In lieu of amending this subpart, a letter will be sent to the facility describing the specific control measures approved. The facility shall make any such letters and the applicable fugitive coal dust emissions control plan available to the public. If the Administrator determines it is appropriate, the conditions and requirements of the letter can be reviewed and changed at any point.

(4) The owner or operator must submit the fugitive coal dust emissions control plan to the Administrator or delegated authority as specified in paragraphs (c)(4)(i) and (c)(4)(ii) of this section.

(i) The plan must be submitted to the Administrator or delegated authority prior to startup of the new, reconstructed, or modified affected facility, or 30 days after the effective date of this rule, whichever is later.

(ii) The plan must be revised as needed to reflect any changing conditions at the source. Such revisions must be dated and submitted to the Administrator or delegated authority before a source can operate pursuant to these revisions. The Administrator or delegated authority may also object to such revisions as specified in paragraph (c)(5) of this section.

(5) The Administrator or delegated authority may object to the fugitive coal dust emissions control plan as specified in paragraphs (c)(5)(i) and (c)(5)(ii) of this section.

(i) The Administrator or delegated authority may object to any fugitive coal dust emissions control plan that it has determined does not meet the requirements of paragraphs (c)(1) and (c)(2) of this section.

(ii) If an objection is raised, the owner or operator, within 30 days from receipt of the objection, must submit a revised fugitive coal dust emissions control plan to the Administrator or delegated authority. The owner or operator must operate in accordance with the revised fugitive coal dust emissions control plan. The Administrator or delegated authority retain

the right, under paragraph (c)(5) of this section, to object to the revised control plan if it determines the plan does not meet the requirements of paragraphs (c)(1) and (c)(2) of this section.

(6) Where appropriate chemical dust suppression agents are selected by the owner or operator as a control measure to minimize fugitive coal dust emissions, (1) only chemical dust suppressants with Occupational Safety and Health Administration (OSHA)-compliant material safety data sheets (MSDS) are to be allowed; (2) the MSDS must be included in the fugitive coal dust emissions control plan; and (3) the owner or operator must consider and document in the fugitive coal dust emissions control plan the site-specific impacts associated with the use of such chemical dust suppressants.

§60.255 Performance tests and other compliance requirements.

(a) An owner or operator of each affected facility that commenced construction, reconstruction, or modification on or before April 28, 2008, must conduct all performance tests required by §60.8 to demonstrate compliance with the applicable emission standards using the methods identified in §60.257.

(b) An owner or operator of each affected facility that commenced construction, reconstruction, or modification after April 28, 2008, must conduct performance tests according to the requirements of §60.8 and the methods identified in §60.257 to demonstrate compliance with the applicable emissions standards in this subpart as specified in paragraphs (b)(1) and (2) of this section.

(1) For each affected facility subject to a PM, SO₂, or combined NO_x and CO emissions standard, an initial performance test must be performed. Thereafter, a new performance test must be conducted according to the requirements in paragraphs (b)(1)(i) through (iii) of this section, as applicable.

(i) If the results of the most recent performance test demonstrate that emissions from the affected facility are greater than 50 percent of the applicable emissions standard, a new performance test must be conducted within 12 calendar months of the date that the previous performance test was required to be completed.

(ii) If the results of the most recent performance test demonstrate that emissions from the affected facility are 50 percent or less of the applicable emissions standard, a new performance test must be conducted within 24 calendar months of the

date that the previous performance test was required to be completed.

(iii) An owner or operator of an affected facility that has not operated for the 60 calendar days prior to the due date of a performance test is not required to perform the subsequent performance test until 30 calendar days after the next operating day.

(2) For each affected facility subject to an opacity standard, an initial performance test must be performed. Thereafter, a new performance test must be conducted according to the requirements in paragraphs (b)(2)(i) through (iii) of this section, as applicable, except as provided for in paragraphs (e) and (f) of this section. Performance test and other compliance requirements for coal truck dump operations are specified in paragraph (h) of this section.

(i) If any 6-minute average opacity reading in the most recent performance test exceeds half the applicable opacity limit, a new performance test must be conducted within 90 operating days of the date that the previous performance test was required to be completed.

(ii) If all 6-minute average opacity readings in the most recent performance test are equal to or less than half the applicable opacity limit, a new performance test must be conducted within 12 calendar months of the date that the previous performance test was required to be completed.

(iii) An owner or operator of an affected facility continuously monitoring scrubber parameters as specified in §60.256(b)(2) is exempt from the requirements in paragraphs (b)(2)(i) and (ii) if opacity performance tests are conducted concurrently with (or within a 60-minute period of) PM performance tests.

(c) If any affected coal processing and conveying equipment (e.g., breakers, crushers, screens, conveying systems), coal storage systems, or coal transfer and loading systems that commenced construction, reconstruction, or modification after April 28, 2008, are enclosed in a building, and emissions from the building do not exceed any of the standards in §60.254 that apply to the affected facility, then the facility shall be deemed to be in compliance with such standards.

(d) An owner or operator of an affected facility (other than a thermal dryer) that commenced construction, reconstruction, or modification after April 28, 2008, is subject to a PM emission standard and uses a control device with a design controlled potential PM emissions rate of 1.0 Mg (1.1 tons) per year or less is exempted from the

requirements of paragraphs (b)(1)(i) and (ii) of this section provided that the owner or operator meets all of the conditions specified in paragraphs (d)(1) through (3) of this section. This exemption does not apply to thermal dryers.

(1) PM emissions, as determined by the most recent performance test, are less than or equal to the applicable limit,

(2) The control device manufacturer's recommended maintenance procedures are followed, and

(3) All 6-minute average opacity readings from the most recent performance test are equal to or less than half the applicable opacity limit or the monitoring requirements in paragraphs (e) or (f) of this section are followed.

(e) For an owner or operator of a group of up to five of the same type of affected facilities that commenced construction, reconstruction, or modification after April 28, 2008, that are subject to PM emissions standards and use identical control devices, the Administrator or delegated authority may allow the owner or operator to use a single PM performance test for one of the affected control devices to demonstrate that the group of affected facilities is in compliance with the applicable emissions standards provided that the owner or operator meets all of the conditions specified in paragraphs (e)(1) through (3) of this section.

(1) PM emissions from the most recent performance test for each individual affected facility are 90 percent or less of the applicable PM standard;

(2) The manufacturer's recommended maintenance procedures are followed for each control device; and

(3) A performance test is conducted on each affected facility at least once every 5 calendar years.

(f) As an alternative to meeting the requirements in paragraph (b)(2) of this section, an owner or operator of an affected facility that commenced construction, reconstruction, or modification after April 28, 2008, may elect to comply with the requirements in paragraph (f)(1) or (f)(2) of this section.

(1) Monitor visible emissions from each affected facility according to the requirements in paragraphs (f)(1)(i) through (iii) of this section.

(i) Conduct one daily 15-second observation each operating day for each affected facility (during normal operation) when the coal preparation and processing plant is in operation. Each observation must be recorded as either visible emissions

observed or no visible emissions observed. Each observer determining the presence of visible emissions must meet the training requirements specified in §2.3 of Method 22 of appendix A-7 of this part. If visible emissions are observed during any 15-second observation, the owner or operator must adjust the operation of the affected facility and demonstrate within 24 hours that no visible emissions are observed from the affected facility. If visible emissions are observed, a Method 9, of appendix A-4 of this part, performance test must be conducted within 45 operating days.

(ii) Conduct monthly visual observations of all process and control equipment. If any deficiencies are observed, the necessary maintenance must be performed as expeditiously as possible.

(iii) Conduct a performance test using Method 9 of appendix A-4 of this part at least once every 5 calendar years for each affected facility.

(2) Prepare a written site-specific monitoring plan for a digital opacity compliance system for approval by the Administrator or delegated authority. The plan shall require observations of at least one digital image every 15 seconds for 10-minute periods (during normal operation) every operating day. An approvable monitoring plan must include a demonstration that the occurrences of visible emissions are not in excess of 5 percent of the observation period. For reference purposes in preparing the monitoring plan, *see* OAQPS "Determination of Visible Emission Opacity from Stationary Sources Using Computer-Based Photographic Analysis Systems." This document is available from the U.S. Environmental Protection Agency (U.S. EPA); Office of Air Quality and Planning Standards; Sector Policies and Programs Division; Measurement Group (D243-02), Research Triangle Park, NC 27711. This document is also available on the Technology Transfer Network (TTN) under Emission Measurement Center Preliminary Methods. The monitoring plan approved by the Administrator or delegated authority shall be implemented by the owner or operator.

(g) As an alternative to meeting the requirements in paragraph (b)(2) of this section, an owner or operator of an affected facility that commenced construction, reconstruction, or modification after April 28, 2008, subject to a visible emissions standard under this subpart may install, operate, and maintain a continuous opacity monitoring system (COMS). Each COMS used to comply with provisions of this subpart must be installed, calibrated,

maintained, and continuously operated according to the requirements in paragraphs (g)(1) and (2) of this section.

(1) The COMS must meet Performance Specification 1 in 40 CFR part 60, appendix B.

(2) The COMS must comply with the quality assurance requirements in paragraphs (g)(2)(i) through (v) of this section.

(i) The owner or operator must automatically (intrinsic to the opacity monitor) check the zero and upscale (span) calibration drifts at least once daily. For particular COMS, the acceptable range of zero and upscale calibration materials is as defined in the applicable version of Performance Specification 1 in 40 CFR part 60, appendix B.

(ii) The owner or operator must adjust the zero and span whenever the 24-hour zero drift or 24-hour span drift exceeds 4 percent opacity. The COMS must allow for the amount of excess zero and span drift measured at the 24-hour interval checks to be recorded and quantified. The optical surfaces exposed to the effluent gases must be cleaned prior to performing the zero and span drift adjustments, except for systems using automatic zero adjustments. For systems using automatic zero adjustments, the optical surfaces must be cleaned when the cumulative automatic zero compensation exceeds 4 percent opacity.

(iii) The owner or operator must apply a method for producing a simulated zero opacity condition and an upscale (span) opacity condition using a certified neutral density filter or other related technique to produce a known obscuration of the light beam. All procedures applied must provide a system check of the analyzer internal optical surfaces and all electronic circuitry including the lamp and photodetector assembly.

(iv) Except during periods of system breakdowns, repairs, calibration checks, and zero and span adjustments, the COMS must be in continuous operation and must complete a minimum of one cycle of sampling and analyzing for each successive 10-second period and one cycle of data recording for each successive 6-minute period.

(v) The owner or operator must reduce all data from the COMS to 6-minute averages. Six-minute opacity averages must be calculated from 36 or more data points equally spaced over each 6-minute period. Data recorded during periods of system breakdowns, repairs, calibration checks, and zero and span adjustments must not be included in the data averages. An arithmetic

or integrated average of all data may be used.

(h) The owner or operator of each affected coal truck dump operation that commenced construction, reconstruction, or modification after April 28, 2008, must meet the requirements specified in paragraphs (h)(1) through (3) of this section.

(1) Conduct an initial performance test using Method 9 of appendix A-4 of this part according to the requirements in paragraphs (h)(1)(i) and (ii).

(i) Opacity readings shall be taken during the duration of three separate truck dump events. Each truck dump event commences when the truck bed begins to elevate and concludes when the truck bed returns to a horizontal position.

(ii) Compliance with the applicable opacity limit is determined by averaging all 15-second opacity readings made during the duration of three separate truck dump events.

(2) Conduct monthly visual observations of all process and control equipment. If any deficiencies are observed, the necessary maintenance must be performed as expeditiously as possible.

(3) Conduct a performance test using Method 9 of appendix A-4 of this part at least once every 5 calendar years for each affected facility.

§60.256 Continuous monitoring requirements.

(a) The owner or operator of each affected facility constructed, reconstructed, or modified on or before April 28, 2008, must meet the monitoring requirements specified in paragraphs (a)(1) and (2) of this section, as applicable to the affected facility.

(1) The owner or operator of any thermal dryer shall install, calibrate, maintain, and continuously operate monitoring devices as follows:

(i) A monitoring device for the measurement of the temperature of the gas stream at the exit of the thermal dryer on a continuous basis. The monitoring device is to be certified by the manufacturer to be accurate within ± 1.7 °C (± 3 °F).

(ii) For affected facilities that use wet scrubber emission control equipment:

(A) A monitoring device for the continuous measurement of the pressure loss through the venturi constriction of the control equipment. The monitoring device is to be certified by the manufacturer to be accurate within ± 1 inch water gauge.

(B) A monitoring device for the continuous measurement of the water supply pressure to the control equipment. The monitoring

device is to be certified by the manufacturer to be accurate within ± 5 percent of design water supply pressure. The pressure sensor or tap must be located close to the water discharge point. The Administrator shall have discretion to grant requests for approval of alternative monitoring locations.

(2) All monitoring devices under paragraph (a) of this section are to be recalibrated annually in accordance with procedures under §60.13(b).

(b) The owner or operator of each affected facility constructed, reconstructed, or modified after April 28, 2008, that has one or more mechanical vents must install, calibrate, maintain, and continuously operate the monitoring devices specified in paragraphs (b)(1) through (3) of this section, as applicable to the mechanical vent and any control device installed on the vent.

(1) For mechanical vents with fabric filters (baghouses) with design controlled potential PM emissions rates of 25 Mg (28 tons) per year or more, a bag leak detection system according to the requirements in paragraph (c) of this section.

(2) For mechanical vents with wet scrubbers, monitoring devices according to the requirements in paragraphs (b)(2)(i) through (iv) of this section.

(i) A monitoring device for the continuous measurement of the pressure loss through the venturi constriction of the control equipment. The monitoring device is to be certified by the manufacturer to be accurate within ± 1 inch water gauge.

(ii) A monitoring device for the continuous measurement of the water supply flow rate to the control equipment. The monitoring device is to be certified by the manufacturer to be accurate within ± 5 percent of design water supply flow rate.

(iii) A monitoring device for the continuous measurement of the pH of the wet scrubber liquid. The monitoring device is to be certified by the manufacturer to be accurate within ± 5 percent of design pH.

(iv) An average value for each monitoring parameter must be determined during each performance test. Each monitoring parameter must then be maintained within 10 percent of the value established during the most recent performance test on an operating day average basis.

(3) For mechanical vents with control equipment other than wet scrubbers, a monitoring device for the continuous measurement of the reagent injection flow rate to the control equipment, as applicable. The monitoring device is to be certified by the manufacturer to be accurate within ± 5

percent of design injection flow rate. An average reagent injection flow rate value must be determined during each performance test. The reagent injection flow rate must then be maintained within 10 percent of the value established during the most recent performance test on an operating day average basis.

(c) Each bag leak detection system used to comply with provisions of this subpart must be installed, calibrated, maintained, and continuously operated according to the requirements in paragraphs (c)(1) through (3) of this section.

(1) The bag leak detection system must meet the specifications and requirements in paragraphs (c)(1)(i) through (viii) of this section.

(i) The bag leak detection system must be certified by the manufacturer to be capable of detecting PM emissions at concentrations of 1 milligram per dry standard cubic meter (mg/dscm) (0.00044 grains per actual cubic foot (gr/acf)) or less.

(ii) The bag leak detection system sensor must provide output of relative PM loadings. The owner or operator shall continuously record the output from the bag leak detection system using electronic or other means (e.g., using a strip chart recorder or a data logger).

(iii) The bag leak detection system must be equipped with an alarm system that will sound when the system detects an increase in relative particulate loading over the alarm set point established according to paragraph (c)(1)(iv) of this section, and the alarm must be located such that it can be heard by the appropriate plant personnel.

(iv) In the initial adjustment of the bag leak detection system, the owner or operator must establish, at a minimum, the baseline output by adjusting the sensitivity (range) and the averaging period of the device, the alarm set points, and the alarm delay time.

(v) Following initial adjustment, the owner or operator must not adjust the averaging period, alarm set point, or alarm delay time without approval from the Administrator or delegated authority except as provided in paragraph (c)(2)(vi) of this section.

(vi) Once per quarter, the owner or operator may adjust the sensitivity of the bag leak detection system to account for seasonal effects, including temperature and humidity, according to the procedures identified in the site-specific monitoring plan required by paragraph (c)(2) of this section.

(vii) The owner or operator must install the bag leak detection sensor downstream of the fabric filter.

(viii) Where multiple detectors are required, the system's instrumentation and alarm may be shared among detectors.

(2) The owner or operator must develop and submit to the Administrator or delegated authority for approval a site-specific monitoring plan for each bag leak detection system. This plan must be submitted to the Administrator or delegated authority 30 days prior to startup of the affected facility. The owner or operator must operate and maintain the bag leak detection system according to the site-specific monitoring plan at all times. Each monitoring plan must describe the items in paragraphs (c)(2)(i) through (vi) of this section.

(i) Installation of the bag leak detection system;

(ii) Initial and periodic adjustment of the bag leak detection system, including how the alarm set-point will be established;

(iii) Operation of the bag leak detection system, including quality assurance procedures;

(iv) How the bag leak detection system will be maintained, including a routine maintenance schedule and spare parts inventory list;

(v) How the bag leak detection system output will be recorded and stored; and

(vi) Corrective action procedures as specified in paragraph (c)(3) of this section. In approving the site-specific monitoring plan, the Administrator or delegated authority may allow the owner and operator more than 3 hours to alleviate a specific condition that causes an alarm if the owner or operator identifies in the monitoring plan this specific condition as one that could lead to an alarm, adequately explains why it is not feasible to alleviate this condition within 3 hours of the time the alarm occurs, and demonstrates that the requested time will ensure alleviation of this condition as expeditiously as practicable.

(3) For each bag leak detection system, the owner or operator must initiate procedures to determine the cause of every alarm within 1 hour of the alarm. Except as provided in paragraph (c)(2)(vi) of this section, the owner or operator must alleviate the cause of the alarm within 3 hours of the alarm by taking whatever corrective action(s) are necessary. Corrective actions may include, but are not limited to the following:

(i) Inspecting the fabric filter for air leaks, torn or broken bags or filter media, or any other condition that may cause an increase in PM emissions;

(ii) Sealing off defective bags or filter media;

(iii) Replacing defective bags or filter media or otherwise repairing the control device;

(iv) Sealing off a defective fabric filter compartment;

(v) Cleaning the bag leak detection system probe or otherwise repairing the bag leak detection system; or

(vi) Shutting down the process producing the PM emissions.

§60.257 Test methods and procedures.

(a) The owner or operator must determine compliance with the applicable opacity standards as specified in paragraphs (a)(1) through (3) of this section.

(1) Method 9 of appendix A-4 of this part and the procedures in §60.11 must be used to determine opacity, with the exceptions specified in paragraphs (a)(1)(i) and (ii).

(i) The duration of the Method 9 of appendix A-4 of this part performance test shall be 1 hour (ten 6-minute averages).

(ii) If, during the initial 30 minutes of the observation of a Method 9 of appendix A-4 of this part performance test, all of the 6-minute average opacity readings are less than or equal to half the applicable opacity limit, then the observation period may be reduced from 1 hour to 30 minutes.

(2) To determine opacity for fugitive coal dust emissions sources, the additional requirements specified in paragraphs (a)(2)(i) through (iii) must be used.

(i) The minimum distance between the observer and the emission source shall be 5.0 meters (16 feet), and the sun shall be oriented in the 140-degree sector of the back.

(ii) The observer shall select a position that minimizes interference from other fugitive coal dust emissions sources and make observations such that the line of vision is approximately perpendicular to the plume and wind direction.

(iii) The observer shall make opacity observations at the point of greatest opacity in that portion of the plume where condensed water vapor is not present. Water vapor is not considered a visible emission.

(3) A visible emissions observer may conduct visible emission observations for up to three fugitive, stack, or vent emission points within a 15-second interval if the following conditions specified in paragraphs (a)(3)(i) through (iii) of this section are met.

(i) No more than three emissions points may be read concurrently.

(ii) All three emissions points must be within a 70 degree viewing sector or angle in front of the observer such that the proper

sun position can be maintained for all three points.

(iii) If an opacity reading for any one of the three emissions points is within 5 percent opacity from the applicable standard (excluding readings of zero opacity), then the observer must stop taking readings for the other two points and continue reading just that single point.

(b) The owner or operator must conduct all performance tests required by §60.8 to demonstrate compliance with the applicable emissions standards specified in §60.252 according to the requirements in §60.8 using the applicable test methods and procedures in paragraphs (b)(1) through (8) of this section.

(1) Method 1 or 1A of appendix A-4 of this part shall be used to select sampling port locations and the number of traverse points in each stack or duct. Sampling sites must be located at the outlet of the control device (or at the outlet of the emissions source if no control device is present) prior to any releases to the atmosphere.

(2) Method 2, 2A, 2C, 2D, 2F, or 2G of appendix A-4 of this part shall be used to determine the volumetric flow rate of the stack gas.

(3) Method 3, 3A, or 3B of appendix A-4 of this part shall be used to determine the dry molecular weight of the stack gas. The owner or operator may use ANSI/ASME PTC 19.10-1981, "Flue and Exhaust Gas Analyses (incorporated by reference— see §60.17) as an alternative to Method 3B of appendix A-2 of this part.

(4) Method 4 of appendix A-4 of this part shall be used to determine the moisture content of the stack gas.

(5) Method 5, 5B or 5D of appendix A-4 of this part or Method 17 of appendix A-7 of this part shall be used to determine the PM concentration as follows:

(i) The sampling time and sample volume for each run shall be at least 60 minutes and 0.85 dscm (30 dscf). Sampling shall begin no less than 30 minutes after startup and shall terminate before shutdown procedures begin. A minimum of three valid test runs are needed to comprise a PM performance test.

(ii) Method 5 of appendix A of this part shall be used only to test emissions from affected facilities without wet flue gas desulfurization (FGD) systems.

(iii) Method 5B of appendix A of this part is to be used only after wet FGD systems.

(iv) Method 5D of appendix A-4 of this part shall be used for positive pressure fabric filters and other similar applications (e.g., stub stacks and roof vents).

(v) Method 17 of appendix A-6 of this part may be used at facilities with or without wet scrubber systems provided the stack gas temperature does not exceed a temperature of 160 °C (320 °F). The procedures of sections 8.1 and 11.1 of Method 5B of appendix A-3 of this part may be used in Method 17 of appendix A-6 of this part only if it is used after a wet FGD system. Do not use Method 17 of appendix A-6 of this part after wet FGD systems if the effluent is saturated or laden with water droplets.

(6) Method 6, 6A, or 6C of appendix A-4 of this part shall be used to determine the SO₂ concentration. A minimum of three valid test runs are needed to comprise an SO₂ performance test.

(7) Method 7 or 7E of appendix A-4 of this part shall be used to determine the NO_x concentration. A minimum of three valid test runs are needed to comprise an NO_x performance test.

(8) Method 10 of appendix A-4 of this part shall be used to determine the CO concentration. A minimum of three valid test runs are needed to comprise a CO performance test. CO performance tests are conducted concurrently (or within a 60-minute period) with NO_x performance tests.

§60.258 Reporting and recordkeeping.

(a) The owner or operator of a coal preparation and processing plant that commenced construction, reconstruction, or modification after April 28, 2008, shall maintain in a logbook (written or electronic) on-site and make it available upon request. The logbook shall record the following:

(1) The manufacturer's recommended maintenance procedures and the date and time of any maintenance and inspection activities and the results of those activities. Any variance from manufacturer recommendation, if any, shall be noted.

(2) The date and time of periodic coal preparation and processing plant visual observations, noting those sources with visible emissions along with corrective actions taken to reduce visible emissions. Results from the actions shall be noted.

(3) The amount and type of coal processed each calendar month.

(4) The amount of chemical stabilizer or water purchased for use in the coal preparation and processing plant.

(5) Monthly certification that the dust suppressant systems were operational when any coal was processed and that manufacturer's recommendations were followed for all control systems. Any variance from the manufacturer's recommendations, if any, shall be noted.

(6) Monthly certification that the fugitive coal dust emissions control plan was implemented as described. Any variance from the plan, if any, shall be noted. A copy of the applicable fugitive coal dust emissions control plan and any letters from the Administrator providing approval of any alternative control measures shall be maintained with the logbook. Any actions, e.g. objections, to the plan and any actions relative to the alternative control measures, e.g. approvals, shall be noted in the logbook as well.

(7) For each bag leak detection system, the owner or operator must keep the records specified in paragraphs (a)(7)(i) through (iii) of this section.

(i) Records of the bag leak detection system output;

(ii) Records of bag leak detection system adjustments, including the date and time of the adjustment, the initial bag leak detection system settings, and the final bag leak detection settings; and

(iii) The date and time of all bag leak detection system alarms, the time that procedures to determine the cause of the alarm were initiated, the cause of the alarm, an explanation of the actions taken, the date and time the cause of the alarm was alleviated, and whether the cause of the alarm was alleviated within 3 hours of the alarm.

(8) A copy of any applicable monitoring plan for a digital opacity compliance system and monthly certification that the plan was

implemented as described. Any variance from plan, if any, shall be noted.

(9) During a performance test of a wet scrubber, and each operating day thereafter, the owner or operator shall record the measurements of the scrubber pressure loss, water supply flow rate, and pH of the wet scrubber liquid.

(10) During a performance test of control equipment other than a wet scrubber, and each operating day thereafter, the owner or operator shall record the measurements of the reagent injection flow rate, as applicable.

(b) For the purpose of reports required under section 60.7(c), any owner or operator subject to the provisions of this subpart also shall report semiannually periods of excess emissions as follow:

(1) The owner or operator of an affected facility with a wet scrubber shall submit semiannual reports to the Administrator or delegated authority of occurrences when the measurements of the scrubber pressure loss, water supply flow rate, or pH of the wet scrubber liquid vary by more than 10 percent from the average determined during the most recent performance test.

(2) The owner or operator of an affected facility with control equipment other than a wet scrubber shall submit semiannual reports to the Administrator or delegated authority of occurrences when the measurements of the reagent injection flow rate, as applicable, vary by more than 10 percent from the average determined during the most recent performance test.

(3) All 6-minute average opacities that exceed the applicable standard.

(c) The owner or operator of an affected facility shall submit the results of initial performance tests to the Administrator or delegated authority, consistent with the provisions of section 60.8. The owner or operator who elects to comply with the reduced performance testing provisions of sections 60.255(c) or (d) shall include in the performance test report identification of each affected facility that will be subject to the reduced testing. The owner or operator electing to comply with section 60.255(d) shall also include information which demonstrates that the control devices are identical.

(d) After July 1, 2011, within 60 days after the date of completing each performance evaluation conducted to demonstrate compliance with this subpart, the owner or operator of the affected facility must submit the test data to EPA by successfully entering the data electronically into EPA's WebFIRE data base available at <http://cfpub.epa.gov/oarweb/index.cfm?action=fire.main>. For performance tests that cannot be entered into WebFIRE (i.e., Method 9 of appendix A-4 of this part opacity performance tests) the owner or operator of the affected facility must mail a summary copy to United States Environmental Protection Agency; Energy Strategies Group; 109 TW Alexander DR; mail code: D243-01; RTP, NC 27711.

APPENDIX C
ACID RAIN PERMIT APPLICATION

Plant Name (from Step 1)

WYGEN II

STEP 3Read the
standard
requirements**Permit Requirements**

- (1) The designated representative of each affected source and each affected unit at the source shall:
- (i) Submit a complete Acid Rain permit application (including a compliance plan) under 40 CFR part 72 in accordance with the deadlines specified in 40 CFR 72.30; and
 - (ii) Submit in a timely manner any supplemental information that the permitting authority determines is necessary in order to review an Acid Rain permit application and issue or deny an Acid Rain permit;
- (2) The owners and operators of each affected source and each affected unit at the source shall:
- (i) Operate the unit in compliance with a complete Acid Rain permit application or a superseding Acid Rain permit issued by the permitting authority; and
 - (ii) Have an Acid Rain Permit.

Monitoring Requirements

- (1) The owners and operators and, to the extent applicable, designated representative of each affected source and each affected unit at the source shall comply with the monitoring requirements as provided in 40 CFR part 75.
- (2) The emissions measurements recorded and reported in accordance with 40 CFR part 75 shall be used to determine compliance by the unit with the Acid Rain emissions limitations and emissions reduction requirements for sulfur dioxide and nitrogen oxides under the Acid Rain Program.
- (3) The requirements of 40 CFR part 75 shall not affect the responsibility of the owners and operators to monitor emissions of other pollutants or other emissions characteristics at the unit under other applicable requirements of the Act and other provisions of the operating permit for the source.

Sulfur Dioxide Requirements

- (1) The owners and operators of each source and each affected unit at the source shall:
- (i) Hold allowances, as of the allowance transfer deadline, in the unit's compliance subaccount (after deductions under 40 CFR 73.34(c)), or in the compliance subaccount of another affected unit at the same source to the extent provided in 40 CFR 73.35(b)(3), not less than the total annual emissions of sulfur dioxide for the previous calendar year from the unit; and
 - (ii) Comply with the applicable Acid Rain emissions limitations for sulfur dioxide.
- (2) Each ton of sulfur dioxide emitted in excess of the Acid Rain emissions limitations for sulfur dioxide shall constitute a separate violation of the Act.
- (3) An affected unit shall be subject to the requirements under paragraph (1) of the sulfur dioxide requirements as follows:
- (i) Starting January 1, 2000, an affected unit under 40 CFR 72.6(a)(2); or
 - (ii) Starting on the later of January 1, 2000 or the deadline for monitor certification under 40 CFR part 75, an affected unit under 40 CFR 72.6(a)(3).
- (4) Allowances shall be held in, deducted from, or transferred among Allowance Tracking System accounts in accordance with the Acid Rain Program.
- (5) An allowance shall not be deducted in order to comply with the requirements under paragraph (1) of the sulfur dioxide requirements prior to the calendar year for which the allowance was allocated.
- (6) An allowance allocated by the Administrator under the Acid Rain Program is a limited authorization to emit sulfur dioxide in accordance with the Acid Rain Program. No provision of the Acid Rain Program, the Acid Rain permit application, the Acid Rain permit, or an exemption under 40 CFR 72.7 or 72.8 and no provision of law shall be construed to limit the authority of the United States to terminate or limit such authorization.
- (7) An allowance allocated by the Administrator under the Acid Rain Program does not constitute a property right.

Plant Name (from Step 1)

WYGEN II

Acid Rain - Page 3

STEP 3,
Cont'd.

Nitrogen Oxides Requirements The owners and operators of the source and each affected unit at the source shall comply with the applicable Acid Rain emissions limitation for nitrogen oxides.

Excess Emissions Requirements

- (1) The designated representative of an affected unit that has excess emissions in any calendar year shall submit a proposed offset plan, as required under 40 CFR part 77.
- (2) The owners and operators of an affected unit that has excess emissions in any calendar year shall:
 - (i) Pay without demand the penalty required, and pay upon demand the interest on that penalty, as required by 40 CFR part 77; and
 - (ii) Comply with the terms of an approved offset plan, as required by 40 CFR part 77.

Recordkeeping and Reporting Requirements

- (1) Unless otherwise provided, the owners and operators of the source and each affected unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time prior to the end of 5 years, in writing by the Administrator or permitting authority:
 - (i) The certificate of representation for the designated representative for the source and each affected unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation, in accordance with 40 CFR 72.24; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation changing the designated representative;
 - (ii) All emissions monitoring information, in accordance with 40 CFR part 75, provided that to the extent that 40 CFR part 75 provides for a 3-year period for recordkeeping, the 3-year period shall apply.
 - (iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the Acid Rain Program; and,
 - (iv) Copies of all documents used to complete an Acid Rain permit application and any other submission under the Acid Rain Program or to demonstrate compliance with the requirements of the Acid Rain Program.
- (2) The designated representative of an affected source and each affected unit at the source shall submit the reports and compliance certifications required under the Acid Rain Program, including those under 40 CFR part 72 subpart I and 40 CFR part 75.

Liability

- (1) Any person who knowingly violates any requirement or prohibition of the Acid Rain Program, a complete Acid Rain permit application, an Acid Rain permit, or an exemption under 40 CFR 72.7 or 72.8, including any requirement for the payment of any penalty owed to the United States, shall be subject to enforcement pursuant to section 113(c) of the Act.
- (2) Any person who knowingly makes a false, material statement in any record, submission, or report under the Acid Rain Program shall be subject to criminal enforcement pursuant to section 113(c) of the Act and 18 U.S.C. 1001.
- (3) No permit revision shall excuse any violation of the requirements of the Acid Rain Program that occurs prior to the date that the revision takes effect.
- (4) Each affected source and each affected unit shall meet the requirements of the Acid Rain Program.

Plant Name (from Step 1)

WYGEN II

Step 3,
Cont'd.**Liability, Cont'd.**

(5) Any provision of the Acid Rain Program that applies to an affected source (including a provision applicable to the designated representative of an affected source) shall also apply to the owners and operators of such source and of the affected units at the source.

(6) Any provision of the Acid Rain Program that applies to an affected unit (including a provision applicable to the designated representative of an affected unit) shall also apply to the owners and operators of such unit. Except as provided under 40 CFR 72.44 (Phase II repowering extension plans) and 40 CFR 76.11 (NO_x averaging plans), and except with regard to the requirements applicable to units with a common stack under 40 CFR part 75 (including 40 CFR 75.16, 75.17, and 75.18), the owners and operators and the designated representative of one affected unit shall not be liable for any violation by any other affected unit of which they are not owners or operators or the designated representative and that is located at a source of which they are not owners or operators or the designated representative.

(7) Each violation of a provision of 40 CFR parts 72, 73, 74, 75, 76, 77, and 78 by an affected source or affected unit, or by an owner or operator or designated representative of such source or unit, shall be a separate violation of the Act.

Effect on Other Authorities

No provision of the Acid Rain Program, an Acid Rain permit application, an Acid Rain permit, or an exemption under 40 CFR 72.7 or 72.8 shall be construed as:

(1) Except as expressly provided in title IV of the Act, exempting or excluding the owners and operators and, to the extent applicable, the designated representative of an affected source or affected unit from compliance with any other provision of the Act, including the provisions of title I of the Act relating to applicable National Ambient Air Quality Standards or State Implementation Plans;

(2) Limiting the number of allowances a unit can hold; *provided*, that the number of allowances held by the unit shall not affect the source's obligation to comply with any other provisions of the Act;

(3) Requiring a change of any kind in any State law regulating electric utility rates and charges, affecting any State law regarding such State regulation, or limiting such State regulation, including any prudence review requirements under such State law;

(4) Modifying the Federal Power Act or affecting the authority of the Federal Energy Regulatory Commission under the Federal Power Act; or,

(5) Interfering with or impairing any program for competitive bidding for power supply in a State in which such program is established.

STEP 4Read the
certification
statement,
sign, and
date**Certification**

I am authorized to make this submission on behalf of the owners and operators of the affected source or affected units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name

MARIZ LUX

Signature

MARIZ LUX

Date

10-3-05