




Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

June 25, 2009

Precast Concrete Products

Attn: Dan Tyler

P.O. Box 5023

Etna, Wyoming 83118

RE: Review of Septic Tank Specifications for Inclusion or Non-inclusion on the:
Wyoming APPROVED SEPTIC TANK List

Dear Mr. Tyler:

The Water Quality Division (WQD) of the Wyoming Department of Environmental Quality (DEQ) has received and reviewed the specifications for the several different sizes and designs of concrete septic tanks submitted. The WQD finds that the following tanks meet all of the minimum design and specification requirements as identified in Chapter 11, Section 39 of the Water Quality Rules and Regulations. These tanks, which follow here, will be included on the "A-List" of the Approved Septic Tank list:

APPROVED for use in Wyoming / A-List:

- 1000 gallon, Single compartment concrete septic tank,
- 1000 gallon, Two compartment concrete septic tank, and
- 1500 gallon, Two compartment concrete septic tank.

Please note that the "A-List" of the approved list contains the following requirement for all tanks, "Septic Tank Clean-Out Riser Requirement - Either a 6-inch diameter clean-out riser or the manway from each compartment of the septic tank must be extended to the ground surface from all septic tanks."

If you should have any other questions please call me at (307) 777-6183.

Sincerely,

Ronald L. Ewald
Consulting Engineer
SE District, Water Quality Division


RLE/rm/9-0548

cc: Septic Tank Status File
Lou Harmon, Program Manager, W&WW Section, WQD
Karen Farley, NE District Supervisor, WQD
James Brough, NW District Supervisor, WQD
Mark Baron, SW District Supervisor, WQD
Rich Cripe, SE District Engineer, WQD


Herschler Building • 122 West 25th Street • Cheyenne, WY 82002 • <http://deq.state.wy.us>

ADMIN/OUTREACH (307) 777-7937 FAX 777-3610	ABANDONED MINES (307) 777-6145 FAX 777-6462	AIR QUALITY (307) 777-7391 FAX 777-5616	INDUSTRIAL SITING (307) 777-7369 FAX 777-5973	LAND QUALITY (307) 777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307) 777-7752 FAX 777-5973	WATER QUALITY (307) 777-7781 FAX 777-5973
--------------------------------------------------	---------------------------------------------------	-----------------------------------------------	-----------------------------------------------------	------------------------------------------------	------------------------------------------------------	-------------------------------------------------



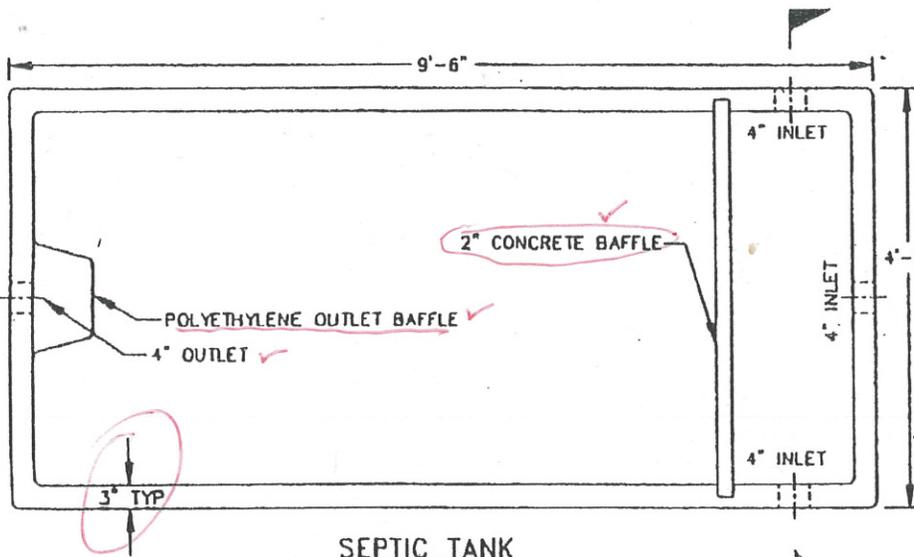


SEPTIC TANK
PLAN VIEW

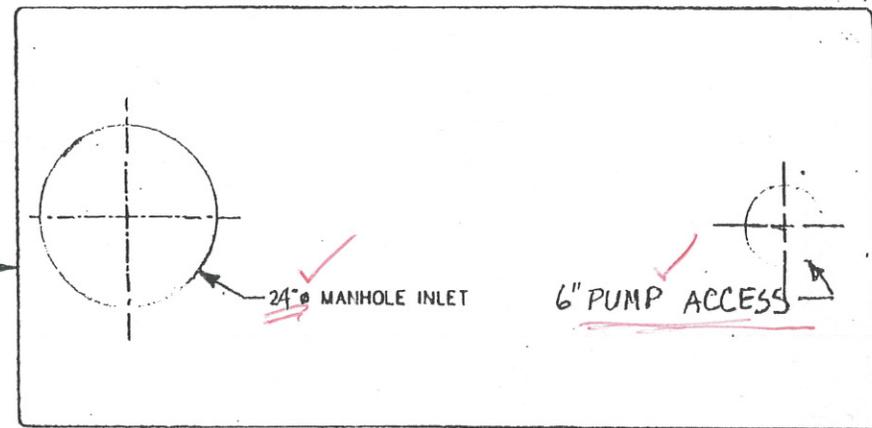


SEPTIC TANK LID
PLAN VIEW

B
THIS DWG.


VOK - RLE 06-24-09



**PRECAST
CONCRETE
PRODUCTS**
P.O. Box 4023 Elm, NY 831
307.880.0080

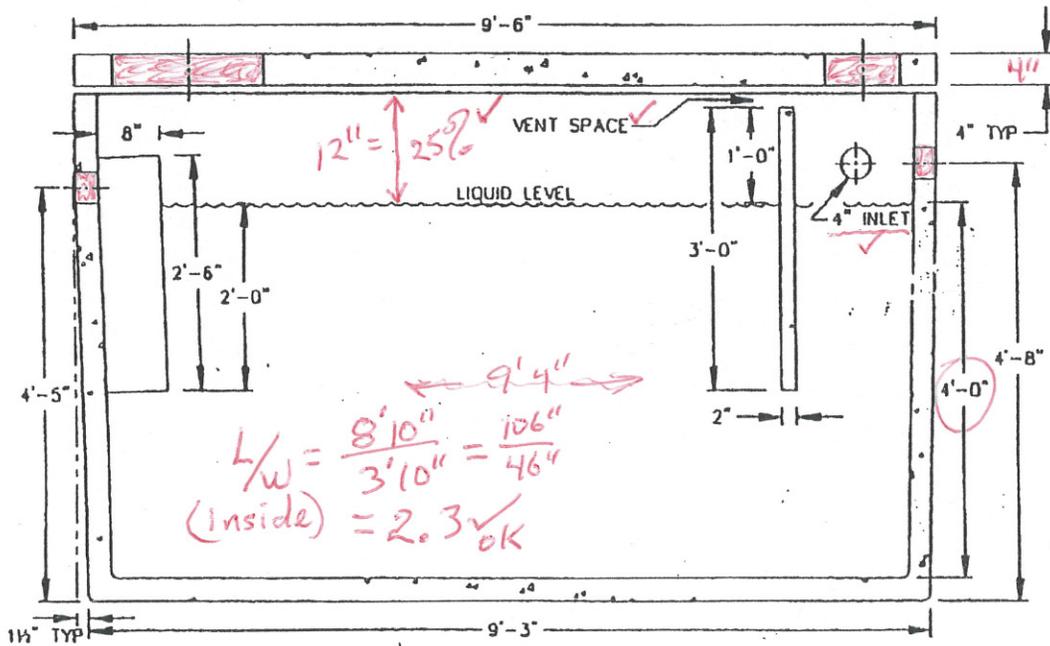

A
SECTION
THIS DWG.

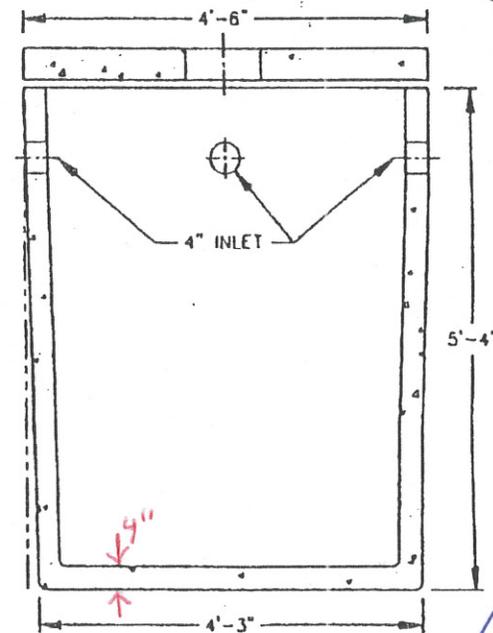

B
SECTION
THIS DWG.

- NOTES:**
- 6/6-10x10 WELDED WIRE MESH IN FLOOR AND WALLS.
 - 4" CONCRETE LID IS REINFORCED WITH #4 REBAR THROUGH OUT.
 - 6" PUMP OUT ACCESS WILL ACCOMMODATE 6" PVC PIPE RISER EXTENSION
 - 6 1/2 BAGS OF CONCRETE MIX REC
 - PLASTIC BAFFLE SECURED WITH STAINLESS STEEL TOPIT NAILS.
 - 1,000 GALLON CAPAC**
INLET & OUTLET
MANUFACTURER NAME
STENCILED ON THE TANK

One Compartment