




# Department of Environmental Quality




To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

January 17, 2008

Herbert H. Spann  
Snyder Industries, Inc.  
P.O. Box 4583  
Lincoln, NE 68504

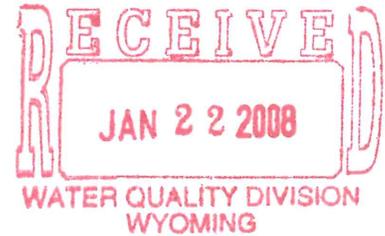

RE: **APPROVAL** of Snyder Industries Ribbed "NuConSept" and Low Profile "NuConSept Plus" polyethylene Septic Tanks for use in Wyoming.

Dear Mr. Spann:

The Water Quality Division (WQD) of the Wyoming Department of Environmental Quality (DEQ) has received and reviewed the specifications for your all of your Snyder Industries different types and models of polyethylene septic tanks. The WQD finds that the following tank designs do meet the minimum requirements as identified in Chapter 11, Section 39 of the Water Quality Rules and Regulations, with one exception. Because there are no clean-outs provided on these tanks, the four **APPROVED Models (1050, 1250, and 1500 gallon double compartment & the 1500 gallon single compartment Ribbed "NuConSept" sizes)** will be required to extend the manways to the ground surface. Therefore, these approved models will be placed on our "**A-List**" of septic tanks approved for unrestricted use in Wyoming with the following condition:

"The manways on the septic tanks (one on each compartment) must be extended to the ground surface because there are no clean-outs provided on Snyder Industries septic tanks."

Additionally, Snyder Industries has a line of low profile septic tanks which do not meet the minimum Wyoming liquid depth requirement. However, the Wyoming DEQ/WQD does have a "**B-List**" of septic tanks which do not meet the minimum standards and requirements for automatic use in Wyoming. Tanks which qualify to be place on this list MAY be USED on an individual basis with sufficient justification

Herschler Building • 122 West 25th Street • Cheyenne, WY 82002 • <http://deq.state.wy.us>

ADMIN/OUTREACH (307) 777-7937 FAX 777-3610	ABANDONED MINES (307) 777-6145 FAX 777-6462	AIR QUALITY (307) 777-7391 FAX 777-5616	INDUSTRIAL SITING (307) 777-7369 FAX 777-5973	LAND QUALITY (307) 777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307) 777-7752 FAX 777-5973	WATER QUALITY (307) 777-7781 FAX 777-5973
--	---	---	---	--	--	---



such as shallow groundwater or bedrock, or other engineering reasons, or as a last resort show that use of any other "A-List" tank would create an unreasonable cost to the applicant.

The WQD has determined that the requirements for tanks to be placed on the "B-List" are that they must be at least 36" or more in depth, and must be two compartment tanks. On this basis Snyder Industries has three tanks which qualify to be placed on the "B-List". These tanks are the **1050, 1250, and 1500 gallon Low Profile "NuConSept Plus" double compartment** polyethylene septic tanks. Additionally, these tanks will have the same condition concerning extending the manways to the ground surface as above.

If you should have any questions, please call me at (307) 777-6183.

Sincerely,

A handwritten signature in cursive script that reads "Ronald L. Ewald".

Ronald L. Ewald  
Consulting Engineer  
SE District, Water Quality Division


RLE/rm/8-0050

cc: Septic Tank Status File  
Lou Harmon, Acting Water & Wastewater Program Manager, WQD  
Karen Farley, NE District Engineering Supervisor, WQD  
James Brough, NW District Engineering Supervisor, WQD  
Mark Baron, SW District Engineering Supervisor, WQD

# SNYDER INDUSTRIES INC.

MATERIALS:

- TANK: EXYDNMOBIL HDPE  
HD8660
- COVER: FORMOLENE HDPE  
HB5502B
- INTERCOMPARTMENTAL WALL: INEGS HDPE  
G50-100

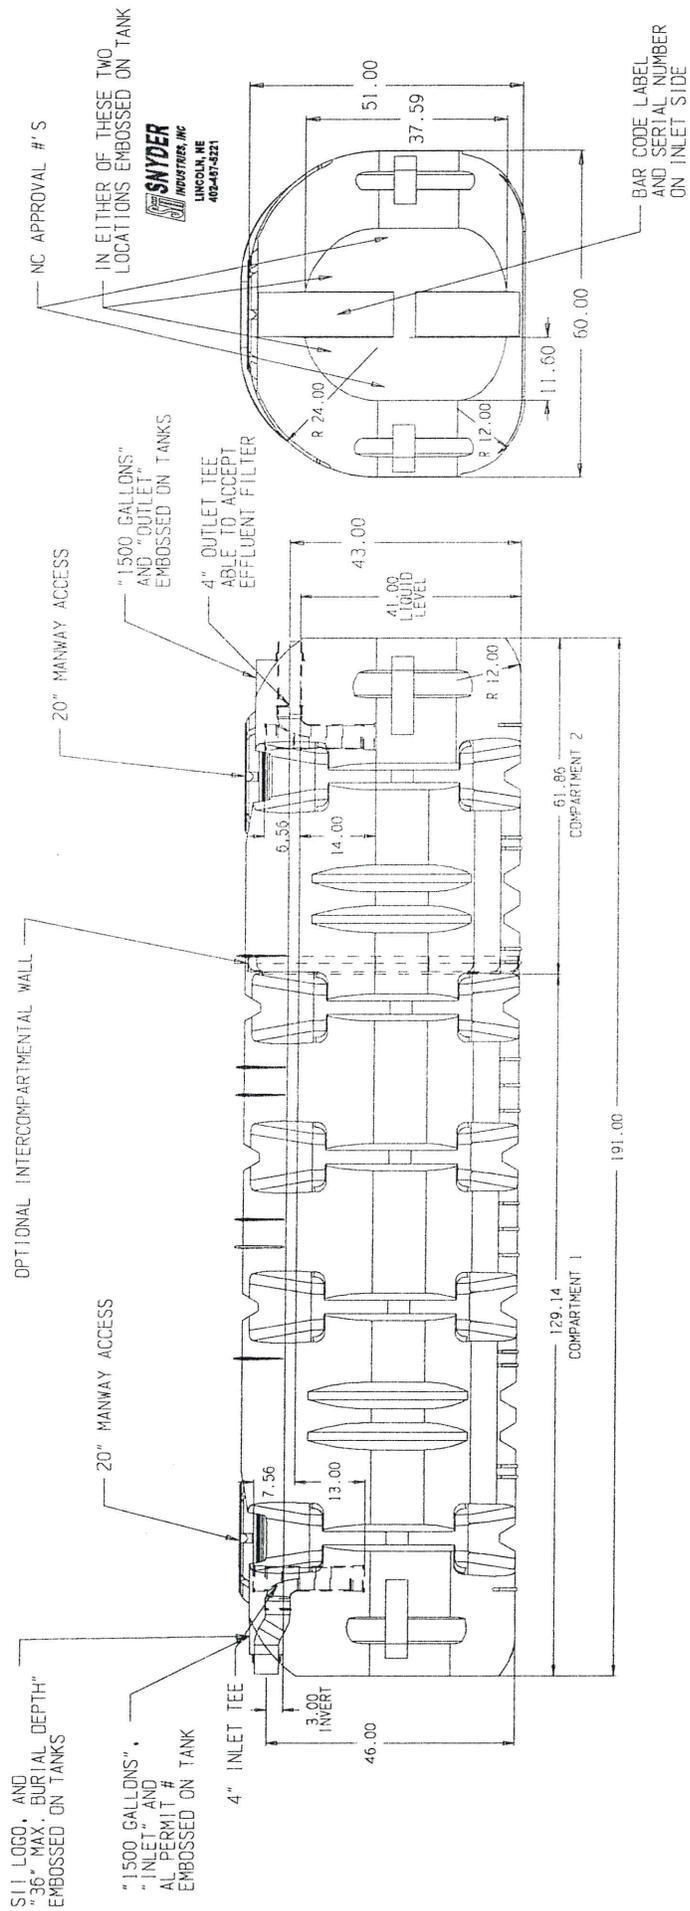

NOTE: DATE OF MFG. IS THE FIRST 4 DIGITS OF THE SERIAL NUMBER

(all dimensions in inches)  
1500 DOMINATOR SEPTIC TANK  
PART NUMBER: 1001511W--

## 1500 GALLON DOMINATOR SEPTIC TANK

DRAWN BY: CBH DATE: 07/29/09