

PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO.00-101
SPECIAL CONDITIONS
REF/PERMIT NO.81-441

Baggs In-line Chlorine Contact Chamber

PWS: 5600058

This permit hereby authorizes the applicant:

Town of Baggs
P.O. Box 300
Baggs WY 82321

to construct 500 lineal feet of 36" diameter water main and 650 feet of 6" diameter water main to provide required chlorine contact time according to the procedures and conditions of the application number 00-101. The facility is located in SE 1/4 Section 5 T12N R91W in the county of Carbon, in the State of Wyoming. This permit shall be effective for a period of two years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis .

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

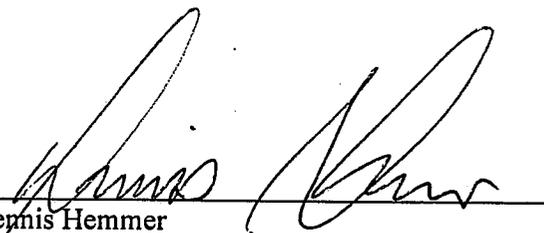

Dennis Hemmer
Director
Department of Environmental Quality

4-17-00

Date of Issuance

LBH/bb/00863.ltr

cc: WWDC

STATEMENT OF BASIS

- I. Permit Number: 00-101
- II. Application reviewed for compliance with the following regulations.
- A. Chapter XI. NO
- B. Chapter XII. YES
- III. Basis for issuing permit: Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- IV. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III.
- NO
- V. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on April 7, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

LBH/bb/00863.ltr

PERMIT TO CONSTRUCT

X New
Renewal
Modified

PERMIT NO. 00-102
SPECIAL CONDITIONS

Keller Septic Tank/Leach Field

This permit hereby authorizes the applicant:

Edward Keller
P. O. Box 882
Worland, WY 82401

to construct a septic tank/leach field to serve a three bedroom residence according to the procedures and conditions of application number 00-102. The facility is located in NW1/4 SW1/4 Sec/ 13. T47N, R93W or Tract 65-F resurvey in the county of Washakie, in the State of Wyoming. This permit shall be effective for a period of two (2) years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance, or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Jeff Hermansky, Northwest District Supervisor, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming 82520; (307) 332-3144; FAX (307) 332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Northwest District Supervisor, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northwest District Supervisor, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; (307)332-3144; FAX (307)332-3183; in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northwest District Supervisor, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

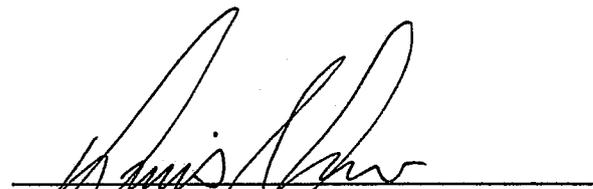

Dennis Hemmer
Director
Department of Environmental Quality

4-26-2000
Date of Issuance

JCH/jm
b/001032.ltr

STATEMENT OF BASIS

I. General information.

Permit Number: 00-102

II. Application reviewed for compliance with the following regulations.

A. Chapter XI. Yes

B. Chapter XII. No

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations.

N/A

V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III.

N/A

VI. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review is performed by Jeff Hermansky, Northwest District Supervisor, and completed on April 21, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

JCH/bb/001032.ltr

DEPARTMENT OF ENVIRONMENTAL QUALITY
STATE OF WYOMING
UNDERGROUND INJECTION CONTROL PERMIT
AUTHORIZATION TO DISCHARGE INTO UNDERGROUND RECEIVERS
ISSUED UNDER CHAPTER 16, WATER QUALITY RULES AND REGULATIONS

(X) New
() Modified

Permit Number: UIC 00-103
Subclass Number: 5E3

In compliance with the Wyoming Environmental Quality Act (W.S. 35-11-101 through 1104, specifically 301(a)(i) through (iv), Laws 1973, Ch. 250, Section 1) and Water Quality Rules and Regulations, Chapter 3 (1988), and Chapter 16 (1998),

Applicant: Wyoming Department of Transportation
P.O. Box 461
Basin, WY 82410
ATTN: Martin Kidner
(307) 568-3422

is authorized to operate the Sweetwater Station Rest Area Wastewater Facility in the NE $\frac{1}{4}$ SE $\frac{1}{4}$, Section 28, Township 30 North, Range 95 West, of the 6th Principal Meridian; according to the procedures and conditions of application # 00-103 and other conditions of this permit as contained on pages 1 through 9.


This permit shall become effective on date of issuance.



Administrator
Water Quality Division
Herschler Building, 122 West 25th Street
Cheyenne, WY 82002
Phone: (307) 777-7781

6/9/00

Date

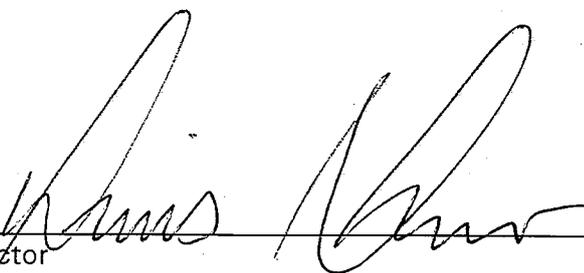

Director
Department of Environmental Quality
Herschler Building, 122 West 25th Street
Cheyenne, WY 82002

6-12-00

Date

TABLE OF CONTENTS

A. DISCHARGE ZONE AND AREA OF REVIEW 3
 Discharge Zone: 3
 Area of Review 3

B. GROUNDWATER CLASSIFICATION 3

C. AUTHORIZED OPERATIONS 4

D. ENVIRONMENTAL MONITORING PROGRAM FOR GROUNDWATERS OF THE STATE 4
 Samples and measurements 4
 records of all monitoring information 4
 information shall include 4
 groundwater in the receiving formation 4
 waive further monitoring 4

E. REQUIREMENTS FOR MONITORING THE DISCHARGE 5

F. RECORDS AND REPORTS 5
 retain copies of all reports 5
 planned physical alterations or additions 5
 submitted no later than 30 days 5
 report any noncompliance 5
 other information 5
 noncompliance with a permit condition or malfunction 6
 written submission shall be provided within 5 days 6
 noncompliance not reported otherwise 6
 failed to submit any relevant facts 6
 retain all records concerning the nature and composition 6
 public notice and an opportunity for hearing 6
 annual report of operations 6
 report for an aborted or curtailed operation 6

G. GENERAL PERMIT CONDITIONS 6
 permit may be modified, suspended or revoked 6
 reviewed at least once every 5 years 6
 modified at any time as may be required 7
 Public notice of the permit review 7
 Any permit noncompliance constitutes a violation 7
 filing of a request 7
 (permittee) is always responsible for permit compliance 7
 legal action 7
 does not convey any property rights 7
 provisions of this permit are severable 7
 waste which migrates into an aquifer 7
 permit is for a term of ten years 7
 modification which may result in a violation 7

construction requirements	7
notify the administrator	7
construction is complete	8
H. DUTIES OF THE PERMITTEE	8
Comply with all permit conditions	8
Halt or reduce activity	8
Take all reasonable steps	8
Furnish to the administrator	8
Operate and maintain all facilities	8
enter the premises where a regulated facility	8
I. SPECIAL MEASURES THE DIRECTOR FINDS NECESSARY:	8
sewage is found to be surfacing	8

A. DISCHARGE ZONE AND AREA OF REVIEW

1. Discharge Zone:

This injection facility (sanitary leachfield) is authorized to inject into an Alluvial Aquifer along the Sweetwater River which is found at this location from zero to 50 feet below the ground surface.

2. Area of Review

The facility authorized by this permit is located in:

Township 30 North, Range 95 West, 6th Principal Meridian
Section 28: NE¼ SE¼

The Area of Review around this facility is legally described as:

Township 30 North, Range 95 West, 6th Principal Meridian
Section 27: W½
Section 28: E½

B. GROUNDWATER CLASSIFICATION

1. The groundwater in the Alluvial Aquifer along the Sweetwater River is classified as class I (Domestic) under Chapter 8 of Wyoming Water Quality Rules and Regulations (March 11, 1993). This classification was made because:

- a. The groundwater in this formation is presumed to meet all of the quality standards set forth in Chapter 8 for class I water;
- b. The groundwater in this formation is currently being used for domestic purposes at several points of withdrawal; and

2. Groundwater of class I shall not be degraded so as to make it unusable as a source of water for this purpose. Any parameters which do not meet the class of use standard shall not be degraded whatsoever.

C. AUTHORIZED OPERATIONS

1. The Wyoming Department of Transportation is authorized to inject 148 barrels per day, (6,225 gallons per day) of wastewater as described: Sanitary waste only from a highway rest area. The waste to be disposed of is to be treated first in a septic tank. The operator is authorized to inject at a pressure of no more than atmospheric pressure as measured at the leachfield. This pressure is controlled by gravity drainage and is not required to be monitored.
2. **Hazardous Waste** This permit does not allow for the injection of any hazardous waste as defined by 40 CFR 261. Injection of any substance defined as hazardous waste, whether hazardous by listing or by characteristic is a violation of this permit.

D. ENVIRONMENTAL MONITORING PROGRAM FOR GROUNDWATERS OF THE STATE

1. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
2. The Wyoming Department of Transportation shall prepare records of all monitoring information to be retained for a period of at least 3 years after closure of the facility.
3. Records of monitoring information shall include:
 - a. The date, exact place, and time of sampling or measurements;
 - b. The name(s) of individual(s) who performed the sampling or measurements;
 - c. The date(s) analyses were performed;
 - d. Names of individuals who performed the analyses;
 - e. The analytical techniques or methods used; and
 - f. The results of such analyses.
4. The groundwater in the receiving formation shall be sampled and the following parameters analyzed on the following schedule and from the following wells.

WELL NAME OR NUMBER	SAMPLING SCHEDULE	ANALYTICAL METHOD	PARAMETER ANALYZED	PERMIT LIMIT (UCL)*
Monitor Well SWS-3	Quarterly	EPA Method 350.3	Ammonia as N	.500
		EPA Method 604	Phenol	.001
Sweetwater Station Domestic Water Supply Well		EPA Method 353.2	Nitrate as N	10.0
		Microbiological Methods for Monitoring the Environment p. 108	Total Coliform	1 colony/100ml

*All chemical concentrations in this permit are expressed in mg/l unless otherwise noted. Prior to taking the above samples, The Wyoming Department of Transportation shall monitor the static water level in monitor wells SWS-1, SWS-2 and SWS-3. The results of those measurements shall be reported along with the sampling results.

5. After the first two years of operation, the Water Quality Division may, without reissuing this permit, waive further monitoring of any parameter from the above list or may require additional monitoring based on new information about the nature of the waste. The Water Quality Division may also, after the first two years of operation, approve a more or less stringent monitoring schedule.

E. REQUIREMENTS FOR MONITORING THE DISCHARGE

The Wyoming Department of Transportation shall monitor the quality of the effluent from the septic tank at the point where the flow leaves the tank on the following schedule. The following parameters shall be analyzed by the listed methods and reported annually:

SAMPLING SCHEDULE	ANALYTICAL METHOD	PARAMETER ANALYZED	PERMIT LIMIT (UCL) *
Quarterly	EPA Method 420.1	Total Phenols	.500
	EPA Method 353.2	Nitrate as N	No Limit
	EPA Method 350.3	Ammonia as N	No Limit

*All chemical concentrations in this permit are expressed in mg/l unless otherwise noted. The above Upper Control Limit (UCL) is not to be exceeded in any sample. Exceedance of this value is a violation of this permit and shall require corrective action. In the event that any contaminant is found to exceed the above UCL's The Wyoming Department of Transportation shall undertake a study to determine and eliminate the source of that contaminant from the waste stream. Any parameter found to be exceeding the above UCL shall be sampled for in the downgradient wells if not already sampled for. After the first two years of operation, the Water Quality Division may, without reissuing this permit, waive further monitoring of any parameter from the above list or may require additional monitoring based on new information about the nature of the waste. The Water Quality Division may also, after the first two years of operation, approve a more or less stringent monitoring schedule.

F. RECORDS AND REPORTS

1. The Wyoming Department of Transportation shall retain copies of all reports required by this permit, and records of all data used to complete the application for this permit, for a period of at least 3 years from the date of the report or application.
2. The Wyoming Department of Transportation shall give notice to the administrator as soon as possible of any planned physical alterations or additions, other than authorized operation and maintenance, to the permitted facility and receive authorization prior to implementing the proposed alteration or addition.
3. Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this permit shall be submitted no later than 30 days following each schedule date.

4. The Wyoming Department of Transportation shall report any noncompliance which may endanger health or the environment, orally within 24 hours from the time The operator becomes aware of the circumstances. The report should include:
 - a. Any monitoring or other information which indicates that any contaminant may cause an endangerment to a usable groundwater of the state.
 - b. Any noncompliance with a permit condition or malfunction of the discharge (injection) system which may cause fluid migration into or between usable groundwaters of the state.
 - c. A written submission shall be provided within 5 days of the time The operator becomes aware of the circumstances. This written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected; the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.
5. The Wyoming Department of Transportation shall report all instances of noncompliance not reported otherwise, at the time monitoring reports are submitted; such reports shall contain the information listed in 4. above.
6. When The Wyoming Department of Transportation becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the administrator, it shall promptly submit such facts or information.
7. The Wyoming Department of Transportation shall retain all records concerning the nature and composition of injected fluids until 5 years after completion of any specified plugging and abandonment procedures. The administrator may require the owner/operator to deliver the records to the administrator at the conclusion of the retention period.
8. A subsurface discharge (injection) facility may not commence subsurface discharge (injection) until, following public notice and an opportunity for hearing, an underground injection control permit has been issued by the department for the proposed operation.
9. The annual report of operations for this facility shall be submitted on forms provided by the department and shall include the following information:
 - a. Any permit exceedances within the previous year.
 - b. The analytical results for sampling for the injected water and any groundwater sampling results required under Section D or E of this permit.
 - c. Annual reports are due in the Cheyenne office of the Water Quality Division no later than December 1 of each year.
10. A comprehensive report for an aborted or curtailed operation authorized by this permit shall be submitted to the administrator within 30 days of complete termination of the injection (discharge) or associated activity, in lieu of an annual report.

G. GENERAL PERMIT CONDITIONS

1. After notice and opportunity for a hearing, a permit may be modified, suspended or revoked in whole or part during its term for cause which includes, but is not limited to, any of the following:
 - a. Violation of the permit;
 - b. Obtaining a permit by misrepresentation or failure of the discharge well or system.
2. Each permit is reviewed at least once every 5 years, and may be reviewed more frequently.
3. A permit may be modified at any time as may be required, including for conformity with changes in regulations or standards which occur after the permit is issued. A permit may be modified in whole or part in order to apply more, or less, stringent standards; or prohibitions for a toxic or other substance present in The Wyoming Department of Transportation's discharge, as may be ordered by the council. This permit can be terminated by authority of the administrator for one or more permit violations.
4. Public notice of the permit review and request for public comment will be made every 10 years by the administrator.
5. Any permit noncompliance constitutes a violation of the permit and is grounds for enforcement action, permit termination, revocation, or modification.
6. The filing of a request by The Wyoming Department of Transportation for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance, does not stay any permit condition.
7. The owner/operator of record (permittee) is always responsible for permit compliance. A permit holder cannot transfer his permit without approval of the department director, and no such transfer will be approved if the facility is not in compliance with the existing permit unless the proposed permittee agrees to bring the facility into compliance.
8. Nothing in this permit shall be construed to preclude the institution of any legal action or relieve The Wyoming Department of Transportation from any responsibilities, liabilities or penalties established pursuant to any applicable state law or regulation.
9. The issuance of this permit does not convey any property rights in either real or personal property, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.
10. The provisions of this permit are severable, and if any provision of the permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.
11. Pollution or waste which migrates into an aquifer containing a usable groundwater of the state is a violation of the permit.

12. This permit is for a term of ten years. If The Wyoming Department of Transportation wishes to continue injection after the expiration date of this permit, they will be required to apply to the Administrator for, and obtain, a new permit.
13. Any modification which may result in a violation of a permit condition shall be reported to the administrator, and any modification that will result in a violation of a permit condition shall be reported to the administrator through the submission of a new or amended permit application.
14. The injection facility covered by this permit shall meet the construction requirements found in Section 10 of Chapter 16, and Part D of Chapter 11, Water Quality Rules and Regulations. The permittee shall submit notice of completion or construction to the administrator and allow for inspection of the facility upon completion of construction prior to commencing any injection activity.
15. the permittee shall notify the administrator seven (7) days prior to conversion of this facility to any other use, or final abandonment of the facility.
16. Injection shall not commence until all construction is complete.

H. DUTIES OF THE PERMITTEE

It is a duty of the permittee to:

1. Comply with all permit conditions;
2. Halt or reduce activity -- it shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce The Wyoming Department of Transportation activity in order to maintain compliance with the permit conditions;
3. Take all reasonable steps to minimize or correct any adverse impact on the environment resulting from noncompliance with this permit; and
4. Furnish to the administrator within a reasonable time, any information which the administrator may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with this permit; and furnish to the administrator, upon request, copies of records required to be kept by this permit.
5. Operate and maintain all facilities and systems of treatment and control which are installed or used by the permittee to achieve compliance with the conditions of this permit. Proper operation and maintenance includes effective performance, adequate funding and operator staffing and training, and adequate laboratory and process controls including appropriate quality assurance procedures. This provision requires the operation of back-up or auxiliary facilities or similar systems only when necessary to achieve compliance with the conditions of the permit.
6. Allow the administrator, or an authorized representative of the administrator, upon the presentation of credentials, during normal working hours, to enter the premises where a regulated facility is located, or where records are kept under conditions of this permit, and inspect the discharge and related facilities, review and copy reports and records required by the permit, collect fluid samples for analysis, measure and record water levels, and perform any other function authorized by law or regulation.

I. SPECIAL MEASURES THE DIRECTOR FINDS NECESSARY:

1. In the event that sewage is found to be surfacing from the leachfield covered by this permit, this is a violation of this permit and shall be reported immediately as required by Section F of this permit. The Wyoming Department of Transportation shall submit a modified application showing plans for a replacement leachfield (or other type of waste disposal method) within 90 days of determining that the primary leachfield has failed.

J. SIGNATORIES REQUIREMENT

1. All reports required by this permit and other requested information shall be signed as follows:

For a corporation -- by a principal executive officer of at least the level of vice-president;

For a partnership or sole proprietorship -- by a general partner or the proprietor, respectively;

For a municipality, state, federal or other public agency -- by either a principal executive officer or ranking elected official; or

By a duly authorized representative for any of the above. A person is a duly authorized representative only if:

1. The authorization is made in writing by one of the described principals;
 2. The authorization specifies either an individual or position having responsibility for the overall operation of the regulated facility or activity; and
 3. The written authorization is submitted to the administrator.
2. If an authorization is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization must be submitted to the administrator prior to or together with any reports or information, to be signed by an authorized representative.
 3. Any person signing a report or other requested information shall make the following certification:

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment."

RFL/mad/01390.ltr

PERMIT TO CONSTRUCT

New
Renewal
Modified

PERMIT NO. 00-104
SPECIAL CONDITIONS
REF/PERMIT NO. 96-032

Cheyenne 15th Street Reconstruction - Phase II
PWS# 5600011

This permit hereby authorizes the applicant:

Cheyenne Board of Public Utilities
P.O. Box 1469
Cheyenne WY 82003-1469

to construct, install or modify a replacement of water lines, valves, fire hydrants, and certain sewer manholes according to the procedures and conditions of the application number 00-104. The facility is located in Section 6 T13N R66W, Section 31 T14N R66W in the county of Laramie, in the State of Wyoming. This permit shall be effective for a period of five years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of following permit conditions:

- 1 of 4 The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

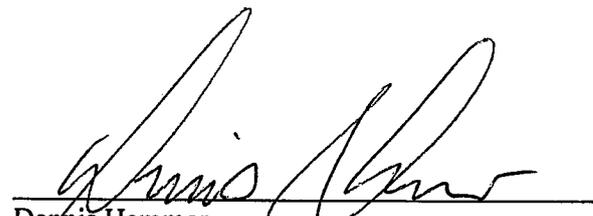

Dennis Hemmer
Director
Department of Environmental Quality

4-17-00

Date of Issuance

LBH/bb/00864.ltr

STATEMENT OF BASIS

- I. Permit Number: 00-104
- II. Application reviewed for compliance with the following regulations.
- A. Chapter XI. YES
- B. Chapter XII. YES
- III. Basis for issuing permit: Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- IV. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III.
- NO
- V. Documentation of Statement of Basis.
- The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on April 7, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

LBH/bb/00864.ltr

PERMIT TO CONSTRUCT

X New
— Renewal
— Modified

PERMIT NO. 00-105R
SPECIAL CONDITIONS

Water System Improvements - Snake River Canyon Ranch PWS #WY5600557

This permit hereby authorizes the applicant:

SRCR Resources, L.C.
1 River Bend Road
Jackson, WY 83001

to construct water system improvements consisting of a 136,000 gallon storage tank, one new well, a chlorination station, 950 feet of 3" diameter HDPE pipe, and 5,097 feet of 8" diameter HDPE pipe, including isolation valves and fire hydrants according to the procedures and conditions of application number 00-105R. The facility is located in Sections 32 and 33, T39N, R116W in the county of Teton, in the State of Wyoming. This permit shall be effective for a period of two (2) years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance, or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming 82520; (307) 332-3144; FAX (307) 332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 6 The applicant will notify the NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 6 The applicant will provide immediate oral and/or written notice to the NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; (307)332-3144; FAX (307)332-3183; in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 6 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-construct plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 6 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".
- 5 of 6 Within 60 days after construction of the proposed new well, yield and drawdown test data for the well shall be submitted to the NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520.
- 6 of 6 Shop drawings of the proposed concrete water storage reservoir, showing structural details of the reservoir, including proposed concrete thicknesses and reinforcing steel, shall be submitted to the NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520 for review prior to beginning construction of the reservoir.

AUTHORIZED BY:

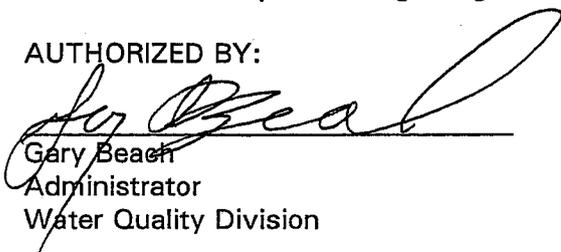

Gary Beach
Administrator
Water Quality Division

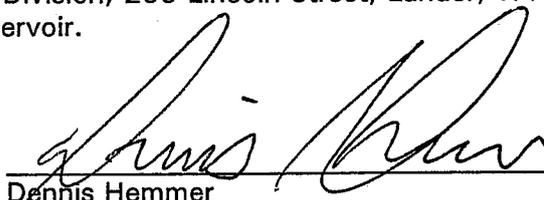

Dennis Hemmer
Director
Department of Environmental Quality

7-31-2000

Date of Issuance

DHC/mad/01940-ltr

cc: Teton County Planning, 181 So. King, Jackson, WY 83001

STATEMENT OF BASIS

I. General information.

Permit Number: 00-105R

II. Application reviewed for compliance with the following regulations.

A. Chapter 11. No

B. Chapter 12. Yes

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section 2.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations.

Not Applicable

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹.

Not Applicable

VI. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Doyle H. Conklin, SW District Engineering Supervisor, and completed on July 27, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

PERMIT TO CONSTRUCT

X New
___ Renewal

PERMIT NO. 00-106
SPECIAL CONDITIONS

Rabbit Row Auto Repair Non-discharging Sand and Oil Interceptor

This permit hereby authorizes the applicant:

Phil Begely
P.O. Box 271
Wilson WY 83014

to construct, install or modify a 1000 gallon sand-grease interceptor draining a 6 bay shop, with a recycling pump and a liquid evaporator, according to the procedures and conditions of the application number 00-106. The facility is located in NE 1/4 Section 23 T41N R117W in the county of Teton, in the State of Wyoming. This permit shall be effective for a period of two years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming 82520; telephone (307) 332-2479; FAX (307) 332-7726.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the DEQ/WQD Northwest District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral or written notice to the DEQ/WQD Northwest District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Northwest District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

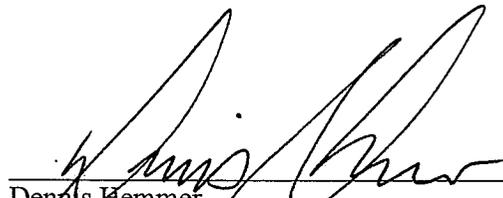

Dennis Hemmer
Director
Department of Environmental Quality

5-12-00

Date of Issuance

LBH/mad 001129.ltr

cc: Jeff Hermansky

STATEMENT OF BASIS

- I. Permit Number: 00-106
- II. Application reviewed for compliance with the following regulations.
- A. Chapter XI. YES
- B. Chapter XII. NO
- III. Basis for issuing permit: Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- IV. Application requires review to determine groundwater impacts in accordance with Sec. 17, Chapter 3.
- YES
- V. If Section 17 of Chapter 3 is applicable, indicate the basis of determining groundwater will be protected.

Facility will not allow a discharge to groundwater. The system is non-discharging by design with all liquids collected by the interceptor being reused or tested and disposed of off-site or evaporated based on hazardous material classification.

Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on May 9, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

AS-BUILT
PERMIT TO CONSTRUCT

New
Renewal
Modified

PERMIT NO. 00-107
SPECIAL CONDITIONS

Pyer Replacement Leach Field

This permit hereby authorizes the applicant:

Terry Pyer
777 River Road
Worland, WY 82401

to have constructed an Infiltrator type replacement leach field according to the procedures and conditions of application number 00-107. The facility is located in Tract 12-1 Kleinschmidt #2, Subdivision in Lot 2, Sec. 1, T47N, R92 1/2W in the county of Washakie, in the State of Wyoming.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, meets applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee has constructed and shall operate the permitted facility in accordance with the statements, presentations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

1 of 1 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division



Dennis Hemmer
Director
Department of Environmental Quality

5-2-2000

Date of Issuance

JCH/jm

STATEMENT OF BASIS

- I. General information.
Permit Number: 00-107
- II. Application reviewed for compliance with the following regulations.
- A. Chapter XI. Yes
 - B. Chapter XII. No
- III. Basis for issuing permit.
- A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
Yes
 - B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.
No
 - C. Permit based on deviation from applicable regulations in accordance with approved policy statement.
No
- IV. Facilities not specifically covered by regulations.
N/A
- V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III.
N/A
- VI. Documentation of Statement of Basis.
- The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Jeff Hermansky, Northwest District Supervisor, and completed on April 21, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."



The State
of Wyoming



Department of Environmental Quality

Jim Geringer, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH 307-777-7758 FAX 777-3610	ABANDONED MINES 307-777-6145 FAX 777-6462	AIR QUALITY 307-777-7391 FAX 777-5616	INDUSTRIAL SITING 307-777-7369 FAX 777-6937	LAND QUALITY 307-777-7756 FAX 777-5864	SOLID & HAZ. WASTE 307-777-7752 FAX 777-5973	WATER QUALITY 307-777-7781 FAX 777-5973
--	---	---	---	--	--	---

April 25, 2000

Terry Pyer
777 River Road
Worland, WY 82401


RE: As-Built Permit To Construct, WQD Reference Number 00-107

Dear Mr. Pyer:

The Department of Environmental Quality/Water Quality Division (DEQ/WQD) has reviewed the above referenced As-Built Application submitted by as-built application, . Our review of the information and as-constructed plans submitted to this office indicates that the application meets DEQ/WQD regulations and the enclosed As-Built Permit To Construct is hereby issued. The enclosed permit covers an Infiltrator type replacement leach field which has already been constructed.

Please be advised that the system must be constructed, installed and operated in accordance with the statements, representations and procedures presented in the application and all supporting documentation as well as the terms and conditions of the permit. You are urged to be familiar with all aspects of the permit application, permit and permit conditions. Any person objecting to a permit issued by the DEQ and desiring affirmative relief may request a hearing before the Environmental Quality Council in accordance with the Rules of Practice and Procedure for the Department of Environmental Quality and the Wyoming Administrative Procedures Act.

Sincerely,

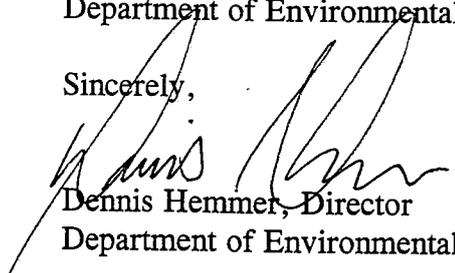
Dennis Hemmer, Director
Department of Environmental Quality

DH/jch/mad 001046.ltr
Enclosure:

PERMIT TO CONSTRUCT

New
Renewal
Modified

PERMIT NO. 00-108
SPECIAL CONDITIONS

Range View RV Park Septic System

This permit hereby authorizes the applicant:

Dan Davidson
1020 East Cedar Street
Rawlins, Wyoming 82301

to construct and install an RV park business septic system with a chamber type leachfield for domestic waste according to the procedures and conditions of the application number 00-108. The facility is located in the NW 1/4 of Section 24, T17N, R84W in the county of Carbon, in the State of Wyoming. This permit shall be effective for a period of 2 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits, or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District Engineering Supervisor, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representation, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 5. The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 5. The applicant will provide immediate oral and/or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 5. Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit or
 - d. Certification the facility was completed with changes or modifications. **Submittal of as-constructed plans and specifications** for the system as it was constructed, certified by an engineer if appropriate. **All modifications or deviations from the authorized plans must be highlighted.**
- 4 of 5. Septic Tank Configuration Requirements - Two 1500 gallon Vaughn Concrete Products septic tanks are to be used in series. **The upflow (first tank in-line) septic tank shall be a single compartment tank.** Additionally, either a 6 inch diameter clean-out riser or the manways must be extended to the ground surface from each compartment of the two tanks.
- 5 of 5. The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".


AUTHORIZED BY:

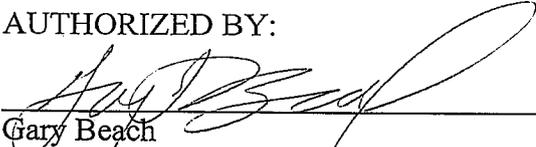

Gary Beach
Administrator
Water Quality Division

10-25-00

Date of Issuance

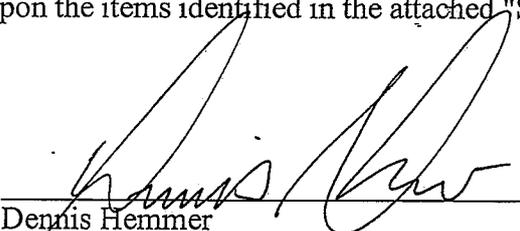

Dennis Hemmer
Director
Department of Environmental Quality

RLE/mad/02684.ltr

cc: Carbon County Planner/Sanitarian

STATEMENT OF BASIS

- I. General information.
- A. Permit Number: 00-108
- II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)
- A. Chapter 11. Yes
- B. Chapter 12. No
- III. Basis for issuing permit. (Indicate yes or no for each section.)
- A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
Yes
- B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.
No
- C. Permit based on deviation from applicable regulations in accordance with approved policy statement.
No
- IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)
- A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.
NOT Applicable
- B. Briefly state the basis for the deviation.
NOT Applicable
- C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).
NOT Applicable

- V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹. (Indicate either applicable or not applicable. If not applicable delete all of section VI. from the Statement of Basis.)

NOT Applicable

VI. Deleted

VII. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Ronald L. Ewald, Senior Analyst, and completed on October 18, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

REVIEW OF PLANS AND SPECIFICATIONS
WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION

Herschler Bldg., 4 West
Cheyenne, Wyoming 82002

PROJECT: Range View RV Park Septic System

ENGINEER: Monty D. Winter
Winter Consulting Engineers
P.O. Box 1859
Saratoga, Wyoming 82331
Ph: (307) 326-8938

APPLICANT: Dan Davidson
1020 East Cedar Street
Rawlins, Wyoming 82301

WATER QUALITY DIVISION REFERENCE NUMBER: 00-108

REVIEWING ENGINEER: Ronald L. Ewald *RLE*
Phone: (307) 777-6183

DATE OF REVIEW: October 2, 2000

ACTION: NOT AUTHORIZED FOR CONSTRUCTION. In accordance with Section 9(a)(ii), Chapter 3, Wyoming Water Quality Rules and Regulations, the application is denied because it is incomplete or does not meet applicable minimum design and construction standards. Please address the comments outlined below and submit the requested information in order that the application process may be completed in accordance with Section 9. If the applicant fails to provide the requested information within six months the incomplete application shall be returned.

COMMENTS, INADEQUACIES, AND QUESTIONS:

1. Septic Tank Dimensions and Specifications - The revised plans indicate that Vaughn Concrete Products 3000 gallon septic tank is to be used. The Water Quality Division(WQD) has not pre-approved a Vaughn 3000 gallon tank. Additionally, when Vaughn Concrete was called, they said they did not have a 3000 gallon tank or forms. The largest size they had was 2500 gallons, and it has problems. Therefore, if you intend to have Vaughn make a special order 3000 gallon tank for this project, a full and complete set of plans, specifications, and dimensions will have to be submitted for review and approval.

However, if you intend to use Vaughn Concrete products, another solution may be possible. Two smaller precast tanks could be used in series provided the upstream tank was at least a 1500 gallon single compartment tank (center divider not installed). Or, two smaller tanks could be used in parallel if they were properly sized and plumbed. For example, the north row of trailer spaces and the future service center could be connected directly to MH-4 and then to a 2000 gallon tank, while the south row of trailer spaces could flow to MH-3 and then into a 1000 gallon tank. These two tanks would then both flow into the distribution box at the head of the leach field. Please provide either detailed specs of the 3000 gallon tank, or details of an alternative septic tank arrangement.

2. Leach Field Size - The revised plans show a new leachfield layout which is much better. However, the plans do not indicate the length or number of "Infiltrator" chambers in each of the six legs. How many chamber units does this layout contain?
3. Water System - These questions were not addressed in the resubmittal. These questions need to be answered before the expanded septic system is approved. Therefore:

Do you intend to have a water supply system as part of this RV park? If so, please describe it. Will city water or a well be used? Will the RV spaces be dry or wet with water taps at each space? If you plan to have more than 15 service connections or will regularly serve more than 25 people, you may also need a permit to construct for a public water supply system.

REVIEW OF PLANS AND SPECIFICATIONS
WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION

Herschler Bldg., 4 West
Cheyenne, Wyoming 82002

PROJECT: Range View RV Park Septic System

ENGINEER: Monty D. Winter
Winter Consulting Engineers
P.O. Box 1859
Saratoga, Wyoming 82331
Ph: (307) 326-8938

APPLICANT: Dan Davidson
1020 East Cedar Street
Rawlins, Wyoming 82301

WATER QUALITY DIVISION REFERENCE NUMBER: 00-108

REVIEWING ENGINEER: Ronald L. Ewald *RLE*
Phone: (307) 777-6183

DATE OF REVIEW: May 8, 2000

ACTION: NOT AUTHORIZED FOR CONSTRUCTION. In accordance with Section 9(a)(ii), Chapter 3, Wyoming Water Quality Rules and Regulations, the application is denied because it is incomplete or does not meet applicable minimum design and construction standards. Please address the comments outlined below and submit the requested information in order that the application process may be completed in accordance with Section 9. If the applicant fails to provide the requested information within six months the incomplete application shall be returned.

COMMENTS, INADEQUACIES, AND QUESTIONS:

1. Septic Tank Too Small - The minimum septic tank capacity must be at least 1.5 times the design flow. Since the design flow is 1970gpd, you need at least 3000 gallons of septic tank capacity. This can be either one large tank, 2 smaller tanks in series (1st compartment must be at least 60% of the total volume), or 2 tanks in parallel each feeding part of the leach field.

2. Leach Field Too Small - In a bed type leach field, each "Infiltrator" unit is allowed to be considered as equivalent to 35.4 sq ft of infiltrative surface. Therefore, a minimum of 103 units will be needed (3648 sq ft/35.4).
3. Equal Leach Field Effluent Distribution - How will relatively equal distribution of the septic tank effluent be achieved? As currently laid out, there are 11 rows of Infiltrators varying in length from 12 feet to 100 feet. This lay out will not provide equal effluent distribution. Simply installing a distribution box at the head of the field is not adequate. Please provide more detail on how equal distribution will be accomplished, or redo the leach field layout to provide rows of roughly equal length.
4. Water System - Do you intend to have a water supply system as part of this RV park? If so, please describe it. City water or a well? Taps at each RV space, etc? If you plan to have more than 15 service connections or will regularly serve more than 25 people you may also need a permit to construct for a public water supply system.

**DEPARTMENT OF ENVIRONMENTAL QUALITY
STATE OF WYOMING
UNDERGROUND INJECTION CONTROL PERMIT
AUTHORIZATION TO DISCHARGE INTO UNDERGROUND RECEIVERS
ISSUED UNDER CHAPTER 16, WATER QUALITY RULES AND REGULATIONS**

(X) New
() Modified

Permit Number: UIC 00-109
Subclass Number: 5E4

In compliance with the Wyoming Environmental Quality Act (W.S. 35-11-101 through 1104, specifically 301(a)(i) through (iv), Laws 1973, Ch. 250, Section 1) and Water Quality Rules and Regulations, Chapter 3 (1988), and Chapter 16 (1998),

Applicant: U.S. National Park Service, Grand Teton National Park
P.O. Box 170
Moose, WY 83012
(307) 739-3357

is authorized to operate the U.S. National Park Service, Grand Teton National Park Wastewater Facility in Section 25, Township 43 North, Range 116 West, of the 6th Principal Meridian; according to the procedures and conditions of application # 00-109 and other conditions of this permit as contained on pages 1 through 10.


This permit shall become effective on date of issuance.



Administrator
Water Quality Division
Herschler Building, 122 West 25th Street
Cheyenne, WY 82002
Phone: (307) 777-7781

6/9/00

Date

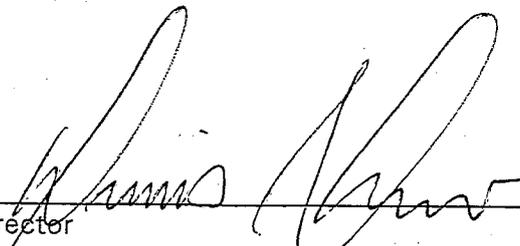

Director
Department of Environmental Quality
Herschler Building, 122 West 25th Street
Cheyenne, WY 82002

6-12-00

Date

TABLE OF CONTENTS

A. DISCHARGE ZONE AND AREA OF REVIEW 3
 Discharge Zone: 3
 Area of Review 3

B. GROUNDWATER CLASSIFICATION 3

C. AUTHORIZED OPERATIONS 4

D. ENVIRONMENTAL MONITORING PROGRAM FOR GROUNDWATERS OF THE STATE 4
 Samples and measurements 4
 records of all monitoring information 4
 information shall include 4
 groundwater in the receiving formation 4
 waive further monitoring 5

E. REQUIREMENTS FOR MONITORING THE DISCHARGE 5

F. RECORDS AND REPORTS 5
 retain copies of all reports 5
 planned physical alterations or additions 5
 submitted no later than 30 days 5
 report any noncompliance 6
 other information 6
 noncompliance with a permit condition or malfunction 6
 written submission shall be provided within 5 days 6
 noncompliance not reported otherwise 6
 failed to submit any relevant facts 6
 retain all records concerning the nature and composition 6
 public notice and an opportunity for hearing 6
 annual report of operations 6
 report for an aborted or curtailed operation 6

G. GENERAL PERMIT CONDITIONS 7
 permit may be modified, suspended or revoked 7
 reviewed at least once every 5 years 7
 modified at any time as may be required 7
 Public notice of the permit review 7
 Any permit noncompliance constitutes a violation 7
 filing of a request 7
 (permittee) is always responsible for permit compliance 7
 legal action 7
 does not convey any property rights 7
 provisions of this permit are severable 7
 waste which migrates into an aquifer 7
 permit is for a term of ten years 7
 modification which may result in a violation 8
 construction requirements 8

notify the administrator	8
construction is complete	8
DUTIES OF THE PERMITTEE	8
Comply with all permit conditions	8
Halt or reduce activity	8
Take all reasonable steps	8
Furnish to the administrator	8
Operate and maintain all facilities	8
enter the premises where a regulated facility	8
I. SPECIAL MEASURES THE DIRECTOR FINDS NECESSARY:	9
sewage is found to be surfacing	9
After the first three years of operation	9
The permittee shall maintain all major systems	9
Operation and Maintenance (O&M) Manual	9
licensed Level IV Wastewater Plant Operator	9
information shall be signed as follows	10
If an authorization is no longer accurate	10
shall make the following certification	10

A. DISCHARGE ZONE AND AREA OF REVIEW

Discharge Zone:

This injection facility (sanitary leachfield) is authorized to inject into the Alluvial Aquifer along Taggart Creek which is found at this location from zero to 50 feet below the ground surface.

2. Area of Review

The facility authorized by this permit is located in:

Township 43 North, Range 116 West, 6th Principal Meridian
Section 25: NW¼ SE¼

The Area of Review around this facility is legally described as:

Township 43 North, Range 116 West, 6th Principal Meridian
Section 25: All

B. GROUNDWATER CLASSIFICATION

1. The groundwater in the Alluvial Aquifer along Taggart Creek is classified as class I (Domestic) under Chapter 8 of Wyoming Water Quality Rules and Regulations (March 11, 1993). This classification was made because:
 - a. The groundwater in this formation meets all of the quality standards set forth in Chapter 8 for class I water;
 - b. The groundwater in this formation is currently being used for domestic purposes at several points of withdrawal; and

2. Groundwater of class I shall not be degraded so as to make it unusable as a source of water for this purpose. Any parameters which do not meet the class of use standard shall not be degraded whatsoever.

C. AUTHORIZED OPERATIONS

1. U.S. National Park Service, Grand Teton National Park is authorized to inject 1357 barrels per day, (57,000 gallons per day) of wastewater as described: Sanitary waste only the Moose Complex. The waste to be disposed of is to be treated first in an activated sludge treatment plant. The operator is authorized to inject at a pressure of no more than atmospheric pressure as measured at the leachfield. This pressure is controlled by gravity drainage and is not required to be monitored.
2. **Hazardous Waste** This permit does not allow for the injection of any hazardous waste as defined by 40 CFR 261. Injection of any substance defined as hazardous waste, whether hazardous by listing or by characteristic is a violation of this permit.

D. ENVIRONMENTAL MONITORING PROGRAM FOR GROUNDWATERS OF THE STATE

1. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
2. U.S. National Park Service, Grand Teton National Park shall prepare records of all monitoring information to be retained for a period of at least 3 years after closure of the facility.
3. Records of monitoring information shall include:
 - a. The date, exact place, and time of sampling or measurements;
 - b. The name(s) of individual(s) who performed the sampling or measurements;
 - c. The date(s) analyses were performed;
 - d. Names of individuals who performed the analyses;
 - e. The analytical techniques or methods used; and
 - f. The results of such analyses.
4. The groundwater in the receiving formation shall be sampled and the following parameters analyzed on the following schedule and from the following wells.

WELL NAME OR NUMBER	SAMPLING SCHEDULE	ANALYTICAL METHOD	PARAMETER ANALYZED	PERMIT LIMIT (UCL)*
Moose Village Wells 1 and 2 (43393911042400 1 and 433939110425601)	Annually in the Fall	EPA Method 350.3	Ammonia as N	.500
		EPA Method 353.2	Nitrate as N	10.0

*All chemical concentrations in this permit are expressed in mg/l unless otherwise noted. Prior to taking the above samples, U.S. National Park Service, Grand Teton National Park shall monitor the static water level in monitor wells MV-1, MV-2 and MV-3. The results of those measurements shall be reported along with the sampling results.

The above Upper Control Limit (UCL) is not to be exceeded in any sample. Exceedance of this value is a violation of this permit and shall require corrective action.

After the first two years of operation, the Water Quality Division may, without reissuing this permit, waive further monitoring of any parameter from the above list or may require additional monitoring based on new information about the nature of the waste. The Water Quality Division may also, after the first two years of operation, approve a more or less stringent monitoring schedule.

E. REQUIREMENTS FOR MONITORING THE DISCHARGE

U.S. National Park Service, Grand Teton National Park shall monitor the quality of the effluent from the plant at the point after all treatment has occurred on the following schedule. The following parameters shall be analyzed by the listed methods and report quarterly:

SAMPLING SCHEDULE	ANALYTICAL METHOD	PARAMETER ANALYZED	PERMIT LIMIT (UCL) *
Monthly	Microbiological Methods for Monitoring the Environment p. 108	Total Coliform Bacteria	No Limit
	EPA Method 405.1	5 Day Biological Oxygen Demand	30.0
	EPA Method 353.2	Nitrate as N	15.0
	EPA Method 350.3	Ammonia as N	3.0

*All chemical concentrations in this permit are expressed in mg/l unless otherwise noted. The above Upper Control Limit (UCL) is not to be exceeded in any sample. Exceedance of this value is a violation of this permit and shall require corrective action. In the event that any contaminant is found to exceed the above UCL's U.S. National Park Service, Grand Teton National Park shall undertake a study to determine and eliminate the source of that contaminant from the waste stream. Any parameter found to be exceeding the above UCL shall be sampled for in the downgradient wells if not already sampled for. After the first two years of operation, the Water Quality Division may, without reissuing this permit, waive further monitoring of any parameter from the above list or may require additional monitoring based on new information about the nature of the waste. The Water Quality Division may also, after the first two years of operation, approve a more or less stringent monitoring schedule.

F. RECORDS AND REPORTS

1. U.S. National Park Service, Grand Teton National Park shall retain copies of all reports required by this permit, and records of all data used to complete the application for this permit, for a period of at least 3 years from the date of the report or application.
2. U.S. National Park Service, Grand Teton National Park shall give notice to the administrator as soon as possible of any planned physical alterations or additions, other than authorized operation and maintenance, to the permitted facility and receive authorization prior to implementing the proposed alteration or addition.

3. Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this permit shall be submitted no later than 30 days following each schedule date.
4. U.S. National Park Service, Grand Teton National Park shall report any noncompliance which may endanger health or the environment, orally within 24 hours from the time The operator becomes aware of the circumstances. The report should include:
 - a. Any monitoring or other information which indicates that any contaminant may cause an endangerment to a usable groundwater of the state.
 - b. Any noncompliance with a permit condition or malfunction of the discharge (injection) system which may cause fluid migration into or between usable groundwaters of the state.
 - c. A written submission shall be provided within 5 days of the time The operator becomes aware of the circumstances. This written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected; the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.
5. U.S. National Park Service, Grand Teton National Park shall report all instances of noncompliance not reported otherwise, at the time monitoring reports are submitted; such reports shall contain the information listed in 4. above.
6. When U.S. National Park Service, Grand Teton National Park becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the administrator, it shall promptly submit such facts or information.
7. U.S. National Park Service, Grand Teton National Park shall retain all records concerning the nature and composition of injected fluids until 5 years after completion of any specified plugging and abandonment procedures. The administrator may require the owner/operator to deliver the records to the administrator at the conclusion of the retention period.
8. A subsurface discharge (injection) facility may not commence subsurface discharge (injection) until, following public notice and an opportunity for hearing, an underground injection control permit has been issued by the department for the proposed operation.
9. The annual report of operations for this facility shall be submitted on forms provided by the department and shall include the following information:
 - a. Any permit exceedances within the previous year.
 - b. The analytical results for sampling for the injected water and any groundwater sampling results required under Section D or E of this permit.
 - c. Annual reports are due in the Cheyenne office of the Water Quality Division no later than December 1 of each year.

10. A comprehensive report for an aborted or curtailed operation authorized by this permit shall be submitted to the administrator within 30 days of complete termination of the injection (discharge) or associated activity, in lieu of an annual report.

G. GENERAL PERMIT CONDITIONS

1. After notice and opportunity for a hearing, a permit may be modified, suspended or revoked in whole or part during its term for cause which includes, but is not limited to, any of the following:
 - a. Violation of the permit;
 - b. Obtaining a permit by misrepresentation or failure of the discharge well or system.
2. Each permit is reviewed at least once every 5 years, and may be reviewed more frequently.
3. A permit may be modified at any time as may be required, including for conformity with changes in regulations or standards which occur after the permit is issued. A permit may be modified in whole or part in order to apply more, or less, stringent standards; or prohibitions for a toxic or other substance present in U.S. National Park Service, Grand Teton National Park's discharge, as may be ordered by the council. This permit can be terminated by authority of the administrator for one or more permit violations.
4. Public notice of the permit review and request for public comment will be made every 10 years by the administrator.
5. Any permit noncompliance constitutes a violation of the permit and is grounds for enforcement action, permit termination, revocation, or modification.
6. The filing of a request by U.S. National Park Service, Grand Teton National Park for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance, does not stay any permit condition.
7. The owner/operator of record (permittee) is always responsible for permit compliance. A permit holder cannot transfer his permit without approval of the department director, and no such transfer will be approved if the facility is not in compliance with the existing permit unless the proposed permittee agrees to bring the facility into compliance.
8. Nothing in this permit shall be construed to preclude the institution of any legal action or relieve U.S. National Park Service, Grand Teton National Park from any responsibilities, liabilities or penalties established pursuant to any applicable state law or regulation.
9. The issuance of this permit does not convey any property rights in either real or personal property, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.
10. The provisions of this permit are severable, and if any provision of the permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

11. Pollution or waste which migrates into an aquifer containing a usable groundwater of the state is a violation of the permit.
12. This permit is for a term of ten years. If U.S. National Park Service, Grand Teton National Park wishes to continue injection after the expiration date of this permit, they will be required to apply to the Administrator for, and obtain, a new permit.
13. Any modification which may result in a violation of a permit condition shall be reported to the administrator, and any modification that will result in a violation of a permit condition shall be reported to the administrator through the submission of a new or amended permit application.
14. The injection facility covered by this permit shall meet the construction requirements found in Section 10 of Chapter 16, and Part D of Chapter 11, Water Quality Rules and Regulations. The permittee shall submit notice of completion or construction to the administrator and allow for inspection of the facility upon completion of construction prior to commencing any injection activity.
15. the permittee shall notify the administrator seven (7) days prior to conversion of this facility to any other use, or final abandonment of the facility.
16. Injection shall not commence until all construction is complete.

H. DUTIES OF THE PERMITTEE

It is a duty of the permittee to:

1. Comply with all permit conditions;
2. Halt or reduce activity -- it shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce U.S. National Park Service, Grand Teton National Park activity in order to maintain compliance with the permit conditions;
3. Take all reasonable steps to minimize or correct any adverse impact on the environment resulting from noncompliance with this permit; and
4. Furnish to the administrator within a reasonable time, any information which the administrator may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with this permit; and furnish to the administrator, upon request, copies of records required to be kept by this permit.
5. Operate and maintain all facilities and systems of treatment and control which are installed or used by the permittee to achieve compliance with the conditions of this permit. Proper operation and maintenance includes effective performance, adequate funding and operator staffing and training, and adequate laboratory and process controls including appropriate quality assurance procedures. This provision requires the operation of back-up or auxiliary facilities or similar systems only when necessary to achieve compliance with the conditions of the permit.
6. Allow the administrator, or an authorized representative of the administrator, upon the presentation of credentials, during normal working hours, to enter the premises where a regulated facility is located, or where records are kept under conditions of this permit, and inspect the discharge and related facilities, review and copy reports and records required by the permit, collect fluid samples

for analysis, measure and record water levels, and perform any other function authorized by law or regulation.

SPECIAL MEASURES THE DIRECTOR FINDS NECESSARY:

1. In the event that sewage is found to be surfacing from the leachfield covered by this permit, this is a violation of this permit and shall be reported immediately as required by Section F of this permit. U.S. National Park Service, Grand Teton National Park shall submit a modified application showing plans for a replacement leachfield (or other type of waste disposal method) within 90 days of determining that the primary leachfield has failed.
2. After the first three years of operation under this permit, the environmental monitoring requirements of this permit shall be reevaluated by the Water Quality Division to determine their effectiveness and the overall necessity for each of the requirements placed on this permit. At that time, Water Quality Division may impose more or less stringent requirements for monitoring and reporting.
3. The permittee shall maintain all major systems within the wastewater treatment plant in working order. Operation of the plant with any system inoperable for more than 30 days shall be considered a violation of this permit, even if the effluent quality meets all other limitations. Water Quality Division shall be notified in advance if any major system will be shut down for more than 7 days for any reason.
4. U.S. National Park Service, Grand Teton National Park shall submit one copy of the Operation and Maintenance (O&M) Manual to the UIC section, Cheyenne Office, Water Quality Division for approval within 90 days of the beginning of construction for this plant. Once approved in writing by the department, the O&M Manual shall be considered part of this permit, and failure to follow that manual is a violation of this permit. The O&M Manual shall, at a minimum include the following:
 - a. Operational monitoring requirements for the plant to insure the proper operation of the plant on at least a weekly basis. Parameters selected for monitoring shall be those analysis actually needed for proper operation of the plant in full compliance with discharge limitations.
 - b. A maintenance schedule for all major components of the plant, including location of on site spares and source information for replacement parts.
 - c. A comprehensive list of reports required to be filed by this permit, and all applicable State of Wyoming regulations.
7. U.S. National Park Service, Grand Teton National Park shall contract with a licensed Level IV Wastewater Plant Operator to be in responsible charge of the plant operations and reporting requirements.

J. SIGNATORIES REQUIREMENT

1. All reports required by this permit and other requested information shall be signed as follows:

For a corporation -- by a principal executive officer of at least the level of vice-president;

For a partnership or sole proprietorship -- by a general partner or the proprietor, respectively;

For a municipality, state, federal or other public agency -- by either a principal executive officer or ranking elected official; or

By a duly authorized representative for any of the above. A person is a duly authorized representative only if:

1. The authorization is made in writing by one of the described principals;
 2. The authorization specifies either an individual or position having responsibility for the overall operation of the regulated facility or activity; and
 3. The written authorization is submitted to the administrator.
2. If an authorization is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization must be submitted to the administrator prior to or together with any reports or information, to be signed by an authorized representative.
3. Any person signing a report or other requested information shall make the following certification:

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment."

RFL/mad/01391.ltr

REVIEW OF PLANS AND SPECIFICATIONS
WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION

Herschler Bldg., 4 West
Cheyenne, Wyoming 82002

PROJECT: Terry Bison Ranch - New 3rd Well

ENGINEER: Russell Dahlgren
Sear Brown
1709 Carey, #8
Cheyenne, Wyoming 82001
Ph: 634-3582

APPLICANT: Terry Bison Ranch
Attn. Daniel R. Thiel, Vice President
51 I-25 Service Road east
Cheyenne, Wyoming 82007

WATER QUALITY DIVISION REFERENCE NUMBER: 00-110

REVIEWING ENGINEER: Ronald L. Ewald *RLE*
Phone: (307) 777-6183

DATE OF REVIEW: May 24, 2000

ACTION: **NOT AUTHORIZED FOR CONSTRUCTION.** In accordance with Section 9(a)(ii), Chapter 3, Wyoming Water Quality Rules and Regulations, the application is denied because it is incomplete or does not meet applicable minimum design and construction standards. Please address the comments outlined below and submit the requested information in order that the application process may be completed in accordance with Section 9. If the applicant fails to provide the requested information within six months the incomplete application shall be returned.

COMMENTS, INADEQUACIES, AND QUESTIONS:


1. Well pumps, discharge piping, and appurtenances {Chapter 12, Section (9)(b)(iii)(D)(III through VII) } -
Because you will now have two different wells feeding the same chlorination unit, addition control features need to be included. The discharge piping shall be equipped with check valves, shutoff valves, pressure gauges, a means of measuring total or individual flows, and a smooth-nosed sampling tap(test port) located at a point downstream of the chlorinator. Also, the discharge piping shall be provided with a means of pumping to waste. Suggested locations for these features are shown on the revised chlorinator schematic included.

Also, please specify the pitless unit to be used and provide cut sheets or specifications so that compliance with venting, measuring access port, and other requirements can be verified.

RLE/bb/01290.ltr

Enclosure: Suggested revised chlorinator schematic

Exhibit 7
 Connection Detail

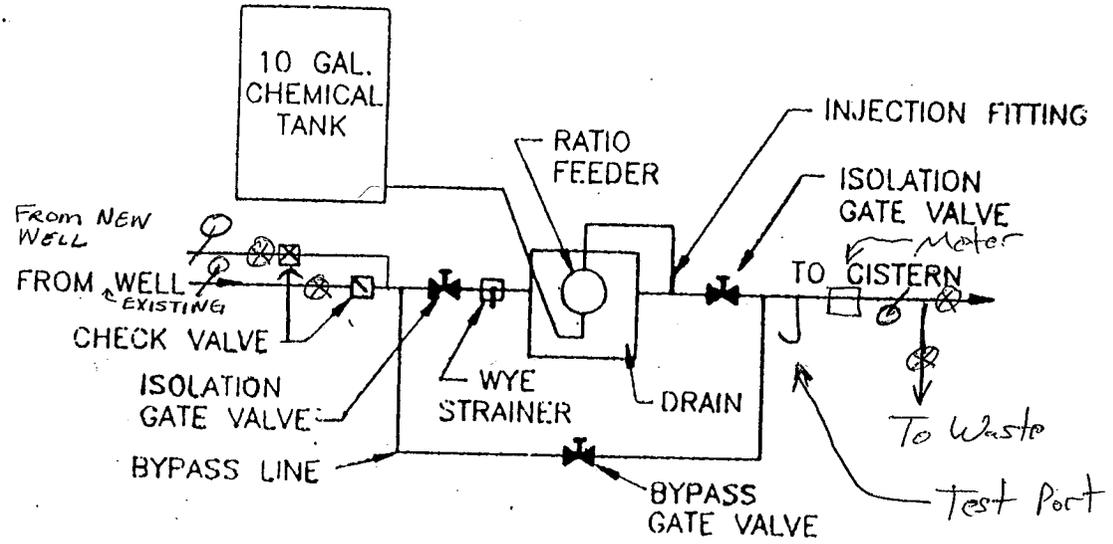

Suggested

CHLORINATOR SYSTEM SCHEMATIC

NO SCALE

⊗ = shutoff valves
 ⊕ = pressure gauges

DEQ Permit No. 93-436, Mod. To 93-164
 Prepared by Jack Noblitt & Associates
 Date: 11/29/93
 Scale 1"=60'

PERMIT TO CONSTRUCT

X New
→ Renewal
Modified

PERMIT NO. 00-110
SPECIAL CONDITIONS
REF/PERMIT NO. 93-164 & 93-436

Terry Bison Ranch - New 3rd Well
PWS #WY5601267

This permit hereby authorizes the applicant:

Terry Bison Ranch
Attn. Daniel R. Thiel, Vice President
51 I-25 Service Road East
Cheyenne, Wyoming 82007

to construct, install, and modify a public water supply system by adding a 3rd well, associated appurtenances, and necessary piping changes according to the procedures and conditions of the application number 00-110. The facility is located in the SW 1/4 of Section 16, T12N, R67W in the county of Laramie, in the State of Wyoming. This permit shall be effective for a period of 2 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits, or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District Engineering Supervisor, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4. The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4. The applicant will provide immediate oral and/or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4. Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit or
 - d. Certification the facility was completed with changes or modifications. **Submittal of as-constructed plans and specifications** for the system as it was constructed, certified by an engineer if appropriate. **All modifications or deviations from the authorized plans must be highlighted.**
- 4 of 4. The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:

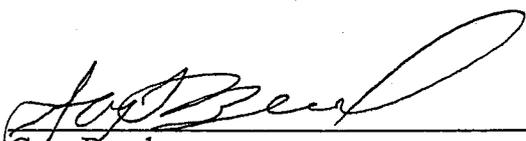

Gary Beach
Administrator
Water Quality Division

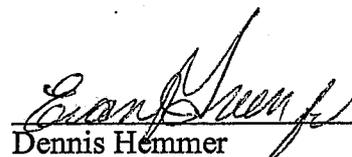

Dennis Hemmer
Director
Department of Environmental Quality

8-10-2000
Date of Issuance

RLE/bb/02057.ltr

STATEMENT OF BASIS

I. General information.

A. Permit Number: 00-110 Reference 93-164 & 93-436

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter 11. No

B. Chapter 12. Yes

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

NOT Applicable

B. Briefly state the basis for the deviation.

NOT Applicable

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

NOT Applicable

- V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹. (Indicate either applicable or not applicable. If not applicable delete all of section VI. from the Statement of Basis.)

NOT Applicable

VI. Deleted

VII. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Ronald L. Ewald, Senior Analyst, and completed on August 10, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

RLE/bb/02057.ltr

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

PERMIT TO CONSTRUCT

X New
Renewal
Modified

PERMIT NO. 00-111
SPECIAL CONDITIONS

Yellowstone Regional Airport Treated Waterline Replacement
PWS #WY5600207

This permit hereby authorizes the applicant:

City of Cody
Attn: Steve Payne
P.O. Drawer 2200
Cody, WY 82414

to replace approximately 1,356 feet of an existing 4-inch diameter water main with an 8-inch diameter water main, including four isolation valves and four new fire hydrants according to the procedures and conditions of application number 00-111. The facility is located in NE1/4 Section 5 (Orig. Survey), T52N, R101W in the county of Park, in the State of Wyoming. This permit shall be effective for a period of two (2) years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance, or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming 82520; (307) 332-3144; FAX (307) 332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner

and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.


The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:


- 1 of 4 The applicant will notify the NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; (307)332-3144; FAX (307)332-3183; in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.

— of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:

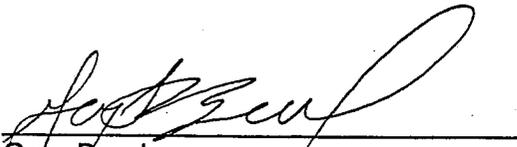

Gary Beach
Administrator
Water Quality Division

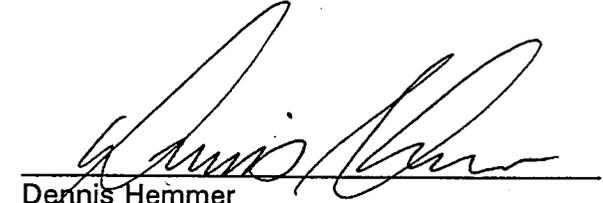

Dennis Hemmer
Director
Department of Environmental Quality

4-26-2000

Date of Issuance

DHC/mad 00977.ltr

STATEMENT OF BASIS

I. General information.

Permit Number: 00-111

II. Application reviewed for compliance with the following regulations.

A. Chapter XI. No

B. Chapter XII. Yes

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations.

Not Applicable

V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III¹.

Not Applicable

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

VI. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Doyle Conklin, SW District Engineering Supervisor, and completed on April 18, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO. 00-112R
SPECIAL CONDITIONS

Love Ridge Lodge Homes
PWS #WY 5600213

This permit hereby authorizes the applicant:

Love Ridge Development, LLC
P.O. Box 1846
Jackson, WY 83001

to construct sanitary sewer and man holes, and extend Jackson water mains to serve the development according to the procedures and conditions of application number 00-112R. The facility is located in NW 1/4 Sec.34, T41N, R116W in the county of Teton, in the State of Wyoming. This permit shall be effective for a period of two (2) years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance, or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Jeff Hermansky, Northwest District Supervising Engineer, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming 82520; (307) 332-3144; FAX (307) 332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and this permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify Jeff Hermansky, Northwest District Supervising Engineer, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to Jeff Hermansky, Northwest District Supervising Engineer, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; (307)332-3144; FAX (307)332-3183; in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to Jeff Hermansky, Northwest District Supervising Engineer, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:

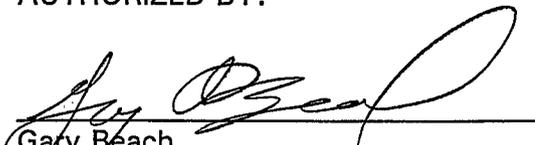

Gary Beach
Administrator
Water Quality Division

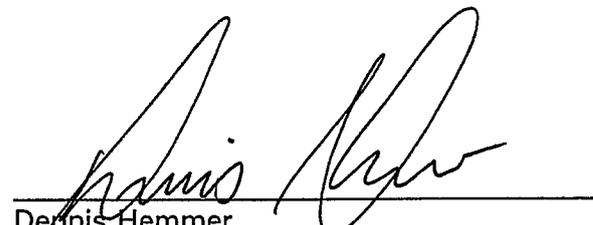

Dennis Hemmer
Director
Department of Environmental Quality

7-6-00

Date of Issuance

STATEMENT OF BASIS

I. General information.

Permit Number: 00-112R

II. Application reviewed for compliance with the following regulations.

A. Chapter 11. Yes

B. Chapter 12. Yes

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section 2.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. N/A

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹.

N/A

VI. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Jeff Hermansky, Northwest District Supervising Engineer, and completed on June 23, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

JCH/bb/01625.ltr

PERMIT TO CONSTRUCT

X New
— Renewal

PERMIT NO. 00-113
SPECIAL CONDITIONS

Basin Wigwam Theater Fire Line
PWS: 5600004

This permit hereby authorizes the applicant:

Town of Basin
P.O. Box 599
Basin WY 82410

to construct, install or modify a 4" fire line with double check backflow preventer to the theater building according to the procedures and conditions of the application number 00-113. The facility is located in SW 1/4 NE 1/4 Section 21 T51N R93W in the county of Big Horn, in the State of Wyoming. This permit shall be effective for a period of two years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming. The phone number is 307-332-3144, the FAX number is 307-332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the DEQ/WQD Northwest District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral or written notice to the DEQ/WQD Northwest District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Northwest District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

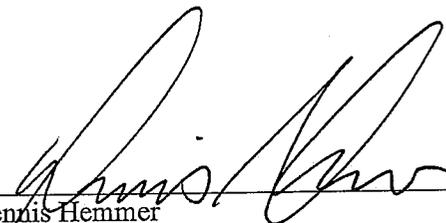

Dennis Hemmer
Director
Department of Environmental Quality

5-12-00

Date of Issuance

LBH/mad 001130.ltr

cc: Jeff Hermansky

STATEMENT OF BASIS

- I. Permit Number: 00-113
- II. Application reviewed for compliance with the following regulations.
- A. Chapter XI. NO
- B. Chapter XII. YES
- III. Basis for issuing permit: Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- IV. Application requires review to determine groundwater impacts in accordance with Sec. 17, Chapter 3.
- NO
- V. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on May 9, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

PERMIT TO CONSTRUCT

New
 Renewal

PERMIT NO.00-114
SPECIAL CONDITIONS

Basin NOWCAP Fireline
PWS: 5600004

This permit hereby authorizes the applicant:

NOWCAP
P.O. Drawer 158
Worland WY 82401

to construct, install or modify a 4" fire line with double check backflow preventer to the NOWCAP building according to the procedures and conditions of the application number 00-114. The facility is located in SW 1/4 Section 16 T51N R93W in the county of Big Horn, in the State of Wyoming. This permit shall be effective for a period of two years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming. The phone number is 307-332-3144, the FAX number is 307-332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the DEQ/WQD Northwest District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral or written notice to the DEQ/WQD Northwest District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Northwest District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

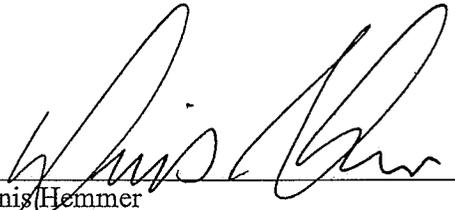

Dennis Hemmer
Director
Department of Environmental Quality

5-12-00

Date of Issuance

LBH/mad 001131.ltr

cc: Jeff Hermansky

STATEMENT OF BASIS

- I. Permit Number: 00-114
- II. Application reviewed for compliance with the following regulations.
- A. Chapter XI. NO
- B. Chapter XII. YES
- III. Basis for issuing permit: Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- IV. Application requires review to determine groundwater impacts in accordance with Sec. 17, Chapter 3.
- NO
- V. Documentation of Statement of Basis.
- The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on May 9, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO. 00-115
SPECIAL CONDITIONS

JAKEWAY RESIDENTIAL SEPTIC SYSTEM

This permit hereby authorizes the applicant:

William and Jackie Jakeway
340 Nogales Lane
Gillette, WY 82716

to construct, install or modify a septic system according to the procedures and conditions of the application number 00-115. The facility is located in the SW/4 of Section 5 of T50N R66W in the county of Crook, in the State of Wyoming. This permit shall be effective for a period of one (1) year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (DEQ/WQD), upon the presentation of credentials and during working hours, to have access to inspect the facilities, at the above location, for the purpose of compliance with the provisions of this construction permit.

The permittee shall notify representatives from the DEQ/WQD the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Northeast District Office, DEQ/WQD, 1043 Coffeen Avenue, Suite D, Sheridan, Wyoming 82801; telephone (307) 672-6457; FAX (307) 674-6050.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Northeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:

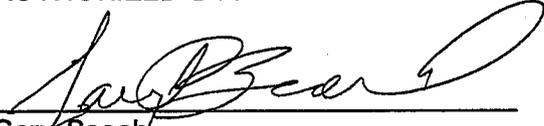

Gary Beach
Administrator
Water Quality Division

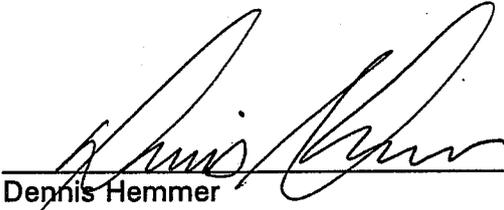

Dennis Hemmer
Director
Department of Environmental Quality

4-26-2000
Date of Issuance

DRM/dm:04/24/00
b/001035.ltr

Enclosures: Notification Post Card
Certificate of Completion
Statement of Basis

xc: Town of Pine Haven

STATEMENT OF BASIS

- I. General information.
- A. Permit Number: 00-115
- II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)
- A. Chapter XI. Yes
- B. Chapter XII. No
- III. Basis for issuing permit. (Indicate yes or no for each section.)
- A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- Yes
- B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.
- No
- C. Permit based on deviation from applicable regulations in accordance with approved policy statement.
- No
- IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)
- A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.
- Not Applicable (N/A)
- B. Briefly state the basis for the deviation.
- N/A
- C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).
- N/A

V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III¹. (Indicate either applicable or not applicable. If not applicable delete all of Section VI. from the Statement of Basis.)

N/A

VI. N/A

VII. Documentation of Statement of Basis.

A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Donald R. McKenzie, NE Water & Wastewater Section Program Principal, and completed on April 24, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

DRM/bb/001035.ltr

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO. 00-116R
SPECIAL CONDITIONS

Thermopolis Wastewater Treatment Plant Chlorination System

PWS# 5600056

This permit hereby authorizes the applicant:

Town of Thermopolis
P.O. Box 603
Thermopolis, WY 82443

to install a sodium hypochlorite tank and pump injection system according to the procedures and conditions of application number 00-116R. The facility is located in SE¼ Section 36, T43N, R95W in the county of Hot Springs, in the State of Wyoming. This permit shall be effective for a period of 1 year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance, or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Jeff Hermansky, Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming 82520; (307) 332-3144; FAX (307) 332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and this permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; (307)332-3144; FAX (307)332-3183; in accordance with the provisions of Section 11, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division



Dennis Hemmer
Director
Department of Environmental Quality

5-5-00

Date of Issuance

STATEMENT OF BASIS

General information.

Permit Number: 00-116R

II. Application reviewed for compliance with the following regulations.

A. Chapter XI. Yes

B. Chapter XII. No

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations.

N/A

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter III¹.

N/A

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

VI. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Jeff Hermansky, Norwest District Engineering Supervisor, and completed on May 3, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO. 00-118
SPECIAL CONDITIONS

CLAUSEN RESIDENTIAL SEPTIC SYSTEM

This permit hereby authorizes the applicant:

Tom Clausen
P.O. Box 1404
Sundance, WY 82720

to construct, install or modify a septic system according to the procedures and conditions of the application number 00-118. The facility is located in the SE/4 of the NW/4 of Section 14 of T51N R63W in the county of Crook, in the State of Wyoming. This permit shall be effective for a period of one (1) year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (DEQ/WQD), upon the presentation of credentials and during working hours, to have access to inspect the facilities, at the above location, for the purpose of compliance with the provisions of this construction permit.

The permittee shall notify representatives from the DEQ/WQD the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Northeast District Office, DEQ/WQD, 1043 Coffeen Avenue, Suite D, Sheridan, Wyoming 82801; telephone (307) 672-6457; FAX (307) 674-6050.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Northeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".


AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division



Date of Issuance

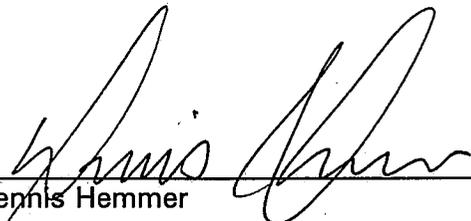

Dennis Hemmer
Director
Department of Environmental Quality

DRM/dm:04/18/00

b/00966.ltr

Enclosures: Notification Post Card
Certificate of Completion
Statement of Basis

STATEMENT OF BASIS

- I. General information.
- A. Permit Number: 00-118
- II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)
- A. Chapter XI. Yes
- B. Chapter XII. No
- III. Basis for issuing permit. (Indicate yes or no for each section.)
- A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- Yes
- B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.
- No
- C. Permit based on deviation from applicable regulations in accordance with approved policy statement.
- No
- IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)
- A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.
- Not Applicable (N/A)
- B. Briefly state the basis for the deviation.
- N/A
- C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).
- N/A

- V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III¹. (Indicate either applicable or not applicable. If not applicable delete all of Section VI. from the Statement of Basis.)

N/A

- VI. N/A

- VII. Documentation of Statement of Basis.

- A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Donald R. McKenzie, NE Water & Wastewater Section Program Principal, and completed on April 18, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

DRM/bb/00966.ltr

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

PERMIT TO CONSTRUCT

X New
— Renewal
Modified

PERMIT NO. 00-119
SPECIAL CONDITIONS

BAR NUNN SANITARY SEWER EXTENSION

This permit hereby authorizes the applicant:

Town of Bar Nunn
4820 N. Wardwell industrial
Bar Nunn, Wyoming 82601

to construct, install or modify a wastewater collection system according to the procedures and conditions of the application number 00-119. The facility is located in SE/4 NE/4, NE/4 NW/4 NE/SW/4, and NW/4 SE/4 of Section 17, Township 34 North, Range 79 West, in the county of Natrona, in the State of Wyoming. This permit shall be effective for a period of five years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (DEQ/WQD), upon the presentation of credentials and during working hours, to have access to inspect the facilities, at the above location, for the purpose of compliance with the provisions of this construction permit.

The permittee shall notify representatives from the DEQ/WQD the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: DEQ/WQD, Casper WDEQ Field Office, 3030 Energy Lane, Suite 200, Casper, WY 82604, telephone (307) 473-3452; FAX (307) 473-3458.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents a permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Casper Field Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Casper Field Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach, Administrator
Water Quality Division

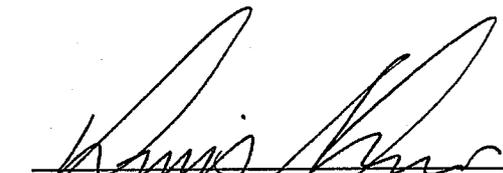

Dennis Hemmer, Director
Department of Environmental Quality

5-22-00

Date of Issuance

JDL: 5/3/00

b/01248.ltr

Enclosures: Notification Post Card, Certificate of Completion, Statement of Basis

STATEMENT OF BASIS

General information.

A. Permit Number: 00-119

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter XI. Yes

B. Chapter XII. Yes

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

Not Applicable (N/A)

B. Briefly state the basis for the deviation.

N/A

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

N/A

V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III¹. (Indicate either applicable or not applicable. If not applicable delete all of Section VI. from the Statement of Basis.)

N/A

VI. N/A

VII. Documentation of Statement of Basis.

A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Dennis Lamb, Northeast District DEQ/WQD-SPO Senior Analyst, and completed on May 3, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

JDL/bb/01248.ltr

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

PERMIT TO CONSTRUCT

X New
— Renewal
Modified

PERMIT NO. 00-120
SPECIAL CONDITIONS

NEW HAVEN BUNKHOUSE RESIDENTIAL SEPTIC SYSTEM

This permit hereby authorizes the applicant:

Nick Bohl
1823 Little Missouri Road
Hulett, WY 82720

to construct, install or modify a septic system according to the procedures and conditions of the application numbers 00-120. The facility is located in the SW/4 SW4 of Section 13 of T55N R67W in the county of Crook, in the State of Wyoming. This permit shall be effective for a period of one (1) year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (DEQ/WQD), upon the presentation of credentials and during working hours, to have access to inspect the facilities, at the above location, for the purpose of compliance with the provisions of this construction permit.

The permittee shall notify representatives from the DEQ/WQD the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: DEQ/WQD; Casper WDEQ Field Office, 3030 Energy Lane, Suite 200, Casper, WY 82604, telephone (307) 473-3452; FAX (307) 473-3458.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and the permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Casper Field Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 11, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Casper Field Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:

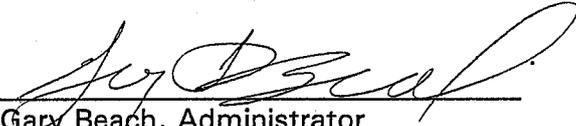

Gary Beach, Administrator
Water Quality Division

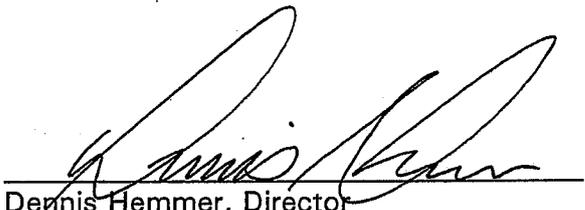

Dennis Hemmer, Director
Department of Environmental Quality

5-5-00

Date of Issuance

JDL/mad 00100.ltr

Enclosures: Notification Post Card
Certificate of Completion
Statement of Basis

STATEMENT OF BASIS

I. General information.

A. Permit Number: 00-120

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter XI. Yes

B. Chapter XII. No

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

Not Applicable (N/A)

B. Briefly state the basis for the deviation.

N/A

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

N/A

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter III¹. (Indicate either applicable or not applicable. If not applicable delete all of Section VI. from the Statement of Basis.)

N/A

VI. N/A

VII. Documentation of Statement of Basis.

A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Dennis Lamb, Northeast District DEQ/WQD-SPO Senior Analyst, and completed on May 2, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO. 00-121
SPECIAL CONDITIONS

PANNELL RANCH RESIDENTIAL SEPTIC SYSTEM

This permit hereby authorizes the applicant:

William Pannell
Box 92
Alva, WY 82711

to construct, install or modify a septic system according to the procedures and conditions of the application numbers 00-121. The facility is located in the NE/4 SE/4 of Section 30 of T56N R63W in the county of Crook, in the State of Wyoming. This permit shall be effective for a period of one (1) year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (DEQ/WQD), upon the presentation of credentials and during working hours, to have access to inspect the facilities, at the above location, for the purpose of compliance with the provisions of this construction permit.

The permittee shall notify representatives from the DEQ/WQD the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: DEQ/WQD, Casper WDEQ Field Office, 3030 Energy Lane, Suite 200, Casper, WY 82604, telephone (307) 473-3452; FAX (307) 473-3458.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Casper Field Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Casper Field Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach, Administrator
Water Quality Division
5-1-00

Date of Issuance



Dennis Hemmer, Director
Department of Environmental Quality

JDL/mad 001059.ltr

Enclosures: Notification Post Card
Certificate of Completion
Statement of Basis

STATEMENT OF BASIS

- I. General information.
- A. Permit Number: 00-121
- II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)
- A. Chapter XI. Yes
- B. Chapter XII. No
- III. Basis for issuing permit. (Indicate yes or no for each section.)
- A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- Yes
- B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.
- No
- C. Permit based on deviation from applicable regulations in accordance with approved policy statement.
- No
- IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)
- A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.
- Not Applicable (N/A)
- B. Briefly state the basis for the deviation.
- N/A
- C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).
- N/A

V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III¹. (Indicate either applicable or not applicable. If not applicable delete all of Section VI. from the Statement of Basis.)

N/A

VI. N/A

VII. Documentation of Statement of Basis.

A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Dennis Lamb, Northeast District DEQ/WQD-SPO Senior Analyst, and completed on April 26, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

PERMIT TO CONSTRUCT

New
Renewal
Modified

PERMIT NO. 00-122
SPECIAL CONDITIONS

Burlington Northern Santa Fe Railway, Mile Post 128, Cheyenne, WY

This permit hereby authorizes the applicant:

Burlington Northern Santa Fe Railway Company
8200 E. Park Meadows Parkway, Suite 8201
Lonetree, CO, 80124

to construct, install or modify a monitoring well according to the procedures and conditions of the application number 00-122. The facility is located in Cheyenne in the county of Laramie, in the State of Wyoming. This permit shall be effective for a period of 2 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Daniel Moore, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

1. No monitoring well/piezometer shall be abandoned without prior approval from the Water Quality Division. After the monitoring well(s)/piezometer(s) have fulfilled their purpose, they shall be abandoned according to procedures specified in Chapter XI, Part G, Section 70 of Wyoming Water Quality Rules and Regulations. In addition, borings in public use areas, particularly paved streets and alleys, shall be abandoned in accordance with City and/or Highway Department requirements.
2. WDEQ/WQD personnel shall be given at least two (2) weeks notice prior to the installation of monitor well(s)/piezometer(s) and sample collection so that they may be on site if deemed necessary.
3. The applicant is responsible for obtaining any Permits required by the State Engineer's Office (777-7354).
4. The results of any other analyses conducted on soil or water removed from these wells/piezometers or boreholes shall be provided to the department as soon as they are available.
5. ***Environmental Monitoring Program for Groundwater of the State:***
 - a. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity and performed in accordance with WDEQ or EPA approved Standard Procedures or Quality Assurance/Quality Control (QA/QC) Plan.
 - b. The permittee shall maintain records of all monitoring information for a period of at least 3 years.
 - c. Records of monitoring information shall include:
 - i. The date, exact place, and time of sampling or measurements;
 - ii. The name(s) of individual(s) who performed the sampling or measurements;
 - iii. The Mean Sea Level elevation of the water table to the closest .01 ft., and the depth to water (to the closest .01 ft.) from a marked measuring point at the top of casing.
 - iv. Sampling procedures and sample preservation accomplished;
 - v. The date(s) analyses were performed;


- vi. Names of individuals who performed the analyses;
- vii. The analytical techniques or methods used; and
- viii. The results of such analyses.
- ix. Monitor wells shall be sampled and the groundwater analyzed as indicated on the following table:

WELL NAME OR NUMBER	SAMPLING FREQUENCY	ANALYTICAL METHOD(S)	PARAMETER(S) ANALYZED	PERMIT LIMIT *
Monitoring Well	one time	EPA 8021B EPA 8015B EPA 9060	BTEX TEPH/DRO TOC	

* Permit Limits (i.e. Groundwater Protection Standards) are only required for compliance monitoring wells. All chemical concentrations in this permit are expressed in mg/l unless otherwise noted.

AUTHORIZED BY:


 Gary Beach
 Administrator
 Water Quality Division

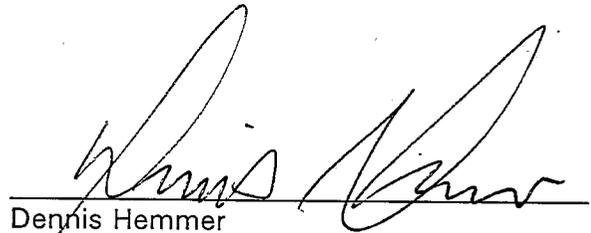
 Dennis Hemmer
 Director
 Department of Environmental Quality

5-15-2000
 Date of Issuance

DM/bb/001176.ltr



The State
of Wyoming



Department of Environmental Quality

Jim Geringer, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH 307-777-7758 FAX 777-3610	ABANDONED MINES 307-777-6145 FAX 777-6462	AIR QUALITY 307-777-7391 FAX 777-5616	INDUSTRIAL SITING 307-777-7369 FAX 777-6937	LAND QUALITY 307-777-7756 FAX 777-5864	SOLID & HAZ. WASTE 307-777-7752 FAX 777-5973	WATER QUALITY 307-777-7781 FAX 777-5973
--	---	---	---	--	--	---

May 11, 2000

Mr. David M. Smith
Manager Environmental Remediation
The Burlington Northern and Santa Fe Railway Company
8200 E. Park Meadows Drive
Lone Tree, CO 80124

Re: Permit to Construct #00-122 for a Supplemental Subsurface Investigation at Derailment Site near Cheyenne, Wyoming (Milepost 128.0).

Dear Mr. Smith:

The Wyoming Water Quality Division (WQD) has reviewed the permit application materials consisting of the document *Workplan for Supplemental Subsurface Investigation at Derailment Site near Cheyenne, Wyoming (Milepost 128.0)*, submitted April 20, 2000, and has issued the attached permit. The WQD must be contacted prior to making any substantive changes to the investigation plan presented in the application materials. If you have any questions concerning this letter, please call me at (307) 777-7092.

Sincerely,

Daniel Moore
Program Principal
Water Quality Division

DM/bb/001175.ltr

Attachment

cc: Mr. Daniel Gregory, ENSR
Mr. Kevin Frederick, WQD

PERMIT TO CONSTRUCT

New
 Renewal

PERMIT NO. 00-123
SPECIAL CONDITIONS

Saratoga - Walnut Avenue Waterline Extension
PWS: 5600061

This permit hereby authorizes the applicant:

Custom Builders
P.O. Box 708
Saratoga WY 82331

to construct, install or modify a six inch diameter waterline extension of 80 ft and a new fire hydrant according to the procedures and conditions of the application number 00-123. The facility is located in NE 1/4 Section 14 T17N R84W in the county of Carbon, in the State of Wyoming. This permit shall be effective for a period of two years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

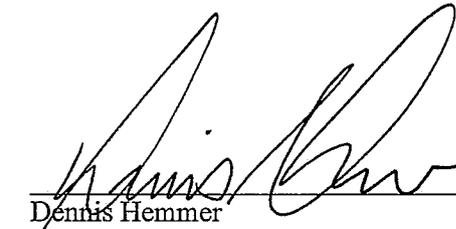

Dennis Hemmer
Director
Department of Environmental Quality

5-18-00

Date of Issuance

LBH/mad 001134.ltr

cc: Saratoga Water Department

STATEMENT OF BASIS

Permit Number: 00-123

II. Application reviewed for compliance with the following regulations.

A. Chapter XI. NO

B. Chapter XII. YES

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

NO

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

NO

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

NO

IV. Facilities not specifically covered by regulations

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

Chapter 12, Section 14(b)(ii) restricts dead-end mains serving fire hydrants to less than 250 ft of length.

B. Briefly state the basis for the deviation.

This project is an extension of an existing 6" diameter waterline. Adequate pressure exists to maintain a minimum line pressure of 30 psi at fire flow. Provisions are being made to loop the line at a later date.

V. Application requires review to determine groundwater impacts in accordance with Sec. 17, Chapter 3.

NO

Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on May 9, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

PERMIT TO CONSTRUCT

✓ New
— Renewal

PERMIT NO. 00-124
SPECIAL CONDITIONS

UMC-West Sewer Extensions in 23rd and 24th Streets

This permit hereby authorizes the applicant:

Cheyenne Board of Public Utilities
P.O. Box 1469
Cheyenne WY 82003-1469

to construct, install or modify a 12" diameter sewer line extension in 24th Street and an 8" diameter sewer line extension in 23rd Street according to the procedures and conditions of the application number 00-124. The facility is located in NE 1/4 Section 31 T14N R66W in the county of Laramie, in the State of Wyoming. This permit shall be effective for a period of two years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division



Dennis Hemmer
Director
Department of Environmental Quality

5-12-00

Date of Issuance

LBH/bb/001144.ltr

STATEMENT OF BASIS

- I. Permit Number: 00-124
- II. Application reviewed for compliance with the following regulations.
- A. Chapter XI. YES
- B. Chapter XII. NO
- III. Basis for issuing permit: Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- IV. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3.
- NO
- V. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on May 9, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

LBH/bb/001144.ltr

PERMIT TO CONSTRUCT

✓ New
— Renewal
Modified

PERMIT NO. 00-125RR
SPECIAL CONDITIONS
REF/PERMIT #97-275RR

R & G, Inc. Evaporation Pond

This permit hereby authorizes the applicant:

R & G, Inc.
P.O. Box 173
Evanston, WY 82931-0173

to construct two evaporative pond cells (as an addition to facilities constructed under Permit to Construct No. 97-275RR) according to the procedures and conditions of application number 00-125RR. The facility is located in SE1/4 Section 19, T22N, R111W in the county of Sweetwater, in the State of Wyoming. This permit shall be effective for a period of three (3) years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance, or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: SW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming 82520; (307) 332-3144; FAX (307) 332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 9 The applicant will notify the SW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 9 The applicant will provide immediate oral and/or written notice to the SW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; (307)332-3144; FAX (307)332-3183; in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 9 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the SW District, State of Wyoming; DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 9 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".
- 5 of 9 Measurement of depth to groundwater and testing of groundwater in the proposed new monitoring well is to be performed to establish initial conditions prior to filling of this pond.
- 6 of 9 The leak detection access pipes are to be checked weekly for the first month and monthly thereafter with a log kept of the inspection results. If fluid is found the DEQ/WQD SW District is to be notified immediately, and samples are to be pulled from the inspection pipes and tested for total petroleum hydrocarbons (TPH) by EPA method 8015 (modified for gasoline and diesel range hydrocarbons), chlorides, total dissolved solids (TDS), and sulfates. Results are to be reported as soon as they are available. Testing requirements are subject to revision as needed.

If fluids are detected in the leak detection system and there is a threat of contamination to groundwater, the groundwater monitoring wells may be required to be sampled and tested.

— Fluids in the pond are to be checked annually for hazardous constituents by collecting a composite sample representative of the stored fluids and testing for the metals, volatiles, and semivolatiles from the EPA/RCRA TCLP constituents list.

- 7 of 9 If fluid is found in the leak detection system, and a leak is verified by sampling and testing, the fluid recirculating system shall be activated to control the fluid level under the pond liner and minimize the chance for migration of the fluid to groundwater until repairs and/or corrective action can be taken.
- 8 Of 9 The pond is permitted to receive oilfield produced water and drilling fluid classified as exploration and production exempt from RCRA regulations by the EPA. Any other waste must be approved on a case by case basis by the DEQ/WQD and the owner.
- 9 of 9 The validity of this permit is subject to the owner maintaining a bond acceptable to the State of Wyoming DEQ/WQD for the amount of the pond closure and post-closure costs. This bonding amount is initially set at \$170,322.65 and is subject to review on an annual basis. The pond closure shall be in compliance with the submitted plan and Chapter 14 of the Wyoming DEQ/WQD Water Quality Rules and Regulations.

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division



Dennis Hemmer
Director
Department of Environmental Quality

6-21-2000
Date of Issuance

STATEMENT OF BASIS

I. General information.

Permit Number: 00-125RR

II. Application reviewed for compliance with the following regulations.

A. Chapter 11. Yes

B. Chapter 12. No

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section 2.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations.

Not Applicable

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹.

Applicable

VI. If Section 17 of Chapter 3 is applicable, indicate the basis of determining groundwater will be protected. (Fill out only the applicable sections and indicate sections that are not applicable.)

A. Facility will not allow a discharge to groundwater. Briefly describe:

Ponds are to be lined with 60 mil HDPE liner with a leak detection system. If a leak is detected, there is a recirculation system to return leaking fluids to the pond, thus reducing the hydrostatic head

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

beneath the liner, and minimizing migration of the fluids to groundwater. There are also three existing monitoring wells and one additional proposed monitoring well that can be checked to monitor groundwater impacts. Testing of groundwater in the proposed monitoring well is to be performed to establish initial conditions prior to filling of these ponds.

- B. Quality of wastewater is such that it will not cause a violation of groundwater standards. Briefly describe:

Not Applicable

- C. Existing soils or geology will not allow a discharge to groundwater. Briefly describe:

Not Applicable

- D. Basis of facility design is that it will be operated so as not to violate groundwater standards (example: maintenance of manure pack at animal waste treatment facility). Briefly describe:

Not Applicable

- E. Discharge will result in groundwater concentrations in excess of standards but post discharge water quality can be returned to standards in accordance with Section 4 (d)(vi), Chapter 8. Briefly describe:

Not Applicable

- F. If water quality exceedances are allowed, briefly describe the parameter limits, property boundaries, places of withdrawal and any other information documenting that any users of affected aquifer will not be impacted.

Not Applicable

- G. Briefly describe monitoring system (parameters, frequency, etc.). Clearly state the parameters to be utilized for determining compliance, what constitutes a violation and steps to be followed by the permittee in the event of a violation.

The leak detection access pipes are to be checked weekly for the first month the ponds are used and monthly thereafter, with a log kept of the inspection results. If fluid is found, the DEQ/WQD Southwest District is to be notified immediately, and samples are to be pulled from the inspection pipes and tested for total petroleum hydrocarbons (TPH) by EPA method 8015 (modified for gasoline and diesel range hydrocarbons), chlorides, total dissolved solids (TDS) and sulfates. Results are to be reported as soon as they are available.

If fluid is found in the leak detection system and a leak is verified by sampling and testing, the fluid recirculating system is to be activated to control the fluid level under the pond liner and minimize the chance for migration of the fluid to groundwater.

If fluids are detected in the leak detection system and there is a threat of contamination to groundwater, the groundwater monitoring wells may be required to be sampled and tested.

Fluids in the pond are to be checked annually for hazardous constituents by collecting a composite sample representative of the stored fluids and testing for the metals, volatiles, and semivolatiles from the EPA/RCRA TCLP constituents list.

VII. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Doyle Conklin, SW District Engineering Supervisor, and completed on June 9, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

PERMIT TO CONSTRUCT

— New
— Renewal
X Modified

PERMIT NO. 00-126R
SPECIAL CONDITIONS
REF/PERMIT NO. 96-270

Wyoming Premium Farms Nursery No. 1

This permit hereby authorizes the applicant:

Wyoming Premium Farms
P.O. Box 457
Wheatland WY 82201

to utilize an additional area of 800 acres for land application of liquid wastes generated by WPF Nursery No. 1 according to the procedures and conditions of the application number 00-126. The additional land applications areas are the W ½ Section 16, E ½ Section 17, and the NW ¼ Section 21 T23N R66 W of the 6th P.M. in the county of Platte, in the State of Wyoming. This permit shall be effective for a period of five years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.


The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:


- 1 of 11 All land application of liquid wastes shall be accomplished in accordance with conditions of Water Quality Division Permit 96-270 and the approved Operation and Maintenance Manual for Wyoming Premium Farms Nursery No. 1, as amended by the conditions of this permit.
- 2 of 11 The areas where land application will be allowed shall be as shown on Map 2.1 of the Wyoming Premium Farms Response to Comments, dated October 2000.
- 3 of 11 Eighty acre management parcels will be identified by Wyoming Premium Farms and delineated on a map submitted with each annual report. A reference parcel of at least 40 acres adjacent to the land application area shall be selected and tested annually for comparison purposes. The reference parcel shall not receive any animal waste applications.
- 4 of 11 One soil test shall be taken from each parcel before land application of liquid wastes. A post application soil test shall be taken the following April-June after land application of liquid wastes.
- 5 of 11 A soil test shall consist of two samples tested individually. Each sample shall be a composite from four locations within the management parcel. One sample shall be from the 0" to 12" depth and one sample from the 12" to 24" depth.
- 6 of 11 Standard soil tests shall be taken, including analysis for phosphorus and Nitrate as N reported as parts per million and as pounds per acre for the horizon represented by the sample.
- 7 of 11 Use pan tests under the traveling sprinkler to verify amount applied, total nitrogen applied, and to take samples for a fecal coliform test. At least one composite test using three pans shall be taken each week of application operations.
- 8 of 11 The nutrients supplied by a land application plus the residual nutrients in the soil shall not exceed the agronomic requirements of the crop to be seeded or the agronomics requirements of the vegetation on grazing land. If agronomic rates are exceeded no additional applications may be made to that 80 acre parcel until the situation is remedied.
- 9 of 11 The liquid applied by an application of animal wastes shall not exceed the retention capacity of the upper 12 inches of the soil less the pre-existing moisture content of the soil. The liquid application rates shall be adjusted as necessary for the most restrictive soil type within a management parcel.
- 10 of 11 The amount of phosphorus present in the upper 12 inches of soil shall be monitored. If the phosphorus loading exceeds 300 pounds per acre, additional soil testing shall be undertaken to evaluate the potential for deleterious salt and alkali accumulations.
- 10 of 11 If phosphorus loading exceeds 300 pounds per acre or deleterious amounts of salt accumulate, land application to that 80 acre management parcel shall stop until the parameter of concern is remedied.

11 of 11 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

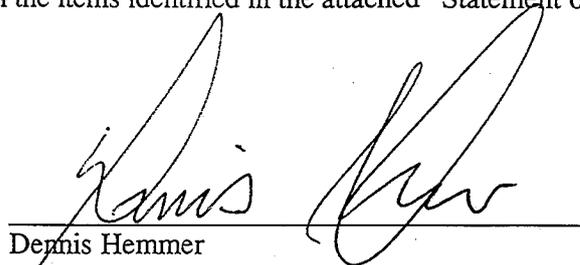

Dennis Hemmer
Director
Department of Environmental Quality

12-4-00

Date of Issuance

LBH/bb/03029.ltr

cc: Platte County Commissioners

Powder River Basin Resource Council
23 North Scott
Sheridan WY 82633

MS Christine Lichtenfels
Wyoming Outdoor Council
262 Lincoln
Lander WY 82520

Mr. and Mrs. Richard Johnson
251 East Johnson Road
Wheatland WY 82201

STATEMENT OF BASIS

Permit Number: 00-126

II. Application reviewed for compliance with the following regulations.

A. Chapter XI. YES

B. Chapter XII. NO

III. Basis for issuing permit: Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Please see attached Response to Public Comments Received, dated 29 November 2000. Supporting information has been provided by Wyoming Premium Farms in the "Wyoming Premium Farms Response to Comments, Rimcon and AVI P.C., October 2000".

IV. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3.

YES

V. If Section 17 of Chapter 3 is applicable, indicate the basis of determining groundwater will be protected.

The facility will not allow a discharge to groundwater:

The land application of liquid wastes at agronomic rates prevents a discharge of dissolved constituents to the ground water.

VI. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on December 1, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO. 00-127
SPECIAL CONDITIONS

Guernsey - Haynes/River Street Sewer Improvements

This permit hereby authorizes the applicant:

Town of Guernsey
P.O. Box 667
Guernsey WY 82214

to construct, install or modify an installation of 7 manholes and replacement of 746 feet of 8" diameter sewer line according to the procedures and conditions of the application number 00-127. The facility is located in SW 1/4 Section 35 T27N R66W in the county of Platte, in the State of Wyoming. This permit shall be effective for a period of five years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 5 The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 5 The applicant will provide immediate oral or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 5 In accordance with Water Quality Division Policies 13.9.7 and 13.9.11, water and sewer main crossings may have only six inches of separation if proper precautions are taken. There shall be no joints in the new pipe within 9 feet of the crossing and the crossing shall be encased in flowable fill from below the lower pipe to two inches above the upper pipe. This method of crossing along with adjustment of grade of the sewer line to grades of .002 ft/ft if necessary is preferred to the vertical displacement detail shown on Drawing No. 2.
- 4 of 5 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 5 of 5 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

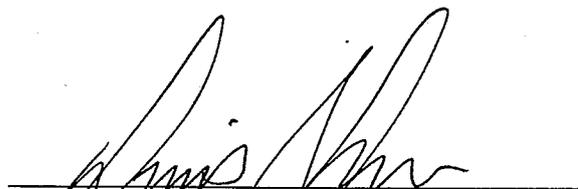

Dennis Hemmer
Director
Department of Environmental Quality

4-26-2000
Date of Issuance

STATEMENT OF BASIS

- I. Permit Number: 00-127
- II. Application reviewed for compliance with the following regulations.
- A. Chapter XI. YES
- B. Chapter XII. NO
- III. Basis for issuing permit: Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- IV. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III.
- NO
- V. Documentation of Statement of Basis.
- The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on April 24, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

LBH/bb/001042.ltr

REVIEW OF PLANS AND SPECIFICATIONS
WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION

Herschler Bldg., 4 West
Cheyenne, Wyoming 82002

PROJECT: WYDOT Arlington Maintenance Facility - Wastewater Systems

ENGINEER: Steve Linse
Western water Consultants, Inc.
611 Skyline Road
Laramie, Wyoming 82070
Ph: (307) 742-0031

APPLICANT: Wyoming Department of Transportation
P.O. Box 1005
Laramie, Wyoming 82073

WATER QUALITY DIVISION REFERENCE NUMBER: 00-128

REVIEWING ENGINEER: Ronald L. Ewald *RLE*
Phone: (307) 777-6183

DATE OF REVIEW: June 1, 2000

ACTION: NOT AUTHORIZED FOR CONSTRUCTION. In accordance with Section 9(a)(ii), Chapter 3, Wyoming Water Quality Rules and Regulations, the application is denied because it is incomplete or does not meet applicable minimum design and construction standards. Please address the comments outlined below and submit the requested information in order that the application process may be completed in accordance with Section 9. If the applicant fails to provide the requested information within six months the incomplete application shall be returned.

COMMENTS, INADEQUACIES, AND QUESTIONS:

There are two separate systems included in this project which require permitting:

- A. Replacement wastewater septic system, and
- B. New truck wash runoff non-discharging evaporative lagoon.

After reviewing the addendum comments to the Engineering Design Report dated May 25, 2000, the following questions and concerns remain:

A. Replacement wastewater septic system.

1. Percolation tests - At exactly what depth were the native soil perk tests performed, and what were the perk rates? Please submit the actual perk test data.
2. High Groundwater Determination - The observation pits were apparently about 8.5 feet deep. From the cross section view of the trenches the trenches are approximately 7 to 8 feet deep. The seasonally high groundwater determination needs to be done to a depth of at least 4 feet below the planned depth of the trenches.
3. Leachfield Design - After reviewing Chapter 7 of the EPA Design Manual for Onsite wastewater Treatment and Disposal Systems it is apparent that in fast percolating soils (< 5 mpi) where amended soil is added that the amended soil needs to be placed in a continuous layer across the entire leachfield area, not just in the bottoms of the trenches (see top of page 215). If you need to use the imported and placed amended soil, it will have to be a continuous layer. In this case, it may be easier to construct a leachfield bed instead of individual trenches. In a bed layout, each "Infiltrator" unit is equivalent to 35.4 square feet instead of 40.0 in a trench configuration. Also, recently we have gotten reports that when Infiltrator units are not placed directly on undisturbed soil they sometimes can be "pushed" into the soft soil they are sitting on thereby eliminating their storage capacity which can lead to system failure. At the depths you are proposing, this could be even more of a potential problem. Therefore, if you do use "Infiltrator" chambers, you should be sure that the amended fill material used has adequate soil bearing capacity to prevent the load bearing edges of the chamber units from penetrating into the fill.

B. New truck wash runoff non-discharging evaporative lagoon.

1. Cell Design Volume - The 500 gallon annual precipitation contribution implied on Page 6 of the original Design Report was merely an error. The correct amount of annual precipitation contribution (35,225 gals) was included in the calculations and the lagoon cell is large enough to store the effluent through the winter and then evaporate the liquids during the summer months. EVERYTHING is OK!

PERMIT TO CONSTRUCT

— New
— Renewal
· Modified

PERMIT NO. 00-128
SPECIAL CONDITIONS

Wyoming DOT Arlington Maintenance Facility - Two Wastewater Systems

This permit hereby authorizes the applicant:

Wyoming Department of Transportation
P.O. Box 1005
Laramie, Wyoming 82073

to construct and install a replacement septic system with a chamber type leachfield bed & a new truck wash runoff non-discharging lined evaporative lagoon according to the procedures and conditions of the application number 00-128. The facility is located in the SW 1/4 of Section 19, T19N, R78W in the county of Carbon, in the State of Wyoming. This permit shall be effective for a period of 2 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits, or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District Engineering Supervisor, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 5. The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 5. The applicant will provide immediate oral and/or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 5. Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. **Submittal of as-constructed plans and specifications** for the system as it was constructed, certified by an engineer if appropriate. **All modifications or deviations from the authorized plans must be highlighted.**
- 4 of 5. Septic Tank Riser Requirements - Either a 6 inch diameter clean-out riser or the manway shall be extended to the ground surface from each compartment of both septic tanks.
- 5 of 5. The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

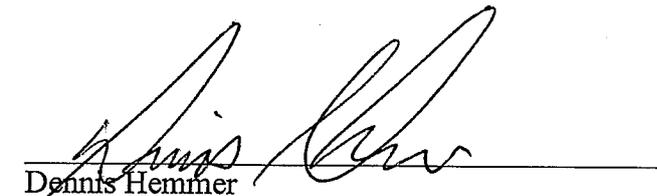

Dennis Hemmer
Director
Department of Environmental Quality

7-10-00

Date of Issuance

RLE/mad/01740.ltr

cc: Carbon County Planner/Sanitarian

STATEMENT OF BASIS

- I. General information.
- A. Permit Number: 00-128
- II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)
- A. Chapter 11. Yes
- B. Chapter 12. No
- III. Basis for issuing permit. (Indicate yes or no for each section.)
- A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
Yes
- B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.
No
- C. Permit based on deviation from applicable regulations in accordance with approved policy statement.
No
- IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)
- A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.
NOT Applicable
- B. Briefly state the basis for the deviation.
NOT Applicable
- C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).
NOT Applicable

- V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹. (Indicate either applicable or not applicable. If not applicable delete all of section VI. from the Statement of Basis.)

NOT Applicable

VI. Deleted

VII. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Ronald L. Ewald, Senior Analyst, and completed on July 7, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

PERMIT TO CONSTRUCT

X New
— Renewal
Modified

PERMIT NO. 00-129
SPECIAL CONDITIONS

DEVILS TOWER NATIONAL MONUMENT MONITOR WELLS

This permit hereby authorizes the applicant:

Devils Tower National Monument
Bldg 170, Highway 110
Devils Tower, WY 82714
Attention: Todd Sues

to construct, install or modify a monitor well system according to the procedures and conditions of the application numbers 00-129. The facility is located in the NW/4 of Section 18 of T53N R65W in the county of Crook, in the State of Wyoming. This permit shall be effective for a period of one (1) year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Northeast District, State of Wyoming, DEQ, Water Quality Division, 1043 Coffeen Avenue, Suite D, Sheridan, Wyoming 82801; telephone (307) 672-6457; FAX (307) 674-6050.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the appropriate district office of the Water Quality Division, Department of Environmental Quality, by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 11, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.


Permit Number 00-129

___ of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

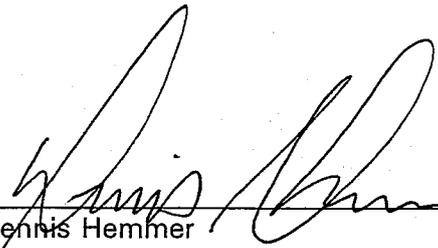

Dennis Hemmer
Director
Department of Environmental Quality

5-5-00
Date of Issuance

DRM:dm 05/01/00

Enclosures: Construction Notice Post Card, Certificate of Completion and Statement of Basis
cc: Kim Schaner, Roybal Corp., 7600 E. Eastman Av., Ste. 102, Denver, CO 80231

STATEMENT OF BASIS

General information.

A. Permit Number: 00-129

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter 11 Yes

B. Chapter 12 No

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes. The basis of the proposed workplan is to investigate the impact of fuel contamination on soil and/or groundwater from a former heating oil tank. The workplan addresses the pertinent criteria contained in the GPC Section's Guideline #2 for minimum content requirements of sub-surface investigation workplans. The only exception to the guideline is the addition of representative PAH testing when groundwater is encountered in the monitor wells. This additional requirement was added at the request of GPC.

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

Not Applicable (N/A)

B. Briefly state the basis for the deviation.

N/A

- C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

N/A

- V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter III¹. (Indicate either applicable or not applicable. If not applicable delete all of section VI. from the Statement of Basis.)

N/A

- VI. If Section 17 of Chapter III is applicable, indicate the basis of determining groundwater will be protected. (Fill out only the applicable sections and indicate sections that are not applicable.)

- A. Facility will not allow a discharge to groundwater. Briefly describe:

N/A

- B. Quality of wastewater is such that it will not cause a violation of groundwater standards. Briefly describe:

N/A

- C. Existing soils or geology will not allow a discharge to groundwater. Briefly describe:

N/A

- D. Basis of facility design is that it will be operated so as not to violate groundwater standards (example: maintenance of manure pack at animal waste treatment facility). Briefly describe:

N/A

- E. Discharge will result in groundwater concentrations in excess of standards but post discharge water quality can be returned to standards in accordance with Section 4 (d)(vi), Chapter VIII. Briefly describe:

N/A

- F. If water quality exceedances are allowed, briefly describe the parameter limits, property boundaries, places of withdrawal and any other information documenting that any users of affected aquifer will not be impacted.

N/A

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

- G. Briefly describe monitoring system (parameters, frequency, etc.). Clearly state the parameters to be utilized for determining compliance, what constitutes a violation and steps to be followed by the permittee in the event of a violation.

N/A

VII. Documentation of Statement of Basis.

- A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Don McKenzie, NE Water & Wastewater Section Program Principal, and completed on May 1, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

PERMIT TO CONSTRUCT

X New
— Renewal
Modified

PERMIT NO. 00-130
SPECIAL CONDITIONS

PFEIFER RESIDENTIAL SEPTIC SYSTEM

This permit hereby authorizes the applicant:

William & Jeanette Pfeifer
P. O. Box 363
Hulett, WY 82720

to construct, install or modify a septic system according to the procedures and conditions of the application number 00-130. The facility is located in the NE/4 of Section 26 of T55N R66W in the county of Crook, in the State of Wyoming. This permit shall be effective for a period of one (1) year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (DEQ/WQD), upon the presentation of credentials and during working hours, to have access to inspect the facilities, at the above location, for the purpose of compliance with the provisions of this construction permit.

The permittee shall notify representatives from the DEQ/WQD the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Northeast District Office, DEQ/WQD, 1043 Coffeen Avenue, Suite D, Sheridan, Wyoming 82801; telephone (307) 672-6457; FAX (307) 674-6050.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Northeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 11, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".


AUTHORIZED BY:



Administrator, Gary Beach
Water Quality Division

5-22-2000

Date of Issuance

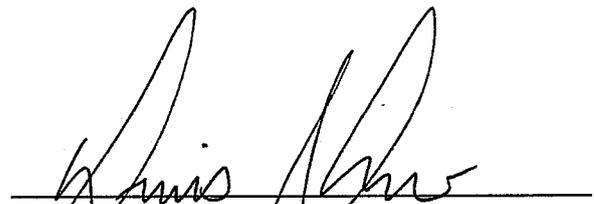

Director, Dennis Hemmer
Department of Environmental Quality

DRM/pr:05/04/00

b/01250.ltr

Enclosures: Notification Post Card
Certificate of Completion
Statement of Basis

STATEMENT OF BASIS

- I. General information.
- A. Permit Number: 00-130
- II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)
- A. Chapter XI. Yes
- B. Chapter XII. No
- III. Basis for issuing permit. (Indicate yes or no for each section.)
- A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- No
- B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.
- Yes. A sand filter system is proposed for this difficult site, which includes high bedrock conditions and isolation problems. The Natrona County Health Department Rules and Regulations are being used in the design of the sand filter system.
- C. Permit based on deviation from applicable regulations in accordance with approved policy statement.
- No
- IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)
- A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.
1. Depth to bedrock from the bottom of the leachfield and the ground surface is to be four feet. Section 36 of Chapter 11 of the WWQRR.
2. Minimum isolation distances between the septic system components and intermittent drainages and water wells shall be 50-100 feet. Table 2 of Section 35 of Chapter 11 of the WWQRR.
- B. Briefly state the basis for the deviation.
1. Although the first foot of soil below the ground surface percs at 1-5 m/i, a clay interval of 2' thickness followed by a rock shelf has created a situation where once the top soil is saturated by the treated wastewater from the septic tank, the fluid then surfaces and/or seeps to two nearby

intermittent drainages. A sand filter will allow the septic tank wastewater to be treated and then pumped to one or more shallow (about 10") drip-like drainfield trenches for effluent disposal through tree, bush and/or grass uptake.

2. The water well had been previously contaminated and its surface seal re-established by the applicant and an RO unit installed with success, although the RO performance should be checked periodically. There is very little to be done economically with the distances between the septic tank and the sand filter to the drainages. The sand filter unit will be contained and any failure easily noted. The same rationale applies to the septic tank as well. The location of the treated wastewater drainfields will be positioned away from the drainages and alternated to keep any surfacing or seepage to a minimum by rotation and vegetation uptake. The effluent quality is expected to be high so minimal health and environmental concerns are anticipated even in the event of drainfield failure.

- C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

N/A

- V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter III¹. (Indicate either applicable or not applicable. If not applicable delete all of Section VI. from the Statement of Basis.)

N/A

- VI. N/A

- VII. Documentation of Statement of Basis.

- A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Donald R. McKenzie, NE Water & Wastewater Section Program Principal, and completed on May 18, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

DRM/bb/01250.ltr

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO. 00-131
SPECIAL CONDITIONS

Sparks Septic Tank/Leach Field

This permit hereby authorizes the applicant:

Wayne Sparks
1476 HWY 30
Basin, WY 82410

to construct a septic tank/leach field to serve a three bedroom residence according to the procedures and conditions of application number 00-131. The facility is located in SE1/4 Sec. 2, T51N, R96W in the county of Big Horn, in the State of Wyoming. This permit shall be effective for a period of two (2) years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance, or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Jeff Hermansky, Northwest District Supervisor State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming 82520; (307) 332-3144; FAX (307) 332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Northwest District Supervisor, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northwest District Supervisor, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; (307)332-3144; FAX (307)332-3183; in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northwest District Supervisor, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

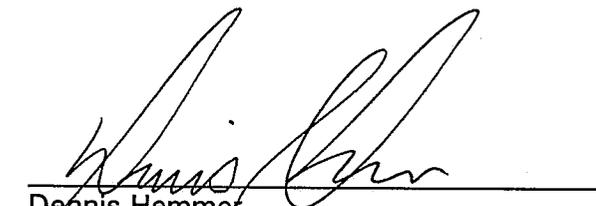

Dennis Hemmer
Director
Department of Environmental Quality

5-2-2000

Date of Issuance

STATEMENT OF BASIS

I. General information.

Permit Number: 00-131

II. Application reviewed for compliance with the following regulations.

A. Chapter XI. Yes

B. Chapter XII. No

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations.

N/A

V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III.

N/A

VI. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Jeff Hermansky, Northwest District Supervisor, and completed on April 26, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

JCH/bb/001050.ltr

PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO. 00-132
SPECIAL CONDITIONS

JOE PRICE RESIDENTIAL SEPTIC SYSTEM

This permit hereby authorizes the applicant:

Joe Price
PO Box 984
Sundance, WY 82729

to construct, install or modify a septic system according to the procedures and conditions of the application numbers 00-132. The facility is located in the NE/4 NE/4 of Section 10 of T51N R63W in the county of Crook, in the State of Wyoming. This permit shall be effective for a period of one (1) year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (DEQ/WQD), upon the presentation of credentials and during working hours, to have access to inspect the facilities, at the above location, for the purpose of compliance with the provisions of this construction permit.

The permittee shall notify representatives from the DEQ/WQD the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: DEQ/WQD, Casper WDEQ Field Office, 3030 Energy Lane, Suite 200, Casper, WY 82604, telephone (307) 473-3452; FAX (307) 473-3458.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Casper Field Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Casper Field Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:

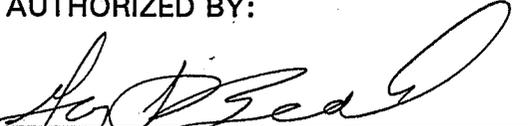

Gary Beach, Administrator
Water Quality Division

5-1-00

Date of Issuance



Dennis Hemmer, Director
Department of Environmental Quality

JDL/mad 001058.ltr

Enclosures: Notification Post Card
Certificate of Completion
Statement of Basis

STATEMENT OF BASIS

I. General information.

A. Permit Number: 00-132

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter XI. Yes

B. Chapter XII. No

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

Not Applicable (N/A)

B. Briefly state the basis for the deviation.

N/A

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

N/A

- V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III¹. (Indicate either applicable or not applicable. If not applicable delete all of Section VI. from the Statement of Basis.)

N/A

- VI. N/A

- VII. Documentation of Statement of Basis.

- A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Dennis Lamb, Northeast District DEQ/WQD-SPO Senior Analyst, and completed on April 26, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO. 00-133
SPECIAL CONDITIONS

CLINTON STREETER RESIDENTIAL SEPTIC SYSTEM

This permit hereby authorizes the applicant:

Clinton R. Streeter
PO Box 1257
Sundance, WY 82729

to construct, install or modify a septic system according to the procedures and conditions of the application numbers 00-133. The facility is located in the N/2 NW/4 & SE/4 NW4 of Section 20 of T50N R62W in the county of Crook, in the State of Wyoming. This permit shall be effective for a period of one (1) year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (DEQ/WQD), upon the presentation of credentials and during working hours, to have access to inspect the facilities, at the above location, for the purpose of compliance with the provisions of this construction permit.

The permittee shall notify representatives from the DEQ/WQD the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: DEQ/WQD, Casper WDEQ Field Office, 3030 Energy Lane, Suite 200, Casper, WY 82604, telephone (307) 473-3452; FAX (307) 473-3458.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Casper Field Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Casper Field Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".


AUTHORIZED BY:

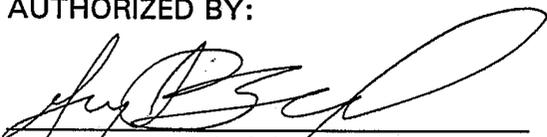

Gary Beach, Administrator
Water Quality Division

5-1-00

Date of Issuance

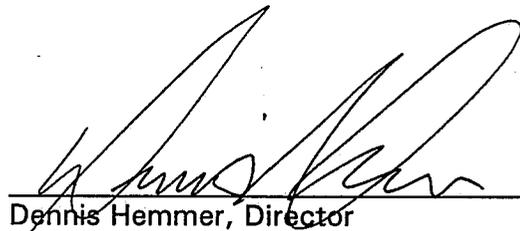

Dennis Hemmer, Director
Department of Environmental Quality

JDL/mad 001065.ltr

Enclosures: Notification Post Card
Certificate of Completion
Statement of Basis

STATEMENT OF BASIS

- I. General information.
- A. Permit Number: 00-133
- II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)
- A. Chapter XI. Yes
- B. Chapter XII. No
- III. Basis for issuing permit. (Indicate yes or no for each section.)
- A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- Yes
- B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.
- No
- C. Permit based on deviation from applicable regulations in accordance with approved policy statement.
- No
- IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)
- A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.
- Not Applicable (N/A)
- B. Briefly state the basis for the deviation.
- N/A
- C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).
- N/A

- V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III¹. (Indicate either applicable or not applicable. If not applicable delete all of Section VI. from the Statement of Basis.)

N/A

- VI. N/A

- VII. Documentation of Statement of Basis.

- A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Dennis Lamb, Northeast District DEQ/WQD-SPO Senior Analyst, and completed on April 27, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

AS-BUILT
PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO. 00-134R
SPECIAL CONDITIONS
REF/PERMIT #00-327R

B & K Shoreline Stop
No PWS # (this is a new system)

This permit hereby authorizes the applicant:

Bruce and Karen Davison
14 Bass Lake Rd
Shoshoni, WY 82649

to have constructed a water distribution system for a 32 space RV park which includes a water well, according to the procedures and conditions of application number 00-134R. The facility is located in Section 19, T3N, R9W in the county of Fremont, in the State of Wyoming.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, meets applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee has constructed and shall operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

1 of 1 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

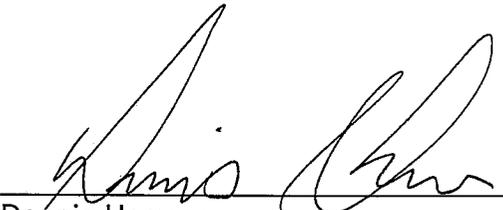

Dennis Hemmer
Director
Department of Environmental Quality

1-3-2001

Date of Issuance

MDB/mdb
b/03199.ltr

STATEMENT OF BASIS

 General information.

Permit Number: 00-134R

II. Application reviewed for compliance with the following regulations.

A. Chapter XI. Yes

B. Chapter XII. Yes

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations.

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

N/A

B. Briefly state the basis for the deviation.

N/A

C. Permit based on general or statewide deviation contained in approved policy statement.

N/A

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter III¹.

N/A

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

- VI. If Section 15 of Chapter III is applicable, indicate the basis of determining groundwater will be protected. (Fill out only the applicable sections and indicate sections that are not applicable.)

N/A

- VII. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Mark Baron, Environmental Senior Analyst, and completed on December 29, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

MDB/bb/01399.ltr



The State
of Wyoming



Department of Environmental Quality

Jim Geringer, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307) 777-7758 FAX 777-3610	ABANDONED MINES (307) 777-6145 FAX 777-6462	AIR QUALITY (307) 777-7391 FAX 777-5616	INDUSTRIAL SITING (307) 777-7369 FAX 777-6937	LAND QUALITY (307) 777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307) 777-7752 FAX 777-5973	WATER QUALITY (307) 777-7781 FAX 777-5973
---	--	--	--	---	---	--

January 2, 2001

Karen Davison
14 Bass Lake Rd.
Shoshoni, WY 82649


RE: As-Built Permit To Construct, B & K Shoreline Stop, WQD Reference Number 00-134
No PWS # (this is a new system)

Dear Ms Davison:

The Department of Environmental Quality/Water Quality Division (DEQ/WQD) has reviewed the above referenced Built Application submitted by your engineer, Terry Zenk. Our review of the information and as-constructed plans submitted to this office indicates that the application meets DEQ/WQD regulations and the enclosed As-Built Permit To Construct is hereby issued. The enclosed permit covers, a water distribution system for a 32 space RV park which includes a water well, which has already been constructed.

Please be advised that the system must be constructed, installed, and operated in accordance with the statements, representations and procedures presented in the application and all supporting documentation as well as the terms and conditions of the permit. You are urged to be familiar with all aspects of the permit application, permit, and permit conditions. Any person objecting to a permit issued by the DEQ and desiring affirmative relief may request a hearing before the Environmental Quality Council in accordance with the Rules of Practice and Procedure for the Department of Environmental Quality and the Wyoming Administrative Procedures Act.

Sincerely,

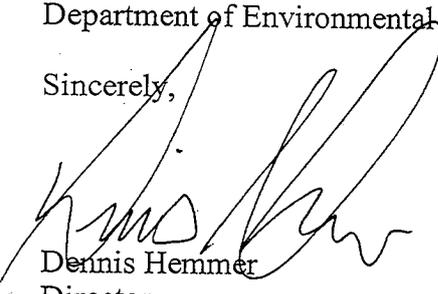
Dennis Hemmer
Director
Department of Environmental Quality

DH/mdb/bb/03199.ltr
Enclosure



The State
of Wyoming



Department of Environmental Quality

Jim Geringer, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307) 777-7758 FAX 777-3610	ABANDONED MINES (307) 777-6145 FAX 777-6462	AIR QUALITY (307) 777-7391 FAX 777-5616	INDUSTRIAL SITING (307) 777-7369 FAX 777-6937	LAND QUALITY (307) 777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307) 777-7752 FAX 777-5973	WATER QUALITY (307) 777-7781 FAX 777-5973
---	--	--	--	---	---	--

August 28, 2000

William Heiss, Mgr.
Espero, LLC
P.O. Box 2944
Casper, Wyoming 82602

RE: Withdrawal of Permit Application Number: 00-135

Dear Mr. Heiss:

At your request, your application for a septic system number 00-135, is being returned without having been permitted.

This project has not been permitted. Construction of this facility without a permit is a violation of the Environmental Quality Act and is punishable with fines not to exceed \$10,000 per day of violation. If you wish to reconsider construction of this facility, then application procedures pursuant to Chapter 3, of the Wyoming Water Quality Rules and Regulations must be followed.

Sincerely,

Ronald L. Ewald
Senior Analyst
SE District, Water Quality Division

RLE/bb/02204.ltr

Enclosure

cc: IPS

MEMO

To: Permit Application File #00-135
From: Ron Ewald RE
Date: August 28, 2000
Subject: **Withdraw Application #00-135**

The applicant, William Heiss, called today to say that they had made arrangements to hook onto the city sewer system. Therefore, they will not need the septic system and would like to withdraw the application.

REVIEW OF PLANS AND SPECIFICATIONS
WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION

Herschler Bldg., 4 West
Cheyenne, Wyoming 82002

PROJECT: 511 Dickenson Avenue Encampment, Wyoming - Septic System

ENGINEER: None

APPLICANT: William Heiss, Mgr. Espero, LLC
P.O. Box 2944
Casper, Wyoming 82602
Ph: (307) 237-9322

WATER QUALITY DIVISION REFERENCE NUMBER: 00-135

REVIEWING ENGINEER: Ronald L. Ewald *RLE*
Phone: (307) 777-6183

DATE OF REVIEW: May 10, 2000

ACTION: NOT AUTHORIZED FOR CONSTRUCTION. In accordance with Section 9(a)(ii), Chapter 3, Wyoming Water Quality Rules and Regulations, the application is denied because it is incomplete or does not meet applicable minimum design and construction standards. Please address the comments outlined below and submit the requested information in order that the application process may be completed in accordance with Section 9. If the applicant fails to provide the requested information within six months the incomplete application shall be returned.

COMMENTS, INADEQUACIES, AND QUESTIONS:

1. CANNOT Install a Septic System Within the City Limits of Encampment Without City Approval - The Town of Encampment has a city ordinance prohibiting septic systems within the incorporated boundaries unless the town grants approval for an exception. Have you informed the Town of your plans, and have they granted approval for your septic system? Before the State can issue a permit for a septic system within the city limits you must submit a copy of the approval letter from the Town.
2. Application Form Incomplete - The facility location, (i.e., 1/4 section, Section, Township, and Range are not provided).

3. Ownership Question - You identify yourself as the Manager of Espero, LLC. Is this to be your private residence, or are you acting as a representative of Espero LLC for someone else? Please clarify the ownership of this property.
4. Percolation Test Data Incomplete and Incorrect - The entire percolation (perk) test data must be submitted for review, not just the final drop data. Also, the final drop data and perk rate do not compute. You must rerun the perk test properly and record and submit all of the data. A more detailed perk test and instructions are included with this review. Be sure to pre-soak the test holes for at least 4 hours or overnight.
5. Cross Section Drawing of the Leach Field - You need to submit a cross section drawing of your leach bed or trenches showing the depths and spacings of the components.
6. Recalculate the Leach Field Area - After redoing the perk test, you will have to recalculate the minimum leach field area. Also, if you intend to use "Infiltrator" chambers in a bed arrangement each unit is equivalent to 35.4 square feet. See attachment.
7. Seasonal High Groundwater Level - Your application says you dug to 14 feet with a backhoe. On what date did you dig this hole? And, even if the hole was dry, did you look for or observe any signs of soil mottling or discoloration that would indicate what the seasonal high groundwater level is?
8. Nearby Water Features - How far away is the nearest stream or river or even neighbor's well?
9. Leach Field Layout - How is your leach field laid out? Two rows of 10 units each, or 3 rows of 7 units each? Your leach field dimensions of 15 ft by 54 ft don't work out either way.
10. Equal Effluent Distribution - How do you plan to get equal flow distribution of the septic tank effluent to each row of "Infiltrator" chambers? Are you going to use a distribution box, or simply split the flow using tees?

RLE/bb/001145.ltr

Enclosures: New blank application package
Percolation Test Package
Equivalent Chamber Sizing Table

PERMIT TO CONSTRUCT

New
 Renewal
 Modified

PERMIT NO. 00-136
SPECIAL CONDITIONS

WATER SYSTEM IMPROVEMENTS- TOWN OF PINE HAVEN PWS # WY5600191C

This permit hereby authorizes the applicant:

Town of Pine Haven
24 Waters Drive
Pine Haven, WY 82721-9761

to construct, install or modify a water distribution system according to the procedures and conditions of the application numbers 00-136. The facility is located in the NW/4 of Section 5 of T50N R66W in the county of Crook, in the State of Wyoming. This permit shall be effective for a period of one (1) year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Northeast District, State of Wyoming, DEQ, Water Quality Division, 1043 Coffeen Avenue, Suite D, Sheridan, Wyoming 82801; telephone (307) 672-6457; FAX (307) 674-6050.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the appropriate district office of the Water Quality Division, Department of Environmental Quality, by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:

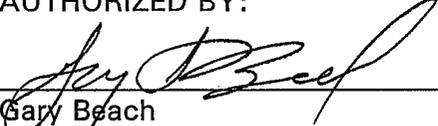

Gary Beach
Administrator
Water Quality Division

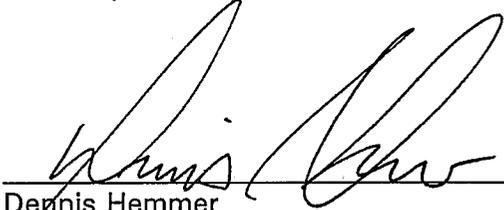

Dennis Hemmer
Director
Department of Environmental Quality

6-1-00
Date of Issuance

DRM/mad/01354.ltr

Enclosures: Construction Notice Post Card, Certificate of Completion and Statement of Basis

xc: Ralph Goodson, Bearlodge, POB 130, Sundance, 82729

STATEMENT OF BASIS

General information.

A. Permit Number: 00-136

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter 11 No

B. Chapter 12 Yes

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

Not Applicable (N/A)

B. Briefly state the basis for the deviation.

N/A

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

N/A

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹. (Indicate either applicable or not applicable. If not applicable delete all of section VI. from the Statement of Basis.)

N/A

VI. If Section 17 of Chapter 3 is applicable, indicate the basis of determining groundwater will be protected. (Fill out only the applicable sections and indicate sections that are not applicable.)

A. Facility will not allow a discharge to groundwater. Briefly describe:

N/A

B. Quality of wastewater is such that it will not cause a violation of groundwater standards. Briefly describe:

N/A

C. Existing soils or geology will not allow a discharge to groundwater. Briefly describe:

N/A

D. Basis of facility design is that it will be operated so as not to violate groundwater standards (example: maintenance of manure pack at animal waste treatment facility). Briefly describe:

N/A

E. Discharge will result in groundwater concentrations in excess of standards but post discharge water quality can be returned to standards in accordance with Section 4 (d)(vi), Chapter 8. Briefly describe:

N/A

F. If water quality exceedances are allowed, briefly describe the parameter limits, property boundaries, places of withdrawal and any other information documenting that any users of affected aquifer will not be impacted.

N/A

G. Briefly describe monitoring system (parameters, frequency, etc.). Clearly state the parameters to be utilized for determining compliance, what constitutes a violation and steps to be followed by the permittee in the event of a violation.

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

N/A

VI. Documentation of Statement of Basis.

- A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Don McKenzie, NE Water & Wastewater Section Program Principal, and completed on May 30, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

51933.DOC

PERMIT TO CONSTRUCT

✓ New
— Renewal
Modified

PERMIT NO. 00-137
SPECIAL CONDITIONS

Loaf 'N Jug/mini mart - Cheyenne
PWS #WY5600011

This permit hereby authorizes the applicant:

Cheyenne Board of Public Utilities
P.O. Box 1469
Cheyenne, Wyoming 82003

to construct, install, and modify water distribution utilities by adding a fire hydrant and a service connection with backflow prevention and sewer collection utilities by adding a service connection according to the procedures and conditions of the application number 00-137. The facility is located in the NE 1/4 of Section 34, T14N, R66W in the county of Laramie, in the State of Wyoming. This permit shall be effective for a period of 2 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits, or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District Engineering Supervisor, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.


The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:


- 1 of 5. The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 5. The applicant will provide immediate oral and/or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 5. Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit, or
 - d. Certification the facility was completed with changes or modifications. **Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.**
- 4 of 5. **Backflow Prevention** - The details of backflow prevention were not specifically discussed in the design submittal. Therefore, **all non-residential commercial services, building fire protection services, and irrigation system connections** shall have backflow prevention as recommended by AWWA Standard M14 and in accordance with the DEQ/WQD Rules and Regulations **Chapter 12, Section 14(i)**, and the **Cheyenne Board of Public Utilities "Rules & Regulations For Cross Connection & Backflow Prevention"**. Additionally, all backflow prevention devices shall be approved by the **University of Southern California - Foundation for Cross Connection Control (USC-FCCC)**.

5 of 5. The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

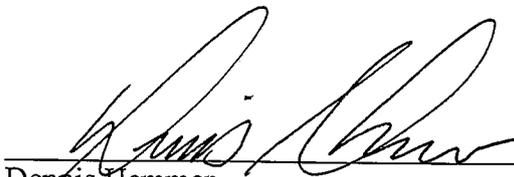

Dennis Hemmer
Director
Department of Environmental Quality

5/12/2000

Date of Issuance

RLE/bb/001161.ltr

STATEMENT OF BASIS

I. General information:

A. Permit Number: 00-137

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter 11. Yes

B. Chapter 12. Yes

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

NOT Applicable

B. Briefly state the basis for the deviation.

NOT Applicable

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

NOT Applicable

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹. (Indicate either applicable or not applicable. If not applicable delete all of section VI. from the Statement of Basis.)

NOT Applicable

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

VI. Deleted

VII. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Ronald L. Ewald, Senior Analyst, and completed on May 10, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

RLE/bb/0061.ltr

PERMIT TO CONSTRUCT

X New
— Renewal
Modified

PERMIT NO. 00-138
SPECIAL CONDITIONS

Mormon Handcart Visitor Center - South Site Unit #3 RV Sites

This permit hereby authorizes the applicant:

Mormon Handcart Visitor Center
47600 West Highway 220
Alcova, Wyoming 82620

to construct and install an RV camp septic system with a chamber type leach field according to the procedures and conditions of the application number 00-138. The facility is located in the NW1/4 SW1/4 of Section 08, T28N, R88W in the county of Carbon, in the State of Wyoming. This permit shall be effective for a period of 2 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits, or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District Engineering Supervisor, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4. The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4. The applicant will provide immediate oral and/or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4. Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit, or
 - d. Certification the facility was completed with changes or modifications. **Submittal of as-constructed plans and specifications** for the system as it was constructed, certified by an engineer if appropriate. **All modifications or deviations from the authorized plans must be highlighted.**
- 4 of 4. The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

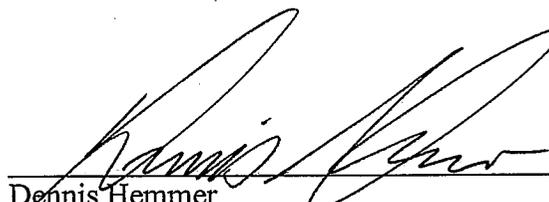

Dennis Hemmer
Director
Department of Environmental Quality

5-12-00

Date of Issuance

RLE/bb/001160.ltr
cc: Carbon County Planner/Sanitarian

STATEMENT OF BASIS

I. General information.

A. Permit Number: 00-138

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter 11. Yes

B. Chapter 12. No

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

NOT Applicable

B. Briefly state the basis for the deviation.

NOT Applicable

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

NOT Applicable

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹. (Indicate either applicable or not applicable. If not applicable delete all of section VI. from the Statement of Basis.)

NOT Applicable

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

VI. Deleted.

VII. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Ronald L. Ewald, Senior Analyst, and completed on May 10, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

RLE/bb/001160.ltr

PERMIT TO CONSTRUCT

✓ New
— Renewal
Modified

PERMIT NO. 00-139
SPECIAL CONDITIONS
REF/PERMIT NO. 78-617, 97-249, 99-115

Flying X Ranch Well No. FX3-99

PWS: 5601104

This permit hereby authorizes the applicant:

Flying X Ranch
799 Halleck Canyon Rd
Wheatland WY 82201

to construct, install or modify a new well according to the procedures and conditions of the application number 00-139. The facility is located in SW 1/4 Section 21 T22N R71W in the county of Albany, in the State of Wyoming. This permit shall be effective for a period of two years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

Issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division



Dennis Hemmer
Director
Department of Environmental Quality

5-18-00

Date of Issuance

LBH/bb/001147.LTR

STATEMENT OF BASIS

- Permit Number: 00-139
- II. Application reviewed for compliance with the following regulations.
- A. Chapter XI. NO
- B. Chapter XII. YES
- III. Basis for issuing permit: Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- IV. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3.
- NO
- V. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on May 10, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

LBH/bb/001147.LTR

PERMIT TO CONSTRUCT

✓ New
— Renewal
Modified

PERMIT NO. 00-140
SPECIAL CONDITIONS

Guldan #1 Residential Septic System

This permit hereby authorizes the applicant:

Michael Guldan
P.O. Box 140653
Edgewater, Colorado 80214

to construct and install a residential septic system with a bed type leach according to the procedures and conditions of the application number 00-140. The facility is located in the SE 1/4 of Section 25, T25N, R68W in the county of Platte, in the State of Wyoming. This permit shall be effective for a period of 2 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits, or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District Engineering Supervisor, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 5. The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 5. The applicant will provide immediate oral and/or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 5. Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit, or
 - d. Certification the facility was completed with changes or modifications. **Submittal of as-constructed plans and specifications** for the system as it was constructed, certified by an engineer if appropriate. **All modifications or deviations** from the authorized plans **must be highlighted**.
- 4 of 5. Septic Tank Riser Requirement - On Vaughn Concrete products septic tanks, either a 6 inch diameter clean-out riser or the manway on each compartment must be extended to the ground surface.
- 5 of 5. The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:

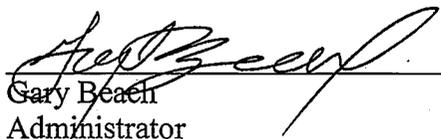

Gary Beach
Administrator
Water Quality Division

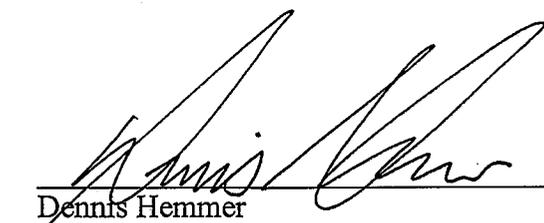

Dennis Hemmer
Director
Department of Environmental Quality

5-12-00

Date of Issuance

RLE/bb/001146.ltr

STATEMENT OF BASIS

I. General information.

A. Permit Number: 00-140

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter 11. Yes

B. Chapter 12. No

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

NOT Applicable

B. Briefly state the basis for the deviation.

NOT Applicable

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

NOT Applicable

- V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹. (Indicate either applicable or not applicable. If not applicable delete all of section VI. from the Statement of Basis.)

NOT Applicable

VI. Deleted

VII. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Ronald L. Ewald, Senior Analyst, and completed on May 10, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

RLE/bb/001146.ltr

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

PERMIT TO CONSTRUCT

X New
— Renewal
Modified

PERMIT NO. 00-141
SPECIAL CONDITIONS

Lot 2 - Rainwater Addition PWS #WY5600042

This permit hereby authorizes the applicant:

William J. Metzler & Jeffrey R. Sheridan
P.O. Box 431
Powell, WY 82435

to construct a water distribution system extension consisting of approximately 243 feet of 8-inch diameter ductile iron pipe, an isolation valve and a fire hydrant according to the procedures and conditions of application number 00-141. The facility is located in Lot 74-G (RS), T55N, R99W in the county of Park, in the State of Wyoming. This permit shall be effective for a period of two (2) years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance, or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming 82520; (307) 332-3144; FAX (307) 332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:


- 1 of 4 The applicant will notify the NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; (307)332-3144; FAX (307)332-3183; in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the NW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.

___ of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

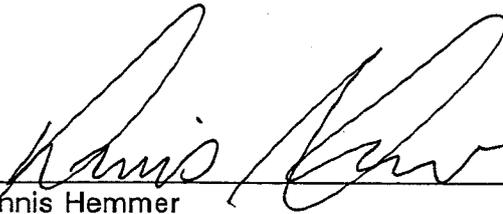

Dennis Hemmer
Director
Department of Environmental Quality

6-26-2000

Date of Issuance

DHC/mad/01588.ltr

cc: City of Powell; Attn: Dick Jones, Water/Wastewater Superintendent; P.O. Box 1008; Powell, WY 82435

STATEMENT OF BASIS

General information.

Permit Number: 00-141

II. Application reviewed for compliance with the following regulations.

A. Chapter 11. No

B. Chapter 12. Yes

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section 2.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations.

Not Applicable

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹.

Not Applicable

VI. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Doyle Conklin, SW District Engineering Supervisor, and completed on June 21, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

PERMIT TO CONSTRUCT

✓ New
— Renewal
Modified

PERMIT NO. 00-142
SPECIAL CONDITIONS

Watson Residential Septic System

This permit hereby authorizes the applicant:

Tom & Cheryl Watson
20 Shadow Lane
Wheatland, Wyoming 82201

to construct and install a residential septic system with a chamber type leach field according to the procedures and conditions of the application number 00-142. The facility is located in the NE 1/4 of Section 05, T23N, R68W in the county of Platte, in the State of Wyoming. This permit shall be effective for a period of 2 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits, or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District Engineering Supervisor, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 5. The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 5. The applicant will provide immediate oral and/or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 5. Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. **Submittal of as-constructed plans and specifications** for the system as it was constructed, certified by an engineer if appropriate. **All modifications or deviations from the authorized plans must be highlighted.**
- 4 of 5. Septic Tank Riser Requirement - On Windmeier Construction septic tanks, either a 6 inch diameter clean-out riser or the manways must be extended to the ground surface.
- 5 of 5. The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

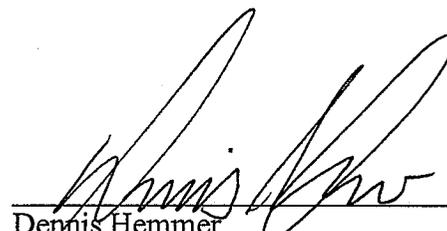

Dennis Hemmer
Director
Department of Environmental Quality

5-12-00

Date of Issuance

STATEMENT OF BASIS

I. General information.

A. Permit Number: 00-142

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter 11. Yes

B. Chapter 12. No

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

NOT Applicable

B. Briefly state the basis for the deviation.

NOT Applicable

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

NOT Applicable

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹. (Indicate either applicable or not applicable. If not applicable delete all of section VI. from the Statement of Basis.)

NOT Applicable

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

VI. Deleted

VII. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Ronald L. Ewald, Senior Analyst, and completed on May 10, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

RLE/bb/001154.ltr

PERMIT TO CONSTRUCT

✓ New
— Renewal
Modified

PERMIT NO. 00-143
SPECIAL CONDITIONS

William Stafford Small Wastewater Treatment Facility

This permit hereby authorizes the applicant:

William J. Stafford
467 S. CS Rd.
Chugwater, Wyoming 82210

to construct and install a residential septic system with a chamber type leach field according to the procedures and conditions of the application number 00-143. The facility is located in the SW 1/4 of Section 29, T20N, R65W in the county of Platte, in the State of Wyoming. This permit shall be effective for a period of 2 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits, or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District Engineering Supervisor, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 5. The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 5. The applicant will provide immediate oral and/or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 5. Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. **Submittal of as-constructed plans and specifications** for the system as it was constructed, certified by an engineer if appropriate. All **modifications or deviations** from the authorized plans **must be highlighted**.
- 4 of 5. Septic Tank Riser Requirement - On Windmeier Construction septic tanks, either a 6 inch diameter clean-out riser or the manways must be extended to the ground surface.
- 5 of 5. The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

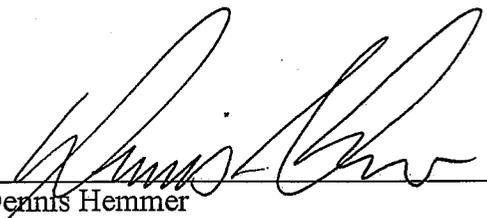

Dennis Hemmer
Director
Department of Environmental Quality

5-12-00

Date of Issuance

STATEMENT OF BASIS

I. General information.

A. Permit Number: 00-143

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter 11. Yes

B. Chapter 12. No

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter 11, or 12.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

NOT Applicable

B. Briefly state the basis for the deviation.

NOT Applicable

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

NOT Applicable

- V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3¹. (Indicate either applicable or not applicable. If not applicable delete all of section VI. from the Statement of Basis.)

NOT Applicable

VI. Deleted

VII. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Ronald L. Ewald, Senior Analyst, and completed on May 10, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

RLE/bb/001153.ltr

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

PERMIT TO CONSTRUCT

X New
___ Renewal

PERMIT NO. 00-144
SPECIAL CONDITIONS

Saratoga - Clearview Street Waterline Extension
PWS: 5600061

This permit hereby authorizes the applicant:

Union Telephone Company, Inc
P.O. Box 160
Saratoga WY 82331

to construct, install or modify a six inch diameter waterline, a new fire hydrant, 141 ft of 8" diameter sewer and a new manhole according to the procedures and conditions of the application number 00-144. The facility is located in SE 1/4 Section 14 T17N R84W in the county of Carbon, in the State of Wyoming. This permit shall be effective for a period of two years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Southeast District, State of Wyoming, DEQ, Water Quality Division, Herschler Building, 4th Floor West, 122 West 25th Street, Cheyenne, Wyoming 82002; telephone (307) 777-7781; FAX (307) 777-5973.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the DEQ/WQD Southeast District Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral or written notice to the DEQ/WQD Southeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Southeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

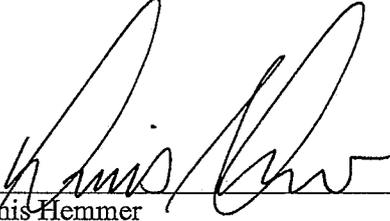

Dennis Hemmer
Director
Department of Environmental Quality

5-18-00

Date of Issuance

LBH/mad 001135.ltr

cc: Saratoga Water Department

STATEMENT OF BASIS

- I. Permit Number: 00-144
- II. Application reviewed for compliance with the following regulations.
- A. Chapter XI. YES
- B. Chapter XII. YES
- III. Basis for issuing permit: Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- IV. Application requires review to determine groundwater impacts in accordance with Sec. 17, Chapter 3.
- NO
- V. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on May 9, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

PERMIT TO CONSTRUCT

New
Renewal
Modified

PERMIT NO. 00-145
SPECIAL CONDITIONS
REF/PERMIT NO. 95-167, 85-514

Exxon-Mobil Corp. Temporary Wastewater Disposal Facilities

This permit hereby authorizes the applicant:

Exxon Mobil Corp.
P.O. Box 4358
Houston TX 77210-4358

to construct, install or modify a temporary sanitary wastewater disposal facilities at drilling locations and off-site associated construction camps located statewide. according to the procedures and conditions of the application number 00-145. This permit shall be effective for a period of 5 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 3 The permittee shall notify the appropriate county or Water Quality District Engineer prior to the installation and after the removal of any facility authorized by this permit. The attached list shall be used to determine the agency to be notified.
- 2 of 3 The design and construction of temporary wastewater disposal facilities shall be in accordance with the plans and specifications approved as Water Quality Division Permit NO. 85-514.
- 3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

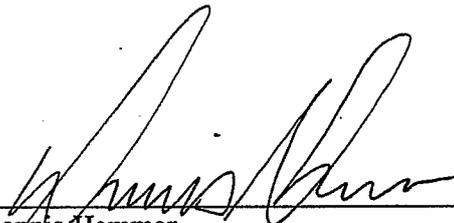

Dennis Hemmer
Director
Department of Environmental Quality

5-12-00

Date of Issuance

LBH/mad/001171.ltr

cc: Delegated Counties, District Offices

STATEMENT OF BASIS

- I. Permit Number: 00-145
- II. Application reviewed for compliance with the following regulations.
- A. Chapter XI. YES
- B. Chapter XII. NO
- III. Basis for issuing permit: Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.
- IV. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3.
- NO
- V. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon, Southeast District Engineering Supervisor, and completed on May 11, 2000. Permit issuance is commended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

PERMIT TO CONSTRUCT

✓ New
— Renewal
Modified

PERMIT NO. 00-146
SPECIAL CONDITIONS

McCuen Septic Tank/Leach Field

This permit hereby authorizes the applicant:

Rebekah McCuen
11 Benchview Estates
Lovell, WY 82431

to construct a septic tank/leach field to serve a four bedroom residence according to the procedures and conditions of application number 00-146. The facility is located in Section 22, T56N, R96W in the county of Big Horn, in the State of Wyoming. This permit shall be effective for a period of 2 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance, or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Jeff Hermansky, Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming 82520; (307) 332-3144; FAX (307) 332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; (307)332-3144; FAX (307)332-3183; in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:

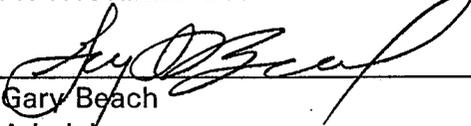

Gary Beach
Administrator
Water Quality Division

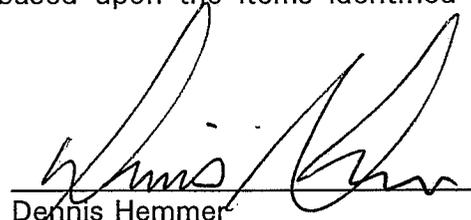

Dennis Hemmer
Director
Department of Environmental Quality

5-30-00

Date of Issuance

STATEMENT OF BASIS

General information.

Permit Number: 00-146

II. Application reviewed for compliance with the following regulations.

A. Chapter XI. Yes

B. Chapter XII. No

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

No

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

Yes

IV. Facilities not specifically covered by regulations.

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

Chapter XI, Part D, Sections 38 and 41, includes sizing for trench, bed, and seepage pit systems. Infiltrators are new technology not included in the regulations.

B. Briefly state the basis for the deviation.

Research data provides sizing criteria found to be acceptable.

C. Permit based on general or statewide deviation contained in approved policy statement

13.41.2 This policy is the acceptable criteria for sizing leachfields using standard chamber units.

V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III¹.

N/A

VII. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Jeff Hermansky, Northwest District engineering Supervisor, and completed on May 4, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

PERMIT TO CONSTRUCT

New
Renewal
Modified

PERMIT NO. 00-147R
SPECIAL CONDITIONS

Decker Septic Tank/Leach Field

This permit hereby authorizes the applicant:

Don Decker
P.O. Box 30
Ten Sleep, Wyoming 82442

to construct a septic tank/leach field to serve a 3 bedroom residence according to the procedures and conditions of application number 00-147R. The facility is located in Section 17, T47N, R88W in the county of Washakie, in the State of Wyoming. This permit shall be effective for a period of 2 years from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (WQD), to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance, or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Jeff Hermansky, Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, Wyoming 82520; (307) 332-3144; FAX (307) 332-3183.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.


The permittee shall construct and operate the permitted facility in accordance with the statement representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:


- 1 of 4 The applicant will notify the Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; (307)332-3144; FAX (307)332-3183; in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northwest District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.

4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:

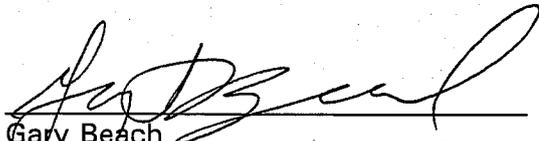

Gary Beach
Administrator
Water Quality Division

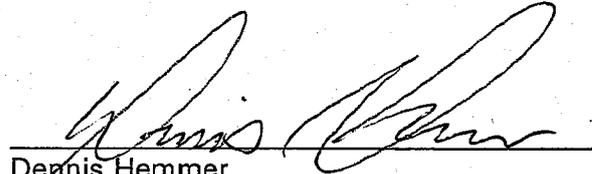

Dennis Hemmer
Director
Department of Environmental Quality

5-15-2000
Date of Issuance

STATEMENT OF BASIS

General information.

Permit Number: 00-147R

II. Application reviewed for compliance with the following regulations.

A. Chapter XI. Yes

B. Chapter XII. No

III. Basis for issuing permit.

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

No

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

Yes

IV. Facilities not specifically covered by regulations.

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

Chapter XI, Part D, Sections 38 and 41, includes sizing for trench, bed, and seepage pit systems. Infiltrators are new technology not included in the regulations.

B. Briefly state the basis for the deviation.

Research data provides sizing criteria found to be acceptable.

C. Permit based on general or statewide deviation contained in approved policy statement

13.41.2 This policy is the acceptable criteria for sizing leachfields using standard chamber units.

V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III¹.

N/A

VI. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Jeff Hermansky, Northwest District Engineering Supervisor, and completed on May 11, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

PERMIT TO CONSTRUCT

x New
— Renewal
Modified

PERMIT NO. 00-148
SPECIAL CONDITIONS

MOORCROFT SEWER LINE REPLACEMENT

This permit hereby authorizes the applicant:

Town of Moorcroft
P.O. Box 70
Moorcroft, WY 82721
Attention: Mayor Barbara Jeffres

to construct, install or modify a sewer collection system according to the procedures and conditions of the application number 00-148. The facility is located in the SW/4 & SE/4 of Section 31 of T50N R67W and NW/4 of Section 6 of T49N R67W in the county of Crook, in the State of Wyoming. This permit shall be effective for a period of one (1) year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

The permittee shall notify representatives from the DEQ, Water Quality Division the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: Northeast District, State of Wyoming, DEQ, Water Quality Division, 1043 Coffeen Avenue, Suite D, Sheridan, Wyoming 82801; telephone (307) 672-6457; FAX (307) 674-6050.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and this permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will notify the appropriate district office of the Water Quality Division, Department of Environmental Quality, by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 11, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:



Gary Beach
Administrator
Water Quality Division

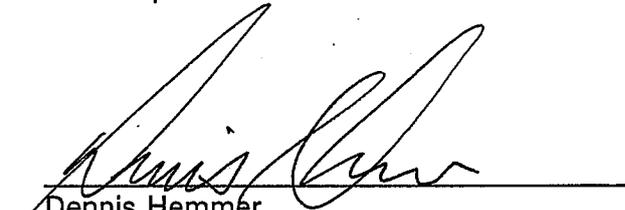

Dennis Hemmer
Director
Department of Environmental Quality

5-5-00

Date of Issuance

DRM:dm 05/04/00
b/001108.ltr

Enclosures: Construction Notice Post Card, Certificate of Completion and Statement of Basis
xc: Jerry Hunt, Weston Engineering, POB 260, Upton, 82730

STATEMENT OF BASIS

General information.

A. Permit Number: 00-148

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter 11 Yes

B. Chapter 12 No

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

Not Applicable (N/A)

B. Briefly state the basis for the deviation.

N/A

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

N/A

V. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter III. (Indicate either applicable or not applicable. If not applicable delete all of section VI. from the Statement of Basis.)

N/A

VI. If Section 17 of Chapter III is applicable, indicate the basis of determining groundwater will be protected. (Fill out only the applicable sections and indicate sections that are not applicable.)

A. Facility will not allow a discharge to groundwater. Briefly describe:

N/A

B. Quality of wastewater is such that it will not cause a violation of groundwater standards. Briefly describe:

N/A

C. Existing soils or geology will not allow a discharge to groundwater. Briefly describe:

N/A

D. Basis of facility design is that it will be operated so as not to violate groundwater standards (example: maintenance of manure pack at animal waste treatment facility). Briefly describe:

N/A

E. Discharge will result in groundwater concentrations in excess of standards but post discharge water quality can be returned to standards in accordance with Section 4 (d)(vi), Chapter VIII. Briefly describe:

N/A

F. If water quality exceedances are allowed, briefly describe the parameter limits, property boundaries, places of withdrawal and any other information documenting that any users of affected aquifer will not be impacted.

N/A

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 17.

- G. Briefly describe monitoring system (parameters, frequency, etc.). Clearly state the parameters to be utilized for determining compliance, what constitutes a violation and steps to be followed by the permittee in the event of a violation.

N/A

VII. Documentation of Statement of Basis.

- A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Don McKenzie, NE Water & Wastewater Section Program Principal, and completed on May 4, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

DRM/bb/001108.ltr

PERMIT TO CONSTRUCT

— New
Renewal
Modified

PERMIT NO. 00-149
SPECIAL CONDITIONS

McGIRR RESIDENTIAL SEPTIC SYSTEM

This permit hereby authorizes the applicant:

Dennis and Dee McGirr
2503 Greenway Drive
Gillette, WY 82716

to construct, install or modify a septic system according to the procedures and conditions of the application number 00-149. The facility is located in the SW/4 of Section 27 of T52N R61W in the county of Crook, in the State of Wyoming. This permit shall be effective for a period of one (1) year from the date of issuance of this permit.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator.

Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division (DEQ/WQD), upon the presentation of credentials and during working hours, to have access to inspect the facilities, at the above location, for the purpose of compliance with the provisions of this construction permit.

The permittee shall notify representatives from the DEQ/WQD the day construction commences and give an estimate of completion of the project. The authorized representative in your area can be contacted at the following address: DEQ/WQD, Casper WDEQ Field Office, 3030 Energy Lane, Suite 200, Casper, WY 82604, telephone (307) 473-3452; FAX (307) 473-3458.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.


The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:


- 1 of 4 The applicant will notify the Casper Field Office by the attached post card of the date construction will begin and the estimated completion date.
- 2 of 4 The applicant will provide immediate oral and/or written notice to the Northeast District Office in accordance with the provisions of Section 9, Chapter III, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Casper Field Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:

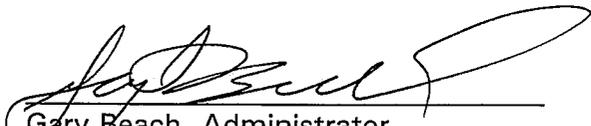

Gary Beach, Administrator
Water Quality Division
5-18-00

Date of Issuance

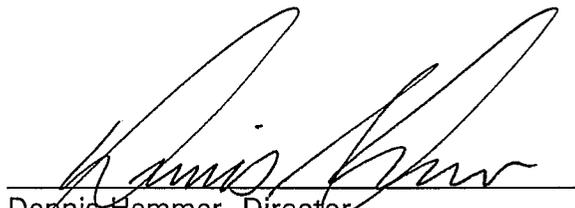

Dennis Hemmer, Director
Department of Environmental Quality

JDL/bb/001124.ltr-5/8/00

Enclosures: Notification Post Card
Certificate of Completion
Statement of Basis

STATEMENT OF BASIS

General information.

A. Permit Number: 00-149

II. Application reviewed for compliance with the following regulations. (Indicate yes or no for each section.)

A. Chapter XI. Yes

B. Chapter XII. No

III. Basis for issuing permit. (Indicate yes or no for each section.)

A. Review of application package indicates proposed facility will be in compliance with applicable regulations identified in Section II.

Yes

B. Permit includes deviation from applicable regulations in accordance with Section 5, Chapter XI, or XII.

No

C. Permit based on deviation from applicable regulations in accordance with approved policy statement.

No

IV. Facilities not specifically covered by regulations. (Indicate the section number of the regulations and briefly summarize the regulation.)

A. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

Not Applicable (N/A)

B. Briefly state the basis for the deviation.

N/A

C. Permit based on general or statewide deviation contained in approved policy statement (indicate the policy number and briefly summarize the nature of the deviation).

N/A

V. Application requires review to determine groundwater impacts in accordance with Section 15, Chapter III¹. (Indicate either applicable or not applicable. If not applicable delete all of Section VI. from the Statement of Basis.)

N/A

VI. N/A

VII. Documentation of Statement of Basis.

A. The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Dennis Lamb, Northeast District DEQ/WQD-SPO Senior Analyst, and completed on May 8, 2000. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

JDL/bb/001124.ltr

¹Sediment ponds, public water supplies, sewerage systems and small wastewater systems are exempt from the requirements of Section 15.

_____ The facility has already been constructed, or is under construction. Construction of any sewerage system, water system, treatment works, or disposal system will stop until an approved permit is issued. The requested information will be submitted within 30 days.

_____ Other / Remarks: _____

Please note and be reminded that the construction, installation, or modification of any sewerage system, treatment works, disposal system, or any other facility capable of causing or contributing to pollution, or a public water supply system **without a Permit To Construct** is a violation of the Wyoming State Statutes. Unless the WQD reviewing engineer identified above receives information concerning the status of this project within 30 days of the receipt of this letter, appropriate follow-up action will be undertaken.

Sincerely;



Ronald L. Ewald
Environmental Senior Analyst
SE District, Water Quality Division

RLE/mad/02685.ltr

cc: Application File # 00-150
Enforcement File

REVIEW OF PLANS AND SPECIFICATIONS
WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION

Herschler Bldg., 4 West
Cheyenne, Wyoming 82002

PROJECT: Larry Kilwein Dwelling #1 - Seasonal Residential Septic System

ENGINEER: None

APPLICANT: Larry Kilwein
9266 Driller Rd.
Casper, Wyoming 82601

WATER QUALITY DIVISION REFERENCE NUMBER: 00-150

REVIEWING ENGINEER: Ronald L. Ewald *RLE*
Phone: (307) 777-6183

DATE OF REVIEW: May 25, 2000

ACTION: NOT AUTHORIZED FOR CONSTRUCTION. In accordance with Section 9(a)(ii), Chapter 3, Wyoming Water Quality Rules and Regulations, the application is denied because it is incomplete or does not meet applicable minimum design and construction standards. Please address the comments outlined below and submit the requested information in order that the application process may be completed in accordance with Section 9. If the applicant fails to provide the requested information within six months the incomplete application shall be returned.

COMMENTS, INADEQUACIES, AND QUESTIONS:

1. Percolation Tests and Calculations Done Incorrectly - The percolation test data appears to be inconsistent and the slowest perk rate from the data should be 125 minutes per inch (mpi), which is unsuitable (i.e., 15minutes/0.12 inch final drop equals 125mpi). Please rerun your percolation tests and be sure to pre-soak the test holes overnight and run the tests until the water level drop rate stabilizes. A new, more detailed, percolation test package is included with this review. Please complete this new form and submit it with your response to this review. Please note that after redoing the percolation tests you will have to recalculate your minimum leach field area, therefore, a new blank application package is also included for this purpose.

2. Leach Field Layout - You need to make a sketch of your leach field layout and also complete the **STANDARD TRENCH TYPE Detail Sheet** included in the packet. After redoing your percolation tests you may not need so many sections of "Infiltrator" chambers. Also, it is better to use either 2 or 4 rows of chambers instead of 3 rows because you can get equal distribution of the effluent with simple tee fittings. With 3 rows you also need a distribution box at the beginning of the leachfield in order to get equal effluent distribution to each row. And finally, how far apart will the rows of chambers be? There needs to be at least 4 feet of undisturbed soil between the trenches.
3. Septic Tank Brand - What is the manufacturer's brand name or the company name of the distributor of this tank? A.J. Vollma is not on our pre-approved list; at least not under that name. Tanks which are not on our approved list can be used provided that they meet the requirements. In this case, you would need to submit the plans and specifications of the tank in question for review.
4. Water Body Proximity - How far away is the high water line of Glendo Reservoir and in what direction from your property?

RLE/bb/01307.ltr

Enclosures: Blank application package
New percolation test package