

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-051

2004 Water Transmission Lines & West Side Storage Tank Project - Phase II
PWS# 5600022

This permit hereby authorizes the applicant:

Town of Greybull
PO Box 271
Greybull, Wyoming 82426

to construct, install or modify a 250,000 gallon steel water storage tank, approximately 11,500 feet of 12" PVC waterline, and associated appurtenances according to the procedures and conditions of the application number 04-051. The facility is located in Sections 17, 18, and 19, Township 52 North, Range 93 West in the county of Big Horn, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by October 1, 2005.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:


- 1 of 4 The applicant will provide immediate oral or written notice to the DEQ/WQD Northwest District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Northwest District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 3 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".
- 4 of 4 The Town of Greybull will implement a cross-connection control program which complies with Wyoming Water Quality Rules and Regulations
 - a. The Town will amend their ordinance dealing with their waterworks system to conform to the requirements of WWQRR Chapter 12 Section 14 (i).
 - b. All water users to receive water directly from the project main will be notified of the backflow prevention requirements and be required to have an acceptable backflow prevention device installed. The Town will determine the hazard classification in each case and will inspect the installed backflow prevention devices. During construction of the project, the Town will shut off the involved services and will not turn them back on until the appropriate backflow prevention devices are installed and inspected.
 - c. All high hazard non-residential connections will be notified of the backflow prevention requirements and be required to have an acceptable backflow prevention device installed. The Town will inspect said connections, determine the acceptable backflow prevention

device to be installed, and inspect the device after installation. The Town will shut off all high hazard non-residential connections which do not comply with the backflow prevention requirements and will not turn them back on until they do comply.


AUTHORIZED BY:



John F. Wagner
Administrator
Water Quality Division



John V. Corra
Director
Department of Environmental Quality



Date of Issuance

JVC/JFW/KJF/pf/4-0496-ltr

cc: WDEQ Casper Field Office

STATEMENT OF BASIS

1. Permit Number: 04-051
2. Application reviewed for compliance with the following applicable regulations :

Chapter 12.

3. Does the permit comply with all applicable regulations identified above?

The permit approval is based upon a deviation from applicable regulations in accordance with Section 5. of Chapter 12.

4. Facilities not specifically covered by regulations;

- a. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

Section 14, part c-"Valves shall be located at not more than 500 foot intervals in commercial districts and at not more than 1 block or 800 foot intervals in other districts."

- b. Briefly state the basis for the deviation.

Little development exists around much of the main from the storage tank into the Town of Greybull. The Town can better determine the most appropriate valve locations along this section of main in the future if and when development progresses along said main. The sections of main within the currently developed areas have appropriately designed valve locations.

5. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3.

Not required

6. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Kevin Frank, PE, SRF Program Senior Analyst, and Mark Baron, PE, NW District Senior Analyst, and completed on May 14, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."



The State
of Wyoming



Department of Environmental Quality

1043 Coffeen Avenue, Suite D • Sheridan, Wyoming 82801

Dave Freudenthal, Governor

AIR QUALITY
(307) 672-6457
Fax (307) 674-6050

LAND QUALITY
(307) 672-6488
Fax (307) 672-2213

WATER QUALITY
(307) 672-6457
Fax (307) 674-6050

NOTIFICATION OF COVERAGE

March 22, 2004


Mr. Bob Wood
Mayor
Town of Dayton
P.O. Box 100
Dayton, WY 82834

RE: South Fork Water Line Replacement, Permit # 04-052
PWS# 5600202C


Dear Bob:

The above application for coverage under General Permit to Construct, Install, Modify or Operate an extension to the Town of Dayton Distribution System in accordance with Chapter 3 and Chapter 12 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit. All construction, installation, or modification allowed by this Notice of Coverage shall be completed by April, 2005.

Sincerely,


Rick J. Estes, P.E.
DEQ/WQD NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Bill Mentock, Mentock Engineering, Taylor Place No. 2, Sheridan, WY 82801



The State
of Wyoming



Department of Environmental Quality

1043 Coffeen Avenue, Suite D • Sheridan, Wyoming 82801

Dave Freudenthal, Governor

AIR QUALITY
(307) 672-6457
Fax (307) 674-6050

LAND QUALITY
(307) 672-6488
Fax (307) 672-2213

WATER QUALITY
(307) 672-6457
Fax (307) 674-6050

NOTIFICATION OF COVERAGE

March 10, 2004

Sterling Price
4316 Olive
Gillette, WY 82718

RE: Price Residential Septic System, Permit # 04-053

Dear Sterling:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of a small wastewater septic system in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit. **A minimum of two (2) photos of the system installation shall accompany the Certificate of Completion submitted to this office.** All construction, installation, or modification allowed by this permit shall be completed by March 1, 2005.

If you have any questions please contact me at 1043 Coffeen Avenue, Suite D, Sheridan, WY, 82801, (307) 672-6457. Thank you.

Sincerely,

Rick J. Estes, P.E.

WDEQ/WQ NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Rob Anderson, 320 Pine Ridge Road, Moorcroft, WY 82721



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307)777-7758 FAX 777-3610	ABANDONED MINES (307)777-6145 FAX 777-6462	AIR QUALITY (307)777-7391 FAX 777-5616	INDUSTRIAL SITING (307)777-7369 FAX 777-6937	LAND QUALITY (307)777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307)777-7752 FAX 777-5973	WATER QUALITY (307)777-7781 FAX 777-5973
---	--	--	--	---	---	--

NOTIFICATION OF COVERAGE

March 16, 2004

Mr. Herman Noe, Manager of Engineering
Cheyenne Board of Public Utilities
P.O. Box 1469
Cheyenne WY 82003-1469

RE: Cheyenne BOPU , Application No.04-054, Laramie County

Dear Mr. Noe:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems described as replacement of existing water main at various locations, Sec. 16 T14N R67W; Laramie County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, the general permit and the materials submitted in your application package. All service connections will be protected by the appropriate backflow device as required by Chapter 12, Section 14(i) of the Water Quality Division Rules and Regulations. All construction, installation, or modification allowed by this notification of coverage shall be completed by August 11, 2006.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 04-054 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne

Jeff Pecenka, Cheyenne Board of Public Utilities
2406 Snyder Avenue
Cheyenne WY 82001

LBH/mad/4-0258-ltr



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

250 Lincoln Street • Lander, Wyoming 82520 • Fax (307) 332-7726

ABANDONED MINES
(307) 332-5085

AIR QUALITY
(307) 332-6755

LAND QUALITY
(307) 332-3047

SOLID & HAZARDOUS WASTE
(307) 332-6924

WATER QUALITY
(307) 332-3144

NOTIFICATION OF COVERAGE

March 12, 2004

Ken Stockwell, Mayor
City of Cody
P.O. Drawer 2200
Cody, Wyoming 82414

RE: Cody - 2004 Cody Avenue & 8 th Street 6-inch Water Line Construction- Permit Number: PWS # 5600207
04-055R, NW1/4 & SE 1/4 Section 1&31, T52N&T53N, R101W, Park County, PWS # 5600207

Dear Mayor Stockwell:

The above application for coverage under General Permit to Construct a water line replacement consisting of 935 linear feet (LF) of 6-inch water main and appurtenances in accordance with Chapter 3, Section 7 and Chapter 12, Section 14 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Mark Baron, P.E.
Environmental Senior Analyst
Water Quality Division

cc: IPS, Cheyenne
encl: General Permit For a Public Water Supply Distribution System

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-056

Wyoming Army National Guard Road Application of ROWPU Water

This permit hereby authorizes the applicant:

Wyoming Army National Guard
Building 15, P.O. Box 399
Guernsey, WY, 82214

to conduct road application of brine water from reverse osmosis water purification units according to the procedures and conditions of the application number 04-056. The facility is located in Sec. 35 T27N R66W in the county of Platte, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by March 16, 2009.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and

permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

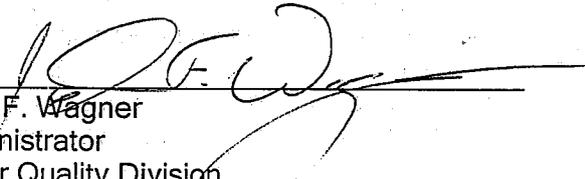
In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 3 The applicant will provide immediate oral or written notice to the Southeast District, Water Quality Division, Herschler Building 4 West, Cheyenne, WY, 82002, Phone 307-777-7088, FAX 307-777-5973, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.

- 2 of 3 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Southeast District, Water Quality Division, Herschler Building 4 West, Cheyenne, WY, 82002 a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.

- 3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".


AUTHORIZED BY:



John F. Wagner
Administrator
Water Quality Division

3/18/04

Date of Issuance



John V. Corra
Director
Department of Environmental Quality

LBH/mad/4-0272-ltr

cc: Frank Seifert
Wyoming Army National Guard
5500 Bishop Boulevard
Cheyenne WY 82009-3320

STATEMENT OF BASIS

1. Permit Number: 04-056
2. Application reviewed for compliance with the following applicable regulations :

Chapter(s) 11 of the Wyoming Water Quality Rules and Regulations

3. Does the permit comply with all applicable regulations identified above?

Yes

Road application of acceptable wastes are protective of the groundwater.

4. A review to determine groundwater impacts in accordance with Section 17, Chapter 3 was not required.
5. Documentation of Statement of Basis: The archives file for this permit include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon PE-PG, Southeast District Engineer, lharmo@state.wy.us, and completed on March 17, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

250 Lincoln Street • Lander, Wyoming 82520 • Fax (307) 332-7726

ABANDONED MINES
(307) 332-5085

AIR QUALITY
(307) 332-6755

LAND QUALITY
(307) 332-3047

SOLID & HAZARDOUS WASTE
(307) 332-6924

WATER QUALITY
(307) 332-3144

NOTIFICATION OF COVERAGE

March 9, 2004

Dorothy J. Overfield, Manager
Northwest Rural Water District
P.O. Box 2347
Cody, Wyoming 82414

RE: Northwest Rural Water District - Southfork Service Area- Line 175- Miller Park Waterline Extensions - Permit Number: 04-057, NE1/4 Section 35, T52N, R103W, Park County, PWS # 5601254

Dear Ms. Overfield:

The above application for coverage under General Permit to Construct a water line extension consisting of 2693 linear feet (LF) of 3-inch water main and appurtenances in accordance with Chapter 3, Section 7 and Chapter 12, Section 14 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Mark Baron, P.E.
Environmental Senior Analyst
Water Quality Division

cc: IPS, Cheyenne
encl: General Permit For a Public Water Supply Distribution System,

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT FOR LAND APPLICATION

PERMIT NO. 04-058
Reference Permits:
NO. 98-346 & 00-208R

Star Valley Cheese - Land Application of Cheese Whey Wastewater

This permit hereby authorizes the applicant:

Frank Dana, V.P. Production
Star Valley Cheese Corporation
P.O. Box 346
Thayne, WY 83127

to land apply cheese whey wastewater, according to the procedures and conditions of the application number 04-058. The application site is located at T34N, R118W & R119W in the county of Lincoln, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by April 15, 2009.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

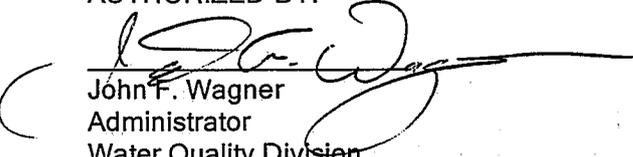
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

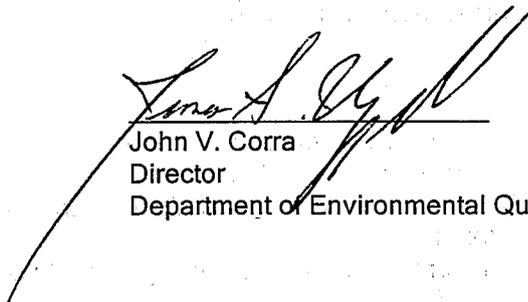
In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 6 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality, Water Quality Division (WQD), Northwest District Engineer, 250 Lincoln Street, Lander, WY 82520, 307-332-3144, FAX 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 6 The permittee shall keep records of land applications of whey, enter into landowner agreements for the application of whey, and conduct soil sampling and analyses to determine background and post application soil nutrient levels as provided for in the Comprehensive Nutrient Management Plan submitted for the project. Records and test results shall be submitted at the end of each calendar year to the following address: SW District, State of Wyoming, DEQ, Water Quality Division, 250 Lincoln Street, Lander, WY 82520; (307)332-3144; FAX (307)332-3183.
- 3 of 6 The whey shall be applied at rates that avoid excessive runoff of the whey from the ground surface or percolation of the nutrients below the root zone. The maximum application rate shall be 1 inch per application (27,140 gallons per acre). No more than 4 inches total may be applied to the same area per year. Whey may not be applied to any areas where the depth to groundwater is less than 6 feet.
- 4 of 6 Land application of whey shall be done as described in the Comprehensive Nutrient Management Plan to prevent odor and vector problems, and shall be applied in a manner to prevent pollution of surface or groundwater. Land application shall not be done within 100 feet of any streams, or on slopes that will allow the whey to run into streams, lakes or other surface waters.
- 5 of 6 This Permit to Construct is being limited to a period not exceeding five (5) years. A permit application including an updated comprehensive nutrient management plan that balances nutrients, including phosphorus (based on new NRCS methodology using a phosphorus index) must be submitted 6 months before this permit expires. At the expiration of this permit, a new permit for the land application of whey will be issued only if the update comprehensive nutrient management plan, based on an agronomic balance demonstrates compliance with both ground and water surface standards.
- 6 of 6 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division

4-21-04
Date of Issuance
MDB/pf/4-0386-ltr


John V. Corra
Director
Department of Environmental Quality

STATEMENT OF BASIS

1. Permit Number: 04-058
2. Application reviewed for compliance with the following regulations:
Chapters 3 and 11 of the Wyoming Water Quality Rules and Regulations.
3. Does the permit comply with all applicable regulations identified above?
Yes.
4. If Section 17 of Chapter 3 review is required indicate the basis for determining groundwater will be protected.
Required
5. If Section 17 of Chapter 3 review is required, indicate the basis for determining groundwater will be protected.
 - a. The facility is designed and will be operated so that it will not violate groundwater standards.

Land application of whey is to be made only in areas that are a minimum of 6 feet above the seasonally high groundwater. Application is to be made at rates that will allow nutrients to be fully utilized by crops, and the land application is to be at rates that will not allow percolation of nutrients below the root zone.
 - b. The permit should clearly state the parameters to be utilized for determining compliance and what occurrences constitute a violation. The permit should identify the corrective actions to be taken in the event of a violation of a groundwater standard.

Soil Testing Schedule - Field soils under whey application are to be sampled as follows:			
Sampling Locations	Parameter	Method	Frequency
Soil sample are to be taken and analyzed for each field where whey is being applied.	AGRONOMIC PROPERTIES		
	Conductivity, paste extract	ASAM ¹ 10-3	Annually
Samples are to be taken at depths of 6 and 12 inches where whey is being applied.	pH, paste extract	ASAM 10-3.2	Annually
	Nitrogen, Nitrate + Nitrite as N	EPA ² 353.2	Annually
	METALS - TOTALS		
Background samples are to be taken at depths of 6 and 12 inches where whey is not being applied.	Phosphorus	SW ³ 6010B	Annually
	Potassium	SW6010B	Annually
	METALS - NAHCO3 EXTRACTABLE		
	Phosphorus, Olsen	SW6010B	Annually

1. American Society of Agronomy
2. U.S. Environmental Protection Agency
3. Solid Waste

6. Documentation of Statement of Basis: The archives file for this permit include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Mark D. Baron, mbaron@state.wy.us, Environmental Senior Analyst and completed on April 15, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

250 Lincoln Street • Lander, Wyoming 82520 • Fax (307) 332-7726

ABANDONED MINES
(307) 332-5085

AIR QUALITY
(307) 332-6755

LAND QUALITY
(307) 332-3047

SOLID & HAZARDOUS WASTE
(307) 332-6924

WATER QUALITY
(307) 332-3144

NOTIFICATION OF COVERAGE

April 9, 2004

Mr. Benjamin T. Horton
Bencor/Gateway Limited Partnership
90 S. Cascade Ave., Suite 330
Colorado Springs, CO 80903

RE: **Rock Springs Walgreens-Water Service, Permit Number 04-059R**, SW1/4 Section 34,
T19N, R105W, Sweetwater County

Dear Mr. Horton:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modification of an Existing Public Water Supply Distribution System in accordance with Chapter 3, Section 7 and Chapter 12 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the facility(ies) in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Doyle Conklin
SW District Engineering Supervisor
Water Quality Division

xc: IPS, Cheyenne
City of Rock Springs; Attn: Paul D. Kauchich, 212 D Street, Rock Springs, WY 82901

encl: General Permit for Extensions to Existing Public Water Supply Distribution Systems



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

250 Lincoln Street • Lander, Wyoming 82520 • Fax (307) 332-7726

ABANDONED MINES
(307) 332-5085

AIR QUALITY
(307) 332-6755

LAND QUALITY
(307) 332-3047

SOLID & HAZARDOUS WASTE
(307) 332-6924

WATER QUALITY
(307) 332-3144

NOTIFICATION OF COVERAGE

May 7, 2004

Mr. John Briggs
P.O. Box 10195
Jackson, WY 83002

RE: **Ridge Estates Water Distribution System, Permit Number 04-060R**; SW1/4 Section
20, T37N, R118W, Lincoln County

Dear Mr. Briggs:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modification of Existing Public Water Supply Distribution Systems in accordance with Chapter 3, Section 7 and Chapter 12 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the facility(ies) in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Doyle Conklin
SW District Engineering Supervisor
Water Quality Division

xc: IPS, Cheyenne
North Alpine Improvement and Service District; P.O. Box 3776, Alpine, WY 83128
encl: General Permit for Extensions to or Modification of an Existing Public Water System



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307)777-7758 FAX 777-3610	ABANDONED MINES (307)777-6145 FAX 777-6462	AIR QUALITY (307)777-7391 FAX 777-5616	INDUSTRIAL SITING (307)777-7369 FAX 777-6937	LAND QUALITY (307)777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307)777-7752 FAX 777-5973	WATER QUALITY (307)777-7781 FAX 777-5973
---	--	--	--	---	---	--

NOTIFICATION OF COVERAGE

February 25, 2004

Mr. Mike Glode, Chariman
Town of Saratoga
P.O. Box 486
Saratoga WY 82331

RE: Saratoga JPB WWTP Pilot Plant, Application No.04-061, Carbon County

Dear Mr. Glode:

The above application for coverage under General Permit to Construct and Operate a Pilot Plant in accordance with Chapter 3, Section 7 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct and operate the pilot plant in accordance with Chapter 11, Section 5 of the Water Quality Division Rules and Regulations, the general permit and the materials submitted in your application package. All construction, installation, or modification allowed by this notification of coverage shall be completed by August 31, 2004. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No.04-060 in any future correspondence. Operation of the pilot plant until August 1, 2004 is encouraged. After the 30 days of operation at cold water temperatures to demonstrate cold water operation, the sampling schedule frequency may be reduced with the agreement of the Water Quality Division. Please take ammonia sample quality control tests for analysis by an EPA approved laboratory concurrent with the BOD samples required.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne
Todd Parfitt
Roland Peterson

Charles Bartlett, Town of Saratoga
P.O. Box 486
Saratoga WY 82331

LBH/mad/4-0167-ltr



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307)777-7758 FAX 777-3610	ABANDONED MINES (307)777-6145 FAX 777-6462	AIR QUALITY (307)777-7391 FAX 777-5616	INDUSTRIAL SITING (307)777-7369 FAX 777-6937	LAND QUALITY (307)777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307)777-7752 FAX 777-5973	WATER QUALITY (307)777-7781 FAX 777-5973
---	--	--	--	---	---	--

NOTIFICATION OF COVERAGE

March 22, 2004

Galand Thaxton
1571 N. 22 ST.
Laramie, Wyoming 82072

RE: 6th Filing Revised Montevue Addition, Lots 1-17, Blk 1- Water & Sewer Extensions, Application No. **04-062**

Dear Mr. Thaxton:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems and Existing Sewage Collection Systems in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, the sewage collection system in accordance with Chapter 11, Section 9 of the Water Quality Division Rules and Regulations, and both systems in accordance with the general permits and the materials submitted in your application package. All water service connections will be protected by the appropriate backflow device as required by Chapter 12, Section 14(i) of the Water Quality Division Rules and Regulations. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permits.

The approval granted under this Notification Of Coverage and the General Permit shall expire on October 26, 2005. Please reference Application Number **04-062** in any future correspondence.

If you have any questions, please contact me at (307) 777-6183.

Sincerely,

Ronald L. Ewald
Environmental Senior Analyst
Southeast District, Water Quality Division

RLE/pf/4-0304-ltr

cc: IPS, Cheyenne
Lloyd H. Baker, Gertsch/Baker & Assoc. 215 S. 3rd ST., Suite 110, Laramie, WY 82070

Enclosures: GENERAL PERMIT - Extensions/Modifications of Existing Public Water Supply Distribution Systems
GENERAL PERMIT - Extensions/Modifications of Existing Sewage Collection
Certificate of Completion form



The State
of Wyoming



Department of Environmental Quality
1043 Coffeen Avenue, Suite D • Sheridan, Wyoming 82801

AIR QUALITY
(307) 672-6457
Fax (307) 674-6050

LAND QUALITY
(307) 672-6488
Fax (307) 672-2213

WATER QUALITY
(307) 672-6457
Fax (307) 674-6050

NOTIFICATION OF COVERAGE

March 10, 2004

KDK Sid Waldrop
P.O. Box 313
Moorcroft, WY 82721

RE: KDK-Sid Waldrop Residential Septic System, Permit # 04-064

Dear Sid:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of a small wastewater septic system in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit. **A minimum of two (2) photos of the system installation shall accompany the Certificate of Completion submitted to this office.** All construction, installation, or modification allowed by this permit shall be completed by March 1, 2005.

If you have any questions please contact me at 1043 Coffeen Avenue, Suite D, Sheridan, WY, 82801, (307) 672-6457. Thank you.

Sincerely,

Rick J. Estes, P.E.
WDEQ/WQ NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Vince Waters, NEWSO, 647 McKean Rd, Moorcroft, WY 82721
Town of Pine Haven, 24 Waters Drive, Pine Haven, WY 82721



The State
of Wyoming

Department of Environmental Quality

Dave Freudenthal, Governor

3030 Energy Lane • Suite 200 • Casper, Wyoming 82604

SOLID & HAZARDOUS WASTE DIVISION
(307) 473-3450
Fax: (307) 473-3458

AIR QUALITY DIVISION
(307) 473-3455
Fax: (307) 473-3458

WATER QUALITY DIVISION
(307) 473-3465
Fax: (307) 473-3458

ABANDONED MINES
(307) 473-3460
Fax: (307) 473-3458



NOTIFICATION OF COVERAGE

April 1, 2004

Ken Stockwell
Mayor
City of Cody
PO Drawer 2200
Cody, WY 82414

RE: Bleistein Ave. 6 inch Water Main Replacement, Application No. 04-065

Dear Mayor Stockwell:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modification of Existing Public Water Supply Distribution Systems in accordance with Chapter 3 and Chapter 12 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the facility(ies) in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V. Section O. of the general permit.

If you have any questions, please contact me at 307-473-3471.

Sincerely,

Kevin J. Frank

Kevin J. Frank, PE
Senior Analyst
Water Quality Division

cc: IPS, Cheyenne



The State of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307)777-7758 FAX 777-3610	ABANDONED MINES (307)777-6145 FAX 777-6462	AIR QUALITY (307)777-7391 FAX 777-5616	INDUSTRIAL SITING (307)777-7369 FAX 777-6937	LAND QUALITY (307)777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307)777-7752 FAX 777-5973	WATER QUALITY (307)777-7781 FAX 777-5973
---	--	--	--	---	---	--

NOTIFICATION OF COVERAGE

March 9, 2004

Daniel M. Dunn
501 16th, #13
Wheatland, WY 82201

RE: Dunn Residential Septic System,
Location: NE 1/4, Section 36, T25N, R68W,

Application No. **04-066**
Platte County

Dear Mr. Dunn:

The above application for coverage under General Permit to Construct, Install, Modify, or Operate a Small Wastewater Facility in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install, or modify the small wastewater system in accordance with Chapter 11, Part D of the Water Quality Division Rules and Regulations, the general permit, the condition listed below, and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Additionally, the following project specific condition also applies:

Septic Tank Clean-Out Riser Requirement - Either a 6 inch diameter clean-out riser or the manway from each compartment of the tank must be extended to the ground surface.

The approval granted under this Notification Of Coverage and the General Permit shall expire on October 26, 2005. Please reference Application Number **04-066** in any future correspondence.

If you have any questions, please contact me at (307) 777-6183.

Sincerely,

Ronald L. Ewald
Environmental Senior Analyst
Southeast District, Water Quality Division

E/bb/4-0233.ltr

Enclosures: GENERAL PERMIT - Small Wastewater Facility
Certificate of Completion

cc: IPS, Cheyenne
Platte County Planner, Marlin Johnson, P.O. Box 728, Wheatland, Wyoming 82201



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307)777-7758 FAX 777-3610	ABANDONED MINES (307)777-6145 FAX 777-6462	AIR QUALITY (307)777-7391 FAX 777-5616	INDUSTRIAL SITING (307)777-7369 FAX 777-6937	LAND QUALITY (307)777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307)777-7752 FAX 777-5973	WATER QUALITY (307)777-7781 FAX 777-5973
---	--	--	--	---	---	--

NOTIFICATION OF COVERAGE

March 17, 2004

Mr. Herman Noe, Manager of Engineering
Cheyenne Board of Public Utilities
P.O. Box 1469
Cheyenne WY 82003-1469

RE: Western Vista Credit Union Fire Service, Application No.04-067, Laramie County

Dear Mr. Noe:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems described as fire hydrant and fire service line, NE 1/4 NE 1/4 Section 19 T14N R66W; Laramie County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, the general permit and the materials submitted in your application package. All construction, installation, or modification allowed by this notification of coverage shall be completed by October 26, 2005.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 04-067 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne

Gary Brown, H.W. Lochner Inc.
5908 Yellowstone Road, Ste A
Cheyenne WY 82009

LBH/mad/4-0275-ltr



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

250 Lincoln Street • Lander, Wyoming 82520 • Fax (307) 332-7726

ABANDONED MINES
(307) 332-5085

AIR QUALITY
(307) 332-6755

LAND QUALITY
(307) 332-3047

SOLID & HAZARDOUS WASTE
(307) 332-6924

WATER QUALITY
(307) 332-3144

NOTIFICATION OF COVERAGE

April 30, 2004

Robert McLaurin
Town Administrator
Town of Jackson
Jackson, Wyoming 83001

RE: Jackson - YAMA Development Group Multi-family Housing Development (810 West Snow King Ave.) - Permit Number: 04-068R, SW 1/4 Section 33, T41N, R116W, Teton County

Dear Mr. McLaurin:

The above application for coverage under General Permits to Construct extensions of a sewage collection system and a public water distribution system consisting of 690 linear feet of 8-inch PVC sewer main and 680 linear feet of 8-inch water main in accordance with Chapter 3, Section 7 and Chapter 11, Section 9 and Chapter 12, Section 14 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, the facilities in accordance with the general permits and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Mark Baron, P.E.
Environmental Senior Analyst
Water Quality Division

cc: IPS, Cheyenne
encl: General Permit For a Sewage Collection System,
General Permit For a Public Water Distribution System



The State
of Wyoming

ARCHIVES



Department of Environmental Quality

Dave Freudenthal, Governor

250 Lincoln Street • Lander, Wyoming 82520 • Fax (307) 332-7726

ABANDONED MINES
(307) 332-5085

AIR QUALITY
(307) 332-6755

LAND QUALITY
(307) 332-3047

SOLID & HAZARDOUS WASTE
(307) 332-6924

WATER QUALITY
(307) 332-3144

NOTIFICATION OF COVERAGE

March 18, 2004

Bud Currah, Mayor
Town of Shoshoni
P.O. Box 267
Shoshoni, Wyoming 82649

RE: Shoshoni - Water Line Project to Wind River Mushrooms- Permit Number: 04-069R; NE1/4 Section 29, T38N, R94W, Fremont County, PWS # 5600053

Dear Mayor Currah:

The above application for coverage under General Permit to Construct a water line extension consisting of 1800 linear feet (LF) of 8-inch water line and appurtenances in accordance with Chapter 3, Section 7 and Chapter 12, Section 14 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Mark Baron, P.E.
Environmental Senior Analyst
Water Quality Division

cc: IPS, Cheyenne
encl: General Permit For a Public Water Supply Distribution System



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307)777-7758 FAX 777-3610	ABANDONED MINES (307)777-6145 FAX 777-6462	AIR QUALITY (307)777-7391 FAX 777-5616	INDUSTRIAL SITING (307)777-7369 FAX 777-6937	LAND QUALITY (307)777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307)777-7752 FAX 777-5973	WATER QUALITY (307)777-7781 FAX 777-5973
---	--	--	--	---	---	--

NOTIFICATION OF COVERAGE

March 17, 2004

Mr. Herman Noe, Manager of Engineering
Cheyenne Board of Public Utilities
P.O. Box 1469
Cheyenne WY 82003-1469

RE: Cheyenne BOPU W&S Extensions to Nissan Motors, Application No.04-070, Laramie County

Dear Mr. Noe:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems and of Existing Sewage Collection Systems described as water line and fire hydrants and sewer line with an oil and grease separator, NW 1/4 Section 1 T13N R67W; Laramie County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, the sewage collection system in accordance with Chapter 11, Section 9 of the Water Quality Division Rules and Regulations, and both systems in accordance with the general permit and the materials submitted in your application package. All service connections will be protected by the appropriate backflow device as required by Chapter 12, Section 14(i) of the Water Quality Division Rules and Regulations. All construction, installation, or modification allowed by this notification of coverage shall be completed by August 11, 2006.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 04-070 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne
Scott Larson, BenchMark of Cheyenne PC
1920 Thomes Ave, Suite 620
Cheyenne WY 82001

LBH//mad/4-0278-ltr

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-071RR

Lincoln County - Stewart Country Club Estates Water & Sewer Extensions
PWS # WY5601471

This permit hereby authorizes the applicant:

Timothy W. Stewart, Owner/Manager
Star Valley Ranch RV Park
P.O. Box 299
Thayne, WY 83127

to construct a public water supply distribution system extension consisting of a stand by generator, 1290 Linear Feet (LF) of 6-inch and 940 LF of 8-inch PVC water main and a sewage collection system extension consisting of 2206 LF of 8-inch PVC sewer main to serve 24 residential lots, according to the procedures and conditions of the application number 04-071RR. The facility is located at NE1/4 Section 1, T34N, R119W in the county of Lincoln, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by August 4, 2006.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

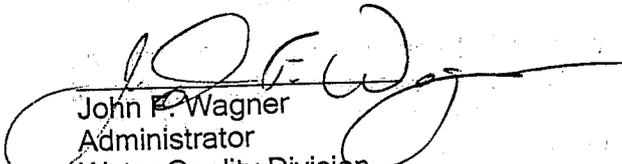
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.


The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality, Water Quality Division (WQD), Southwest District Engineer, 250 Lincoln Street, Lander, WY 82520, 307-332-3144, FAX 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northwest District a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
- a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.
- 3 of 4 As-Built plans and specifications must be submitted for the alternative power source. Ventilation for the booster pump building must comply with Chapter 12, Section 8 (k) which requires forced ventilation of at least 6 air changes per hour with an inlet and outlet.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John V. Corra
Director
Department of Environmental Quality

8/9/04
Date of Issuance

MDB/bb/4-0797.ltr

STATEMENT OF BASIS

1. Permit Number: 04-071RR
2. Application reviewed for compliance with the following regulations:
Chapters 3, 11 and 12 of the Wyoming Water Quality Rules and Regulations.
3. Does the permit comply with all applicable regulations identified above?
Yes.
4. If Section 17 of Chapter 3 review is required indicate the basis for determining groundwater will be protected.
Not Required
5. Documentation of Statement of Basis: The archives file for this permit include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Mark D. Baron, mbaron@state.wy.us, Environmental Senior Analyst and completed on August 4, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

MDB/bb/4-797.ltr



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

250 Lincoln Street • Lander, Wyoming 82520 • Fax (307) 332-7726

ABANDONED MINES
(307) 332-5085

AIR QUALITY
(307) 332-6755

LAND QUALITY
(307) 332-3047

SOLID & HAZARDOUS WASTE
(307) 332-6924

WATER QUALITY
(307) 332-3144

NOTIFICATION OF COVERAGE

April 19, 2004

Dorothy J. Overfield, Manager
Northwest Rural Water District
P.O. Box 2347
Cody, Wyoming 82414

RE: Northwest Rural Water District - Stambaugh Treated Waterline Extension - Permit Number:
04-072, NE1/4 Section 23 O.S., T55N, R99W, Park County, PWS # 5601254

Dear Ms. Overfield:

The above application for coverage under General Permit to Construct a water line extension to serve 6 rural water services consisting of 1300 linear feet (LF) of 2-inch water main and appurtenances in accordance with Chapter 3, Section 7 and Chapter 12, Section 14 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Mark Baron, P.E.
Environmental Senior Analyst
Water Quality Division

cc: ~~IPS, Cheyenne~~

encl: General Permit For a Public Water Supply Distribution System

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-073R

Big Piney Elevated Water Storage Tank Project
PWS: 5600007

This permit hereby authorizes the applicant:

Town of Big Piney
P.O. Box 70
Big Piney, WY 83113

to construct, install or modify a 200,000 gallon elevated water storage tank and appurtenances according to the procedures and conditions of the application number 04-073R. The facility is located in Section 36, T30N, R112W in the county of Sublette, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by May 30, 2006.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

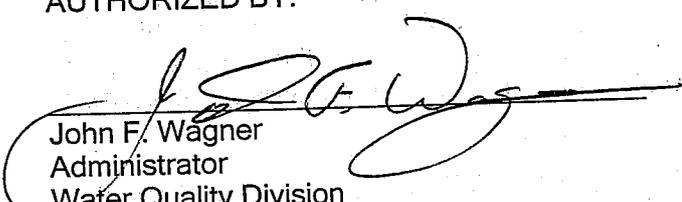
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

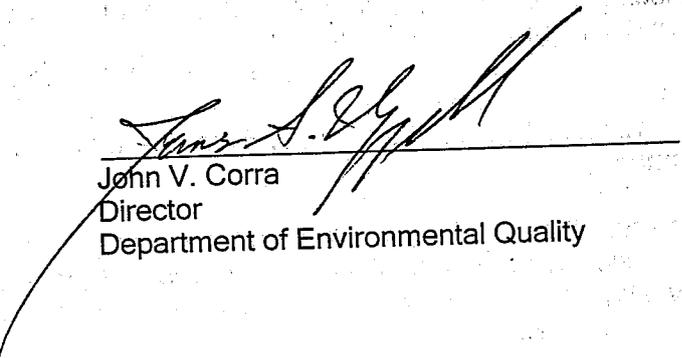
In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 3 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/ Water Quality Division, SW District, 250 Lincoln Street, Lander, WY 82520, 307-332-3144, fax 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 3 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the SW District a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.
- 3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division

May 13, 2004
Date of Issuance


John V. Corra
Director
Department of Environmental Quality

JVC/JFW/DHC/pf/4-485-ltr

STATEMENT OF BASIS

1. Permit Number: 04-073R
2. Application reviewed for compliance with the following regulations :
Chapter 12 of the Wyoming Water Quality Rules and Regulations
3. Does the permit comply with all applicable regulations identified above?
Yes
4. A review to determine groundwater impacts in accordance with Section 17, Chapter 3.
Not required. Public water supplies are exempted from review by Chapter 3, Section 17.
5. Documentation of Statement of Basis: The archives file for this permit include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Doyle Conklin, dconkl@state.wy.us, SW District Engineering Supervisor, and completed on May 11, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307)777-7758 FAX 777-3610	ABANDONED MINES (307)777-6145 FAX 777-6462	AIR QUALITY (307)777-7391 FAX 777-5616	INDUSTRIAL SITING (307)777-7369 FAX 777-6937	LAND QUALITY (307)777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307)777-7752 FAX 777-5973	WATER QUALITY (307)777-7781 FAX 777-5973
---	--	--	--	---	---	--

NOTIFICATION OF COVERAGE

March 12, 2004

Rex T. Erickson
34 Rick Road
P.O. Box 1117
Wheatland, Wyoming 82201

RE: Erickson Residential Septic System, Application No. **04-074**
Location: SW1/4 SE1/4, Section 23, T24N, R68W, Platte County

Dear Mr. Erickson:

The above application for coverage under General Permit to Construct, Install, Modify or Operate a Small Wastewater Facility in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the small wastewater system in accordance with Chapter 11, Part D of the Water Quality Division Rules and Regulations, the general permit, the condition listed below, and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Additionally, the following project specific condition also applies:

Septic Tank Clean-Out Riser Requirement - Either a 6 inch diameter clean-out riser or the manway from **each compartment of the tank** must be extended to the ground surface.

The approval granted under this Notification Of Coverage and the General Permit shall expire on October 26, 2005. Please reference Application Number **04-074** in any future correspondence.

If you have any questions, please contact me at (307) 777-6183.

Sincerely,

Ronald L. Ewald
Environmental Senior Analyst
Southeast District, Water Quality Division

RLE/mad 4-0255-ltr

cc: IPS, Cheyenne

Platte County Planner, Marlin Johnson, P.O. Box 728, Wheatland, Wyoming 82201

Enclosures: GENERAL PERMIT - Small Wastewater Facility
Certificate of Completion



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307)777-7758 FAX 777-3610	ABANDONED MINES (307)777-6145 FAX 777-6462	AIR QUALITY (307)777-7391 FAX 777-5616	INDUSTRIAL SITING (307)777-7369 FAX 777-6937	LAND QUALITY (307)777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307)777-7752 FAX 777-5973	WATER QUALITY (307)777-7781 FAX 777-5973
---	--	--	--	---	---	--

NOTIFICATION OF COVERAGE

March 17, 2004

Mr. Herman Noe, Manager of Engineering
Cheyenne Board of Public Utilities
P.O. Box 1469
Cheyenne WY 82003-1469

RE: Cheyenne BOPU Campstool 3rd Filing, Application No.04-075, Laramie County

Dear Mr. Noe:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems and of Existing Sewage Collection Systems described as 5280 ft of new 8-16" dia. water main and 3290' of sanitary sewer line, W ½ Section 31 T14N R65W; Laramie County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, the sewage collection system in accordance with Chapter 11, Section 9 of the Water Quality Division Rules and Regulations, and both systems in accordance with the general permit and the materials submitted in your application package. All service connections will be protected by the appropriate backflow device as required by Chapter 12, Section 14(i) of the Water Quality Division Rules and Regulations. All construction, installation, or modification allowed by this notification of coverage shall be completed by August 11, 2006.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 04-075 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne
Bruce Perryman, AVI pc
2035 Westland Road
Cheyenne WY 82001

LBH/mad/4-0279-ltr



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE EXTENSION OF COMPLETION DATE

May 24, 2006

Mr. Herman Noe, Manager of Engineering
Cheyenne Board of Public Utilities
P.O. Box 1469
Cheyenne, WY 82003-1469

RE: Cheyenne BOPU Campstool 3rd Filing, Application No.04-075, Laramie County

Dear Mr. Noe:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems and of Existing Sewage Collection Systems described as 5280 ft of new 8-16" dia. water main and 3290' of sanitary sewer line, W 1/2 Section 31 T14N R65W; Laramie County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations was originally issued March 17, 2004. All construction, installation, or modification allowed by this notification of coverage was to be completed by August 11, 2006. This extension allows the completion date to be extended to March 17, 2009.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 04-075 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

LBH/jc/6-0461

cc: IPS, Cheyenne
Ryan Rigg P.E., AVI pc
2035 Westland Road
Cheyenne, WY 82001

Herschler Building • 122 West 25th Street • Cheyenne, WY 82002 • <http://deq.state.wy.us>

ADMIN/OUTREACH
(307) 777-7758
FAX 777-3610

ABANDONED MINES
(307) 777-6145
FAX 777-6462

AIR QUALITY
(307) 777-7391
FAX 777-5616

INDUSTRIAL SITING
(307) 777-7369
FAX 777-6937

LAND QUALITY
(307) 777-7756
FAX 777-5864

SOLID & HAZ. WASTE
(307) 777-7752
FAX 777-5973

WATER QUALITY
(307) 777-7781
FAX 777-5973





The State
of Wyoming

Department of Environmental Quality



Dave Freudenthal, Governor

3030 Energy Lane • Suite 200 • Casper, Wyoming 82604

SOLID & HAZARDOUS WASTE DIVISION
(307) 473-3450
Fax: (307) 473-3458

AIR QUALITY DIVISION
(307) 473-3455
Fax: (307) 473-3458

WATER QUALITY DIVISION
(307) 473-3465
Fax: (307) 473-3458

ABANDONED MINES
(307) 473-3460
Fax: (307) 473-3458

NOTIFICATION OF COVERAGE

April 21, 2004

Hal H. Hutchinson, PE
City Engineer
City of Casper
200 N. David
Casper, WY 82601

RE: 2004 Miscellaneous Water Main Replacement Project, Application No. 04-076

Dear Hal:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modification of Existing Public Water Supply Distribution Systems in accordance with Chapter 3 and Chapter 12 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the facility(ies) in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit.

The following additional requirements are conditions of this coverage:

1. All commercial and industrial customers located within water main replacement areas which are not already in compliance with cross connection requirements will be inspected. An appropriate compliance schedule, not to exceed 30 months, will be established dependent upon the degree of hazard and the cost of the retrofit installation. The City of Casper will be responsible to insure compliance.
2. Residential customers within water main replacement areas will be on an appropriate schedule to install dual check valves, expansion tanks, and pressure relief valves. This time frame shall not exceed 30 months, and follow up will take place to insure compliance.

Hal H. Hutchinson

April 21, 2004

Page 2 of 2

3. The City of Casper Uniform Plumbing Code will be amended to require dual check valves and accompanying expansion tanks/pressure relief valves for new construction.

4. Within six months, the City of Casper will revise its Cross Connection Control Ordinance to require dual check valves for all residential services.

If you have any questions, please contact Dennis Lamb or myself at 307-473-3465.

Sincerely,

Kevin J. Frank

Kevin J. Frank, PE
Senior Analyst
Water Quality Division

cc: IPS, Cheyenne



The State
of Wyoming



Department of Environmental Quality
1043 Coffeen Avenue, Suite D • Sheridan, Wyoming 82801

Dave Freudenthal, Governor

AIR QUALITY
(307) 672-6457
Fax (307) 674-6050

LAND QUALITY
(307) 672-6488
Fax (307) 672-2213

WATER QUALITY
(307) 672-6457
Fax (307) 674-6050

NOTIFICATION OF COVERAGE

March 12, 2004

Tom Davis
P.O. Box 232
Moorcroft, WY 82721

RE: Tom Davis Single Family Wastewater System, Permit # 04-078

Dear Tom:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of a small wastewater septic system in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit. **A minimum of two (2) photos of the system installation shall accompany the Certificate of Completion submitted to this office.** All construction, installation, or modification allowed by this permit shall be completed by March 1, 2005.

If you have any questions please contact me at 1043 Coffeen Avenue, Suite D, Sheridan, WY, 82801, (307) 672-6457. Thank you.

Sincerely,

Rick J. Estes, P.E.
WDEQ/WQ NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Rob Anderson, 320 Pine Ridge Road, Moorcroft, WY 82721



Department of Environmental Quality

To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.



Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

June 30, 2004

Mr. Homer Scott Jr.
Powder Horn LLC
P.O. Box 2007
Sheridan, WY 82801

RE: Powder Horn Golf Club Clubhouse Water Service/Fire Line , Permit # 04-079

Dear Mr. Scott:

The above application for coverage under General Permit to Construct, Install, Modify or Operate a extension to the SAWS Water Distribution System in accordance with Chapter 3 and Chapter 12 of the WWQRR has been reviewed and is hereby approved. Our review of the information and as-constructed plans submitted to this office indicates that the application meets WDEQ/WQD regulations and the enclosed As-Built Permit To Construct is hereby issued.

Please be advised that the system must be operated in accordance with the statements, representations and procedures presented in the application and all supporting documentation as well as the terms and conditions of the permit. You are urged to be familiar with all aspects of the permit application, permit and permit conditions.

If you have any questions please contact me at 1866 S. Sheridan Avenue, Sheridan, WY, 82801, (307) 673-9337.

Sincerely,

Rick J. Estes, P.E.
WDEQ/WQD NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Bill Mentock, PE/LS 3864, Mentock -Willey Consultants, 1030 N. Main St., Sheridan, WY 82801
Bruce Yates, PE, Sheridan County Engineer/SAWS Manager
Mike Cole, PE, Assistant City of Sheridan Public Works Director

Page 1 of 1





The State
of Wyoming



Department of Environmental Quality
1043 Coffeen Avenue, Suite D • Sheridan, Wyoming 82801

Dave Freudenthal, Governor

AIR QUALITY
(307) 672-6457
Fax (307) 674-6050

LAND QUALITY
(307) 672-6488
Fax (307) 672-2213

WATER QUALITY
(307) 672-6457
Fax (307) 674-6050

NOTIFICATION OF COVERAGE

March 18, 2004

Mike Turner
325 Ertman Rosd
Newcastle, WY 82701

RE: Mike Turner As-Built Septic System, Permit # 04-080

Dear Mike:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of small wastewater septic in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. Our review of the information and as-constructed plan submitted to this office indicates that the application meets DEQ/WQD regulations and the enclosed As-Built Permit To Construct is hereby issued.

Please be advised that the system must be operated in accordance with the statements, representations and procedures presented in the application and all supporting documentation as well as the terms and conditions of the permit. You are urged to be familiar with all aspects of the permit application, permit and permit conditions.

If you have any questions please contact me at 1043 Coffeen Avenue, Suite D, Sheridan, WY, 82801, (307) 672-6457. Thank you.

Sincerely,

Rick J. Estes, P.E.
WDEQ/WQ NE District Senior Environmental Analyst

cc: IPS, Cheyenne



The State
of Wyoming



Department of Environmental Quality
1043 Coffeen Avenue, Suite D • Sheridan, Wyoming 82801

Dave Freudenthal, Governor

AIR QUALITY
(307) 672-6457
Fax (307) 674-6050

LAND QUALITY
(307) 672-6488
Fax (307) 672-2213

WATER QUALITY
(307) 672-6457
Fax (307) 674-6050

NOTIFICATION OF COVERAGE

March 16, 2004

Mr. Bruce Hepp
Mayor
Town of Buffalo
40 N. Main
Buffalo, WY 82834


RE: 2004 Sewer Replacement-Town of Buffalo , Permit # 04-081

Dear Bruce:

The above application for coverage under General Permit to Construct, Install, Modify or Operate a extension to the City of Buffalo Wastewater Collection System in accordance with Chapter 3 and Chapter 11 of the WWQRR has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permits. All construction, installation, or modification allowed by this permit shall be completed by April 1, 2005.

If you have any questions please contact me at 1043 Coffeen Avenue, Suite D, Sheridan, WY, 82801, (307) 672-6457. Thank you.

Sincerely,


Rick J. Estes, P.E.
WDEQ/WQD NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Keith A. Neustel, PE, Grizzly Engineering, P.O. Box 1004, Buffalo, WY 82834

DEPARTMENT OF ENVIRONMENTAL QUALITY
STATE OF WYOMING
UNDERGROUND INJECTION CONTROL PERMIT
AUTHORIZATION TO DISCHARGE INTO UNDERGROUND RECEIVERS
ISSUED UNDER CHAPTER 16, WATER QUALITY RULES AND REGULATIONS

(X) New
() Modified

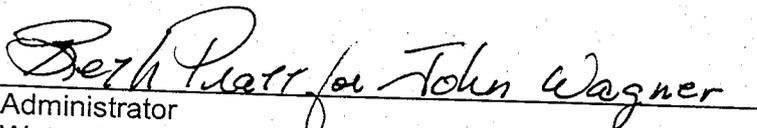
Permit Number: UIC 04-082
Subclass Number: 5E3

In compliance with the Wyoming Environmental Quality Act (W.S. 35-11-101 through 1104, specifically 301(a)(i) through (iv), Laws 1973, Ch. 250, Section 1) and Water Quality Rules and Regulations, Chapter 3 (2000), and Chapter 16 (2001),

Applicant: U.S. National Park Service, Grand Teton National Park
P.O. Box 170
Moose, WY 83012
(307) 739-3357

is authorized to operate the U.S. National Park Service, Grand Teton National Park Lupine Meadows West Large Capacity Septic System in the SE $\frac{1}{4}$ SE $\frac{1}{4}$ Section 26, Township 44 North, Range 116 West, of the 6th Principal Meridian; according to the procedures and conditions of application # UIC 04-082 and other conditions of this permit.


is permit shall become effective on date of issuance.



Administrator
Water Quality Division
Herschler Building, 122 West 25th Street
Cheyenne, WY 82002
Phone: (307) 777-7781

6/3/04

Date



Director
Department of Environmental Quality
Herschler Building, 122 West 25th Street
Cheyenne, WY 82002

6/3/04

Date

TABLE OF CONTENTS

A.	DISCHARGE ZONE AND AREA OF REVIEW	2
	1. Discharge Zone:	2
	2. Area of Review	2
B.	GROUNDWATER CLASSIFICATION	2
C.	AUTHORIZED OPERATIONS	3
D.	ENVIRONMENTAL MONITORING PROGRAM FOR GROUND WATERS OF THE STATE	3
E.	REQUIREMENTS FOR MONITORING THE DISCHARGE	4
F.	RECORDS AND REPORTS	5
G.	GENERAL CONDITIONS	7
H.	DUTIES OF GRAND TETON NATIONAL PARK	7
I.	SPECIAL MEASURES THE DIRECTOR FINDS NECESSARY:	7
J.	SIGNATORIES REQUIREMENT	8

A. DISCHARGE ZONE AND AREA OF REVIEW

1. Discharge Zone:
This injection facility (sanitary leachfield) is authorized to inject into the Alluvial Aquifer along the Cottonwood Creek which is found at this location from zero to 50 feet below the ground surface.

2. Area of Review
The facility authorized by this permit is located in:

Township 44 North, Range 116 West, 6th Principal Meridian
 Section 26: SE $\frac{1}{4}$ SE $\frac{1}{4}$

 The Area of Review around this facility is legally described as:

Township 44 North, Range 116 West, 6th Principal Meridian
 Section 26: SE $\frac{1}{4}$

B. GROUNDWATER CLASSIFICATION

1. The groundwater in the alluvial aquifer along the Cottonwood Creek is classified as class I (Domestic) under Chapter 8 of Wyoming Water Quality Rules and Regulations (March 11, 1993). This classification was made because: The groundwater in this formation is currently being used for domestic purposes at several points of withdrawal.

2. Groundwater of class I shall not be degraded so as to make it unusable as a source of water for this purpose. Any parameters which do not meet the class of use standard shall not be degraded whatsoever.

AUTHORIZED OPERATIONS

Grand Teton National Park is authorized to inject 19 barrels per day, (800 gallons per day) through the existing septic system, and 67 barrels per day, (2,800 gallons per day) through a new septic system. The wastewater is described as sanitary waste only from residential sources. Grand Teton National Park is authorized to inject at a pressure of no more than 10 psi as measured at the leachfield. This pressure is controlled by gravity drainage and is not required to be monitored.

Hazardous Waste This permit does not allow for the injection of any hazardous waste as defined by 40 CFR 261. Injection of any substance defined as hazardous waste, whether hazardous by listing or by characteristic is a violation of this permit.

In the event that any septic system covered by this permit is converted at any time to any other use, additional capacity may be required for the septic system. Any such conversion shall be reported to the DEQ in the form of a modified permit application showing that all required capacity exists for the newly converted system.

D. ENVIRONMENTAL MONITORING PROGRAM FOR GROUND WATERS OF THE STATE

1. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
2. Grand Teton National Park shall prepare records of all monitoring information to be retained for a period of at least 3 years after closure of the facility.
3. Records of monitoring information shall include:
 - a. The date, exact place, and time of sampling or measurements;
 - b. The name(s) of individual(s) who performed the sampling or measurements;
 - c. The date(s) analyses were performed;
 - d. Names of individuals who performed the analyses;
 - e. The analytical techniques or methods used; and
 - f. The results of such analyses.
4. The groundwater in the receiving formation shall be sampled and the following parameters analyzed according to the following schedule and reported annually by December 1 of each year.

WELL NAME OR NUMBER	SAMPLING SCHEDULE	ANALYTICAL METHOD	PARAMETER ANALYZED	PERMIT LIMIT (UCL)*
Three Monitor Wells shown on drawing 60,151 in the application	Annually in the Fall	EPA Method 350.3	Ammonia as N	.500
		EPA Method 353.2	Nitrate as N	10.0
		any method	Fecal Coliform	1/100 ml
			Water Elevation	no limit

*All chemical concentrations in this permit are expressed in mg/l unless otherwise noted.

The above Upper Control Limit (UCL) is not to be exceeded in any sample. Exceedance of this value is a violation of this permit and shall require corrective action. In the event that any of the above UCL's are exceeded, the Grand Teton National Park shall immediately sample all domestic use wells on their property for Total Coliform Bacteria.

After the first two years of operation, the Water Quality Division may, without reissuing this permit, waive further monitoring of any parameter from the above list or may require additional monitoring based on new information about the nature of the waste. The Grand Teton National Park shall report the results of all analysis done, regardless of whether those analysis were required by this permit. The Water Quality Division may also, after the first two years of operation, approve a more or less stringent monitoring schedule.

E. REQUIREMENTS FOR MONITORING THE DISCHARGE

Grand Teton National Park shall monitor the quality of the injected fluid on the following schedule. The following parameters shall be analyzed by the listed methods and reported annually:

SAMPLING SCHEDULE	ANALYTICAL METHOD	PARAMETER ANALYZED	PERMIT LIMIT (UCL) *
Annually in the Fall	EPA Method 350.3	Ammonia as N	150.0

*All chemical concentrations in this permit are expressed in mg/l unless otherwise noted. The above Upper Control Limit (UCL) is not to be exceeded in any sample. Exceedance of this value is a violation of this permit and shall require corrective action. In the event that any contaminant is found to exceed the above UCL's the Grand Teton National Park shall undertake a study to determine and eliminate the source of that contaminant from the waste stream. Any parameter found to be exceeding the above UCL shall be sampled for in the down gradient wells if not already sampled for. Grand Teton National Park shall sample the down gradient well within 30 days of the date that it becomes aware of any exceedance of the above UCL's. After the first year of operation, the Water Quality Division may, without reissuing this permit, waive further monitoring of any parameter from the above list or may require additional monitoring based on new information about the nature of the waste. The Water Quality Division may also, after the first year of operation, approve a more or less stringent monitoring schedule.

F. RECORDS AND REPORTS

1. Grand Teton National Park shall retain copies of all reports required by this permit, and records of all data used to complete the application for this permit, for a period of at least 3 years from the date of the report or application.
2. Grand Teton National Park shall give notice to the administrator as soon as possible of any planned physical alterations or additions to the permitted facility.
3. Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this permit shall be submitted no later than 30 days following each schedule date.

4. Grand Teton National Park shall report any noncompliance which may endanger health or the environment, orally within 24 hours from the time Grand Teton National Park becomes aware of the circumstances. The report should include:
 - a. Any monitoring or other information which indicates that any contaminant may cause an endangerment to a usable groundwater of the state.
 - b. Any noncompliance with a permit condition or malfunction of the discharge (injection) system which may cause fluid migration into or between usable ground waters of the state.

A written submission shall be provided within 5 days of the time Grand Teton National Park becomes aware of the circumstances. This written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected; the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.

5. Grand Teton National Park shall report all instances of noncompliance not reported otherwise, at the time monitoring reports are submitted; such reports shall contain the information listed in 4. above.
6. When Grand Teton National Park becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the administrator, it shall promptly submit such facts or information.
7. Grand Teton National Park shall retain all records concerning the nature and composition of injected fluids until 5 years after completion of any specified plugging and abandonment procedures. The administrator may require the owner/operator to deliver the records to the administrator at the conclusion of the retention period.
8. A subsurface discharge (injection) well may not commence subsurface discharge (injection) until, following public notice and an opportunity for hearing, a groundwater pollution control permit has been issued by the department for the proposed operation, and:
 - a. Well construction is complete and Grand Teton National Park has submitted notice of completion of construction to the administrator,
 - b. The administrator has inspected or otherwise reviewed the subsurface discharge (injection) well and finds it in compliance with the conditions of the permit; or Grand Teton National Park has not received notice from the administrator of intent to inspect or otherwise review the facility within 13 days of the notice of a. above, in which case prior inspection or review is waived, and
 - c. Grand Teton National Park has submitted, and the Water Quality Division has approved, an Operation and Maintenance Manual for both the septic system and the public water system.
9. The annual report of operations for this facility shall be submitted on forms provided by the department and shall include the following information:
 - a. Any permit exceedances within the previous year.

- b. The analytical results for sampling for the injected water and any groundwater sampling results required under Section D or E of this permit.
 - c. Annual reports are due in the Cheyenne office of the Water Quality Division no later than December 1 of each year.
10. A comprehensive report for an aborted or curtailed operation authorized by this permit shall be submitted to the administrator within 30 days of complete termination of the injection (discharge) or associated activity, in lieu of an annual report.

G. GENERAL CONDITIONS

1. After notice and opportunity for a hearing, a permit may be modified, suspended or revoked in whole or part during its term for cause which includes, but is not limited to, any of the following:
 - a. Violation of the permit;
 - b. Obtaining a permit by misrepresentation or failure of the discharge well or system.
2. Each permit is reviewed at least once every 5 years, and may be reviewed more frequently.
3. A permit may be modified at any time as may be required, including for conformity with changes in regulations or standards which occur after the permit is issued. A permit may be modified in whole or part in order to apply more, or less, stringent standards; or prohibitions for a toxic or other substance present in Grand Teton National Park's discharge, as may be ordered by the council. This permit can be terminated by authority of the administrator for one or more permit violations.
4. Public notice of the permit review and request for public comment will be made every 10 years by the administrator.
5. Any permit noncompliance constitutes a violation of the permit.
6. The filing of a request by Grand Teton National Park for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance, does not stay any permit condition.
7. The owner/operator of record (permittee) is always responsible for permit compliance. A permit holder cannot transfer his permit without approval of the department director.
8. Nothing in this permit shall be construed to preclude the institution of any legal action or relieve Grand Teton National Park from any responsibilities, liabilities or penalties established pursuant to any applicable state law or regulation.
9. The issuance of this permit does not convey any property rights in either real or personal property, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.
10. The provisions of this permit are severable, and if any provision of the permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.
11. Pollution or waste which migrates into an aquifer containing a usable groundwater of the state is a violation of the permit.

DUTIES OF GRAND TETON NATIONAL PARK

It is a duty of Grand Teton National Park to:

1. Comply with all permit conditions;
2. Halt or reduce activity -- it shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce Grand Teton National Park activity in order to maintain compliance with the permit conditions;
3. Take all reasonable steps to minimize or correct any adverse impact on the environment resulting from noncompliance with this permit; and
4. Furnish to the administrator within a reasonable time, any information which the administrator may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with this permit; and furnish to the administrator, upon request, copies of records required to be kept by this permit.

I. SPECIAL MEASURES THE DIRECTOR FINDS NECESSARY:

1. In the event that sewage is found to be surfacing from the leachfield covered by this permit, this is a violation of this permit and shall be reported immediately as required by Section F of this permit. In the event that the leachfield covered by this permit should fail, it is not necessary to modify this permit to allow for the replacement leachfield to be installed, so long as the construction specifications remain the same. Grand Teton National Park shall submit a plan showing the location of the replacement area for department approval prior to the installation of any replacement leachfield. Grand Teton National Park shall notify the department that the replacement leachfield is to be installed within 90 days of determining that the primary leachfield has failed.
2. The Grand Teton National Park shall notify the Ray Shriver, Teton County Engineering Department, P.O. Box 3594, Jackson, WY 83001, (307) 733-3317 at least five days prior to installing the septic system to arrange for an on-site inspection of the facility.

J. SIGNATORIES REQUIREMENT

1. All reports required by this permit and other requested information shall be signed as follows:
For a corporation -- by a principal executive officer of at least the level of vice-president;
For a partnership or sole proprietorship -- by a general partner or the proprietor, respectively;
For a municipality, state, federal or other public agency -- by either the principal executive officer or ranking elected official.
By a duly authorized representative for any of the above. A person is a duly authorized representative only if:
 - a. The authorization is made in writing by one of the described principals;
 - b. The authorization specifies either an individual or position having responsibility for the overall operation of the regulated facility or activity; and
 - c. The written authorization is submitted to the administrator.

2. If an authorization is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization must be submitted to the administrator prior to or together with any reports or information, to be signed by an authorized representative.
3. Any person signing a report or other requested information shall make the following certification:

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment."

RFL/pf/4-0553-ltr



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

3030 Energy Lane • Suite 200 • Casper, Wyoming 82604

SOLID & HAZARDOUS WASTE DIVISION
(307) 473-3450
Fax: (307) 473-3458

AIR QUALITY DIVISION
(307) 473-3455
Fax: (307) 473-3458

WATER QUALITY DIVISION
(307) 473-3465
Fax: (307) 473-3458

ABANDONED MINES
(307) 473-3460
Fax: (307) 473-3458

NOTIFICATION OF COVERAGE

March 15, 2004

Matt Garland
MGM Enterprises Inc.
P. O. Box 3300
Gillette, WY 82717

RE: MGM Enterprises Inc. Small Wastewater, Permit # 04-083

Dear Mr. Garland:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of a small wastewater septic system in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit. **A minimum of two (2) photos of the system installation shall accompany the Certificate of Completion submitted to this office.** All construction, installation, or modification allowed by this permit shall be completed by March 1, 2005.

If you have any questions please contact Dennis Lamb at 3030 Energy Lane, Casper, WY, 82604, (307) 473-3452. Thank you.

Sincerely,

Dennis Lamb
WDEQ/WQ NE District Supervisor

cc: IPS, Cheyenne



The State
of Wyoming



Department of Environmental Quality
1043 Coffeen Avenue, Suite D • Sheridan, Wyoming 82801

Dave Freudenthal, Governor

AIR QUALITY
(307) 672-6457
Fax (307) 674-6050

LAND QUALITY
(307) 672-6488
Fax (307) 672-2213

WATER QUALITY
(307) 672-6457
Fax (307) 674-6050

NOTIFICATION OF COVERAGE

March 29, 2004

Mr. Phillip Sieler
Box 7013
Pierre, SD 57501

RE: Phillip Sieler Residential **As-Built** Septic System, Permit # 04-085

Dear Phillip:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of small wastewater septic in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. Our review of the information and as-constructed plan submitted to this office indicates that the application meets WDEQ/WQD regulations and the enclosed As-Built Permit To Construct is hereby issued. Please be advised that the system must be operated in accordance with the statements, representations and procedures presented in the application and all supporting documentation as well as the terms and conditions of the permit. You are urged to be familiar with all aspects of the permit application, permit and permit conditions.

If you have any questions please contact me at 1043 Coffeen Avenue, Suite D, Sheridan, WY, 82801, (307) 672-6457. Thank you.

Sincerely,

Rick J. Estes, P.E.
WDEQ/WQ NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Allan Schreier, PE, 11160 Snoma Road, Belle Fourche, SD 57717



The State
of Wyoming

Department of Environmental Quality

Dave Freudenthal, Governor

3030 Energy Lane • Suite 200 • Casper, Wyoming 82604



SOLID & HAZARDOUS WASTE DIVISION
(307) 473-3450
Fax: (307) 473-3458

AIR QUALITY DIVISION
(307) 473-3455
Fax: (307) 473-3458

WATER QUALITY DIVISION
(307) 473-3465
Fax: (307) 473-3458

ABANDONED MINES
(307) 473-3460
Fax: (307) 473-3458

NOTIFICATION OF COVERAGE

April 22, 2004

David Keanini, VP Engineering & Safety
Lance Oil and Gas
1099 18th Street
Suite 1200
Denver, CO 80202

RE: Lance Oil and Gas Coal Gulch Unit CBM Water Treatment Pilot Project, Permit #
04-086

Dear Mr. Keanini:

The above application for coverage under General Permit to Construct, Install, Modify or Operate a Pilot Plant in accordance with Section 5, Chapter 11, of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit.

If you have any questions please contact Dennis Lamb at 3030 Energy Lane, Casper, WY, 82604, (307) 473-3452. Thank you.

Sincerely,

Dennis Lamb
NE District Supervisor
DEQ/WQD

cc: IPS, Cheyenne



The State
of Wyoming

Department of Environmental Quality

Dave Freudenthal, Governor

3030 Energy Lane • Suite 200 • Casper, Wyoming 82604



SOLID & HAZARDOUS WASTE DIVISION
(307) 473-3450
Fax: (307) 473-3458

AIR QUALITY DIVISION
(307) 473-3455
Fax: (307) 473-3458

WATER QUALITY DIVISION
(307) 473-3465
Fax: (307) 473-3458

ABANDONED MINES
(307) 473-3460
Fax: (307) 473-3458

NOTIFICATION OF COVERAGE

April 7, 2004

Kieth Tyler
Bypass Industrial Park, Inc.
140 North Center
Casper, WY 82601

RE: Bypass Industrial Park Improvements, Permit # 04-087

Dear Mr. Tyler:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of existing sewage collection systems in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) and General Permit to Construct, Install, Modify or Operate a water distribution system in accordance with Chapter 3 and Chapter 12 of the WWQRR have been reviewed and are hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit.

If you have any questions please contact Dennis Lamb at 3030 Energy Lane, Casper, WY, 82604, (307) 473-3452. Thank you.

Sincerely,

Dennis Lamb
NE District Supervisor
DEQ/WQD

cc: IPS, Cheyenne

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-088R

Fox Creek Campground-Shoshone National Forest -Park County
PWS # no number assigned

This permit hereby authorizes the applicant:

Rebecca Aus, Forest Supervisor
Shoshone National Forest
808 Meadow Lane
Cody, WY 82414

to construct a public water supply distribution system consisting of a water well, distribution mains, a 1600 gallon storage tank, booster pumps, chlorine disinfection system, and a sewage collection system consisting of 5000 and 2000 gallon holding tanks, and a RV dump station, according to the procedures and conditions of the application number 04-088R. The facility is located at NE1/4 SE1/4 Section 30,T58N, R107W in the county of Park, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by May 20, 2006.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

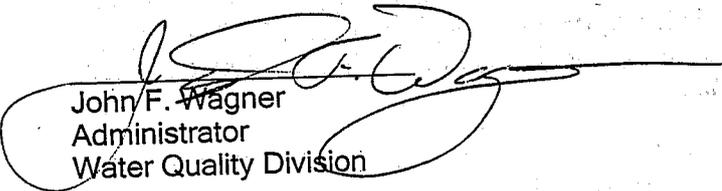
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.


The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality, Water Quality Division (WQD), Northwest District Engineer, 250 Lincoln Street, Lander, WY 82520, 307-332-3144, FAX 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northwest District a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
- a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.
- 3 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".
- 4 of 4 Water quality data for the well, such as that for bacteriological contaminants, inorganic contaminants (IOC), volatile organic contaminants (VOC), synthetic organic contaminants (SOC), and radio nuclide contaminants must be submitted upon completion of the water well. The well water quality must be in compliance with the United States Environmental Protection Agency National Primary Drinking Water Standards.

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John V. Corra
Director
Department of Environmental Quality

5/25/04
Date of Issuance
MDB/mdb
bb/4-0509.ltr

STATEMENT OF BASIS

1. Permit Number: 04-088R
2. Application reviewed for compliance with the following regulations:
Chapters 3, 11 and 12 of the Wyoming Water Quality Rules and Regulations.
3. Does the permit comply with all applicable regulations identified above?
No
4. Facilities include components not specifically covered by regulations and approval is based upon a deviation from applicable regulations in accordance with Section 5 of applicable regulations. (Include this section only if the answer to item 3. above is no and the permit approval is based upon a deviation in accordance with Section 5.)
 - a. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.

The permit includes approval to deviate from the following regulatory requirements:

 - 1) Chapter 12, Section 6 (c)(v)(A)(II) requires water quality data such as that for bacteriological contaminants; inorganic contaminants (IOC), volatile organic contaminants (VOC), synthetic organic contaminants (SOC) and radio nuclide contaminants to be submitted.
 - 2) Chapter 12, Section 9 (b)(ii)(A) limits the design pumping rate to 1.5 times the test pump capacity at the stabilized drawdown.
 - b. Briefly state the basis for the deviation.
 - 1) The permit is conditioned such that the water quality data will be submitted before the water well is put into service.
 - 2) The water well will only serve a campground which will be only open for 5 months per year. The aquifer, therefore, will have 7 months to recharge.
4. If Section 17 of Chapter 3 review is required indicate the basis for determining groundwater will be protected.

Not required. Public Water Supplies and Sewerage Systems are exempted from review by Chapter 3, Section 17.
5. Documentation of Statement of Basis: The archives file for this permit includes adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Mark D. Baron, mbaron@state.wy.us, Environmental Senior Analyst and completed on May 20, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

MDB/bb/4-0509.ltr

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-089

Country Meadow Estates WWTP

This permit hereby authorizes the applicant:

Country Meadow Estates Mobile Home Park
4746 Skyline Drive #39
Laramie, WY, 82070

to construct, install or modify an installation of a 30,000 gallon per day Case-Cotter extended aeration wastewater treatment plant according to the procedures and conditions of the application number 04-089. The facility is located in NW 1/4 Section 12 T15N R72W in the county of Albany, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by August 11, 2006.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

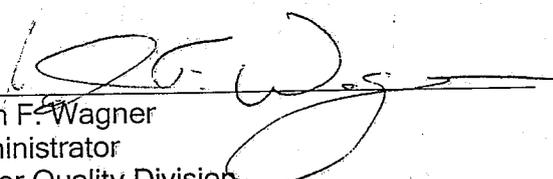
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.


In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 4 The applicant will provide immediate oral or written notice to the Southeast District, Water Quality Division, Herschler Building 4 West, Cheyenne, WY, 82002, Phone 307-777-7088, FAX 307-777-5973, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 4 Before the new package treatment plant is placed into service an O&M manual for the wastewater facilities for Country Meadows Estates Mobile Home Park must be approved. This O&M manual is not the manual that comes with the new package plant. The O&M manual must explain not only the procedures for using the new plant, but how the old plant will be maintained and how it will be utilized. The O&M manual should also discuss operation of the chlorinator, the use of the flow measurement weir, and the sampling necessary to satisfy the requirements of the NPDES discharge permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Southeast District, Water Quality Division, Herschler Building 4 West, Cheyenne, WY, 82002 a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division

3/24/04
Date of Issuance


John V. Corra
Director
Department of Environmental Quality

LBH/pf/4-0301-ltr

cc : Roland Peterson
Albany County Planning Office

STATEMENT OF BASIS

1. Permit Number: 04-089
2. Application reviewed for compliance with the following applicable regulations :
Chapter 11 of the Wyoming Water Quality Rules and Regulations
3. Does the permit comply with all applicable regulations identified above?
YES
4. A review to determine groundwater impacts in accordance with Section 17, Chapter 3 was not required. The package plant does not allow a discharge to the groundwater.
5. Documentation of Statement of Basis: The archives file for this permit include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Louis B. Harmon PE-PG, Southeast District Engineer, lharmo@state.wy.us, and completed on March 22, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-090

Bio Action T1 Portable WWTP Pilot Study

This permit hereby authorizes the applicant:

Ralph Brown
Bio Action Wastewater Treatment, L.L.C.
13440 Canyon Hill Road C2
Thermopolis, WY 82443

to construct a pilot plant study of a portable wastewater treatment plant conducted at the Riverton Wastewater Treatment Plant according to the procedures and conditions of the application number 04-090. The facility is located in NW1/4 Sec.36, T1N, R4E, Wind River Meridian in the county of Fremont, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by March 29, 2006.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 5 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/ Water Quality Division, Northwest District, 250 Lincoln Street, Lander, WY 82520, 307-332-3144, fax 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 5 The plant must be dosed at as near the anticipated field conditions as possible. The total daily flow rate as well as the individual dose times and rates must be recorded and reported with the plant monitoring data.
- 3 of 5 The pilot plant shall be monitored for the following parameters and frequency:

Plant Influent - Riverton raw wastewater

BOD	two times per week
TSS	two times per week
Temperature	two times per week
pH	two times per week
ammonia (N)	monthly

Samples must be 24 hour composite/flow proportioned.

Hydro Action AP 500 Tank

MLSS	At start-up and then two times per week
Temperature	daily
pH	daily
DO	daily

Plant effluent - pre chlorination

BOD	Initial discharge and then daily 1st week, then two times per week
TSS	daily 1st week, then two times per week
Nitrates + Nitrites	daily 1st week, then two times per week
Ammonia (N)	daily 1st week, then two times per week
Fecal coliform bacteria	daily 1st week, then two times per week
Temperature	daily 1st week, then two times per week
pH	daily 1st week, then two times per week

Plant effluent - post chlorination

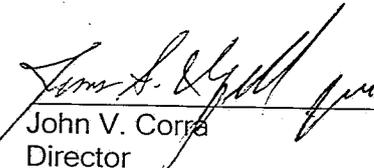
Fecal coliform bacteria	Initial discharge and then daily 1st week, then two times per week
pH	daily 1st week, then two times per week

Plant performance must be analyzed for a minimum of 3 weeks after the plant effluent quality has stabilized (6 sample points) for each set of conditions to be evaluated.

- 4 of 5 All testing data must be submitted with the application for statewide plant operation.
- 5 of 5 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John V. Corre
Director
Department of Environmental Quality

4/6/04
Date of Issuance

STATEMENT OF BASIS

1. Permit Number: 04-090
2. Application reviewed for compliance with the following regulations :
Chapter 11 of the Wyoming Water Quality Rules and Regulations
3. Does the permit comply with all applicable regulations identified above?
Yes
4. A review to determine groundwater impacts in accordance with Section 17, Chapter 3.
Not Required
5. Documentation of Statement of Basis: The archives file for this permit include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Jeff Hermansky, jherma@state.wy.us, Northwest District Engineering Supervisor and completed on March 29, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

JCH/bb/4-0323.ltr

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-091RR

North Alpine Service and Improvement District
PWS: 5601021

This permit hereby authorizes the applicant:

North Alpine Service and Improvement District
P.O. Box 3776
Alpine, WY 83128

to construct, install or modify a public water system, including replacing existing storage tank with a new 200,000 gallon storage tank, 3,000 linear feet of 8-inch HDPE water line, 5,050 feet of 8-inch PVC water line, new service lines with backflow prevention devices, five fire hydrants and one air release valve according to the procedures and conditions of the application number 04-091RR. The facility is located in N1/2 SW1/4 Section 20, T37N, R119W in the county of Lincoln, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by May 30, 2007.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

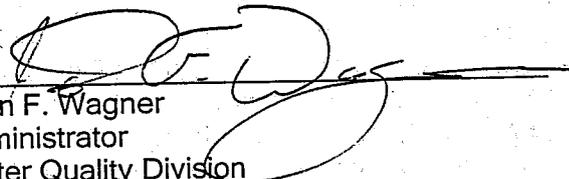
1 of 3 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/Water Quality Division, SW District, 250 Lincoln Street, Lander, WY 82520, 307-332-3144, fax 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.

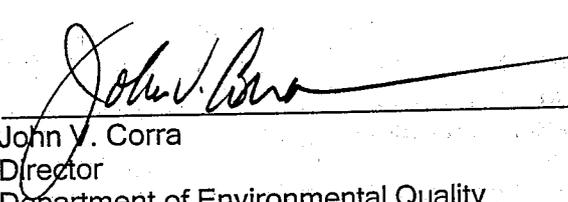
2 of 3 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the SW District a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.

- a. Date that construction of the facility was completed; and
- b. Date that the facility was placed in operation; and
- c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
- d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.

3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John V. Corra
Director
Department of Environmental Quality

5/21/04
Date of Issuance

JVC/JFW/DHC/pf/4-493-ltr

cc: Lincoln County Planning and Zoning; P.O. Box 414; Afton, WY 83110

STATEMENT OF BASIS

1. Permit Number: 04-091RR
2. Application reviewed for compliance with the following regulations :
Chapter 12 of the Wyoming Water Quality Rules and Regulations
3. Does the permit comply with all applicable regulations identified above?
Yes
4. A review to determine groundwater impacts in accordance with Section 17, Chapter 3.
Not Required

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Doyle Conklin, dconkl@state.wy.us, SW District Engineering Supervisor, and completed on May 17, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-092

Pine Haven Well No. 2
PWS# WY 5600191

This permit hereby authorizes the applicant:

Town of Pine Haven
24 Water Drive
Pine Haven, Wyoming 82721-9761

to construct, install or modify a water supply well in the Madison aquifer and the associated plumbing to connect to the existing system according to the procedures and conditions of the application number 04-092. The facility is located in NW/4 of Section 5, Township 50 North, Range 66 West in the county of Crook, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by April 1, 2005.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

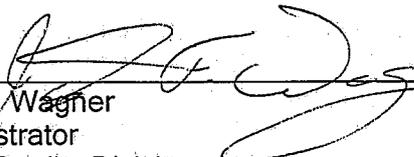
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

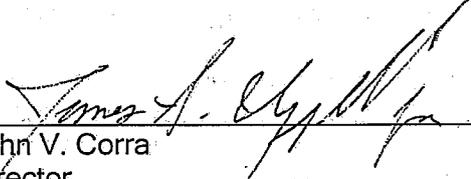
The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 3 The applicant will provide immediate oral or written notice to the DEQ/WQD Northeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 3 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Northeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John V. Corra
Director
Department of Environmental Quality

3/24/084
Date of Issuance

JDL/pf/4-0305-ltr

cc: WDEQ Casper Field Office

STATEMENT OF BASIS

1. Permit Number: 04-092
2. Application reviewed for compliance with the following applicable regulations :
 - a. Chapter 11.
 - b. Chapter 12
3. Does the permit comply with all applicable regulations identified above?
 - a. Yes
4. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3.

Not Req.
5. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Dennis Lamb, Northeast District Supervisor, and completed on March 14, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-093

Wyodak North pit Ash Pond Modification

This permit hereby authorizes the applicant:

PacifiCorp
48 Wyodak Road
Gillette, Wyoming 82718

to construct, install or modify a modification to an existing ash pond at the Wyodak North Pit according to the procedures and conditions of the application number 04-093. The facility is located in NE/4 of the NE/4 of Section 28, Township 50 North, Range 71 West in the county of Campbell, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by April 1, 2005.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

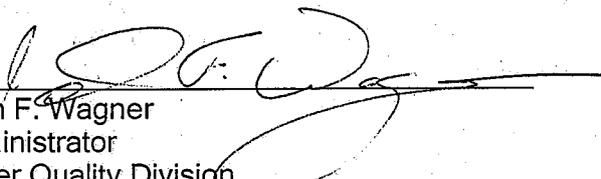
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

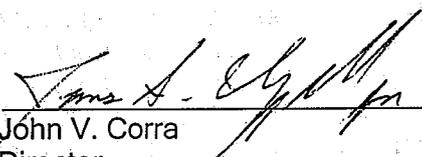
In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 3 The applicant will provide immediate oral or written notice to the DEQ/WQD Northeast District Office in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 3 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ/WQD Northeast District Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.
- 3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division

3/24/04
Date of Issuance


John V. Corra
Director
Department of Environmental Quality

JDL/pf/4-0300-ltr

cc: WDEQ Casper Field Office

STATEMENT OF BASIS

1. Permit Number: 04-092
2. Application reviewed for compliance with the following applicable regulations :
 - a. Chapter 11.
3. Does the permit comply with all applicable regulations identified above?
 - a. Yes
4. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3.

Not req.
5. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter III, Wyoming Water Quality Rules and Regulations. This review was performed by Dennis Lamb, Northeast District Supervisor, and completed on March 14, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

11/13/2006

January 22, 2007

Old Baldy Corporation
% John Baxter
P.O. Box 707
Saratoga WY 82331

Subject: Notification of Coverage 04-094 Old Baldy, 7th Addition Water Line Extension

Dear Mr. Baxter:

As per your request of June 30, 2006, the notification of coverage for Old Baldy, 7th Addition Water Line Extension, Application No.04-094, Carbon County has been extended from August 11, 2006 to the maximum of March 22, 2009.

Sincerely:

Louis B. Harmon PE-PG
Southeast District Supervisor
Water and Wastewater Program, Wyoming Water Quality Division

cc: Archive File, Notification of Coverage 04-494



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307)777-7758 FAX 777-3610	ABANDONED MINES (307)777-6145 FAX 777-6462	AIR QUALITY (307)777-7391 FAX 777-5616	INDUSTRIAL SITING (307)777-7369 FAX 777-6937	LAND QUALITY (307)777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307)777-7752 FAX 777-5973	WATER QUALITY (307)777-7781 FAX 777-5973
---	--	--	--	---	---	--

NOTIFICATION OF COVERAGE

March 22, 2004

Mr. Marshal Brereton,
Old Baldy Corporation
P.O. Box 707
Saratoga, WY 82331

RE: Old Baldy, 7th Addition Water Line Extension, Application No.04-094, Carbon County

Dear Mr. Brereton:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems described as 6364 ft 8" diameter water line extension, SW 1/4 Sec. 17, SE 1/4 Sec. 18 T17N R83W; Carbon County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, in accordance with the general permit and the materials submitted in your application package. All service connections will be protected by the appropriate backflow device as required by Chapter 12, Section 14(i) of the Water Quality Division Rules and Regulations. All construction, installation, or modification allowed by this notification of coverage shall be completed by August 11, 2006.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 04-094 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne

Jon Anderson, PMPC
118 East Bridge Avenue
Saratoga WY 82331

LBH/pf/4-0306-ltr



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

250 Lincoln Street • Lander, Wyoming 82520 • Fax (307) 332-7726

ABANDONED MINES
(307) 332-5085

AIR QUALITY
(307) 332-6755

LAND QUALITY
(307) 332-3047

SOLID & HAZARDOUS WASTE
(307) 332-6924

WATER QUALITY
(307) 332-3144

NOTIFICATION OF COVERAGE

May 5, 2004

Jay D' Ewart, Owner
P.O. Box 1574
Rock Springs, Wyoming 82901

RE: Rock Springs - White Mountain Country Estates Subdivision, Phase III - Permit Number:
04-095R, SE 1/4 Section 5, T19N, R105W, Sweetwater County

Dear Mr. Ewart:

The above application for coverage under General Permits to Construct extensions of a sewage collection system and a public water distribution system consisting of 2485 linear feet of 8-inch PVC sewer main and 2590 linear feet of 8-inch water main in accordance with Chapter 3, Section 7 and Chapter 11, Section 9 and Chapter 12, Section 14 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, the facilities in accordance with the general permits and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Mark Baron, P.E.
Environmental Senior Analyst
Water Quality Division

cc: IPS, Cheyenne
encl: General Permit For a Sewage Collection System,
General Permit For a Public Water Distribution System



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307)777-7758 FAX 777-3610	ABANDONED MINES (307)777-6145 FAX 777-6462	AIR QUALITY (307)777-7391 FAX 777-5616	INDUSTRIAL SITING (307)777-7369 FAX 777-6937	LAND QUALITY (307)777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307)777-7752 FAX 777-5973	WATER QUALITY (307)777-7781 FAX 777-5973
---	--	--	--	---	---	--

NOTIFICATION OF COVERAGE

April 9, 2004

Tim Horst
101 East Pine #1
Rawlins, Wyoming 82301

RE: Tim Horst Residential Septic System, Application No. 04-096
Location: N 1/2 NW 1/4, Section 31, T21N, R87W, Carbon County

Dear Mr. Horst:

The above application for coverage under General Permit to Construct, Install, Modify, or Operate a Small Wastewater Facility in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install, or modify the small wastewater system in accordance with Chapter 11, Part D of the Water Quality Division Rules and Regulations, the general permit, the conditions listed below, and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Additionally, the following project specific conditions also apply:

1. Septic Tank Clean-Out Riser Requirement - Either a 6 inch diameter clean-out riser or the manway from each compartment of the tank must be extended to the ground surface.
2. Polyethylene Septic Tank Installation Requirements - To ensure structural integrity, the manufacturer's instructions regarding bedding the tank and filling the tank with water during burial must be followed during installation. Additionally, immediately after clean-outs, the tank must be refilled with water according to the manufacturer's instructions to maintain structural integrity.

The approval granted under this Notification Of Coverage and the General Permit shall expire on April 9, 2006. Please reference Application Number 04-096 in any future correspondence.

If you have any questions, please contact me at (307) 777-6183.

Sincerely,

Ronald L. Ewald
Environmental Senior Analyst
Southeast District, Water Quality Division

RLE/bb/4-0371.ltr

Enclosures: GENERAL PERMIT - Small Wastewater Facility
Certificate of Completion

cc: IPS, Cheyenne
Carbon County Planner



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMIN/OUTREACH (307)777-7758 FAX 777-3610	ABANDONED MINES (307)777-6145 FAX 777-6462	AIR QUALITY (307)777-7391 FAX 777-5616	INDUSTRIAL SITING (307)777-7369 FAX 777-6937	LAND QUALITY (307)777-7756 FAX 777-5864	SOLID & HAZ. WASTE (307)777-7752 FAX 777-5973	WATER QUALITY (307)777-7781 FAX 777-5973
---	--	--	--	---	---	--

NOTIFICATION OF COVERAGE

March 22, 2004

Mr. Denis Peterson, Public Works Director
Town of Lusk
201 East 3rd
Lusk, WY 82225

RE: Town of Lusk Car Wash Water Main Extension, Application No.04-097, Niobrara County

Dear Mr. Peterson:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems described as extension of existing 6" diameter water main, NE 1/4 Section 18 T32N R63W; Niobrara County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, in accordance with the general permit and the materials submitted in your application package. All service connections will be protected by the appropriate backflow device as required by Chapter 12, Section 14(i) of the Water Quality Division Rules and Regulations. All construction, installation, or modification allowed by this notification of coverage shall be completed by August 11, 2006.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 04-097 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne

Marc Rosso, Baker and Associates 1925 East 'A' Street, Torrington WY 82240

LBH/pf/4-0306-ltr



The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

250 Lincoln Street • Lander, Wyoming 82520 • Fax (307) 332-7726

ABANDONED MINES
(307) 332-5085

AIR QUALITY
(307) 332-6755

LAND QUALITY
(307) 332-3047

SOLID & HAZARDOUS WASTE
(307) 332-6924

WATER QUALITY
(307) 332-3144

NOTIFICATION OF COVERAGE

April 29, 2004

Mary Lankford
Sublette County Clerk
P.O. Box 250
Pinedale, Wyoming 82941

RE: Pinedale - 2004 Sublette County Mill Street Sewer Line Project - Permit Number: 04-098,
NW 1/4 Section 3, T33N; R109W, Sublette County

Dear Ms. Lankford:

The above application for coverage under General Permit to Construct the replacement of a sewer main consisting of 390 linear feet of 8-inch PVC sewer main and one manhole in accordance with Chapter 3, Section 7 and Chapter 11, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Mark Baron, P.E.
Environmental Senior Analyst
Water Quality Division

cc: IPS, Cheyenne
encl: General Permit For a Sewage Collection System

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-099RR

ExxonMobil LaBarge Operations Shute Creek Gas Plant - Water System
PWS # WY5600919

This permit hereby authorizes the applicant:

Keith E. Merkley, Operations Superintendent
ExxonMobil Production Company
P.O. Box 4358
Houston, TX 77210-4358

to construct a river water infiltration galley facility, 8 miles of 8-inch HDPE raw water pipeline, pretreatment equipment modifications consisting of sodium hypochlorite addition, polymer addition, multi-media filters, potable water filters according to the procedures and conditions of the application number 04-099RR. The facility is located at SW1/4, Section 14, T23N, R112W in the county of Lincoln, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by December 29, 2006.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

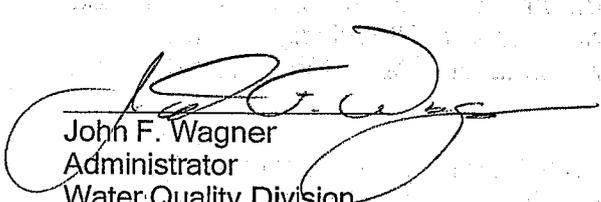
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

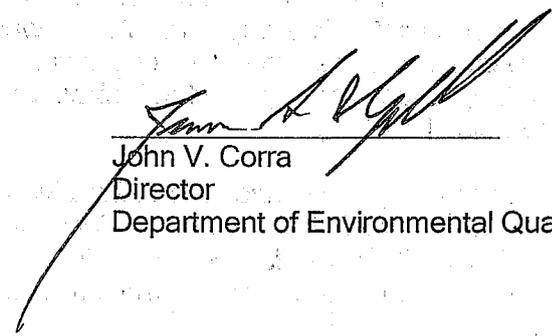
The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 3 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality, Water Quality Division (WQD), Southwest District Engineer, 250 Lincoln Street, Lander, WY 82520, 307-332-3144, FAX 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 3 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northwest District a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
- a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.
- 3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John V. Corra
Director
Department of Environmental Quality

1/6/05
Date of Issuance
MDB/mdb
bb/4-1323.ltr

STATEMENT OF BASIS

1. Permit Number: 04-099RR
2. Application reviewed for compliance with the following regulations:
Chapters 3 and 12 of the Wyoming Water Quality Rules and Regulations.
3. Does the permit comply with all applicable regulations identified above?
Yes.
4. If a Section 17 of Chapter 3 review is required indicate the basis for determining groundwater will be protected.
Not Required.
5. Documentation of Statement of Basis: The archives file for this permit includes adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Mark D. Baron, mbaron@state.wy.us, Environmental Senior Analyst and completed on December 29, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

MDB/bb/4-1323.ltr

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 04-100R

Bridger Coal No. 1 Well
PWS: (Not Assigned Yet)

This permit hereby authorizes the applicant:

Bridger Coal Company
P.O. Box 68
Point of Rocks, WY 82942

to construct, install or modify a water well for a public water supply and industrial water supply according to the procedures and conditions of the application number 04-100R. The facility is located in NE1/4 Section 12, T21N, R101W in the county of Sweetwater, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by May 31, 2006.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

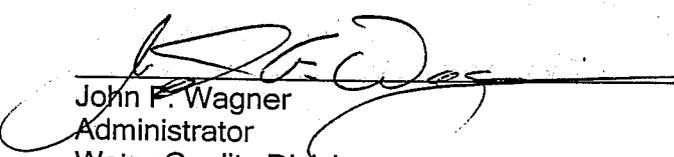
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

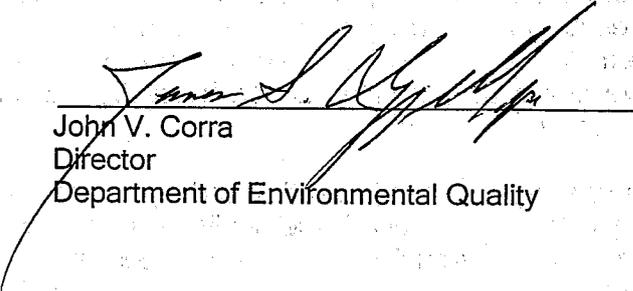
In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 3 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/Water Quality Division, SW District, 250 Lincoln Street, Lander, WY 82520, 307-332-3144, fax 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 3 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the SW District a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.
- 3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division

May 13, 2004
Date of Issuance


John V. Corra
Director
Department of Environmental Quality

JVC/JFW/DHC/pf-4-0486-ltr

cc: Sweetwater County Planning; 80 West Flaming Gorge Way; Green River, WY 82935

STATEMENT OF BASIS

1. Permit Number: 04-100R
2. Application reviewed for compliance with the following regulations :
Chapter 12 of the Wyoming Water Quality Rules and Regulations
3. Does the permit comply with all applicable regulations identified above?
Yes
4. A review to determine groundwater impacts in accordance with Section 17, Chapter 3.
Not required. Public water supplies are exempted from review by Chapter 3, Section 17
5. Documentation of Statement of Basis: The archives file for this permit include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Doyle Conklin, dconkl@state.wy.us, SW District Engineering Supervisor and completed on May 11, 2004. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

