

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 06-054

Reference Permit: WYPDES No. WY0021741

Moorcroft 2006 Sewer System Improvement Project

This permit hereby authorizes the applicant:

Town of Moorcroft
PO Box 70
Moorcroft, Wyoming 82721

to construct, install or modify replacement collection mains and chlorination equipment and associated appurtenances according to the procedures and conditions of the application number 06-054. The facility is located in NE1/4 Section 6, Township 49 North, Range 67 West; SE1/4 Section 31, Township 50 North, Range 67 West; and SE1/4 Section 36, Township 50 North, Range 68 West in the county of Crook, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by December 31, 2007.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

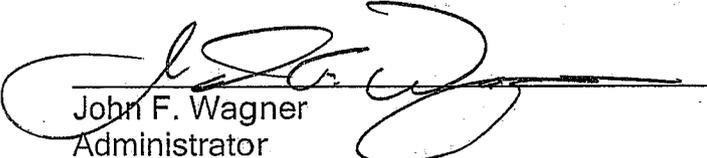
In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

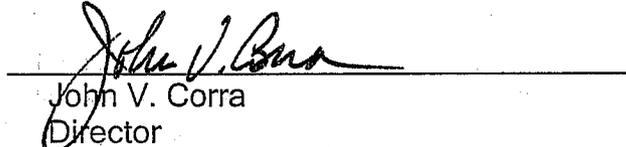
- 1 of 3 The applicant will provide immediate oral or written notice to the DEQ Casper Field Office, 152 N. Durbin St., Suite 100, Casper, WY 82601, 307-473-3465, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.

- 2 of 3 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the DEQ Casper Field Office on the form provided (CERTIFICATION OF COMPLETION), the following information:
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate. All modifications or deviations from the authorized plans must be highlighted.

- 3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John V. Corra
Director
Department of Environmental Quality

5/22/06
Date of Issuance
KJF/jc/6-0428
JRM 5/19/06

STATEMENT OF BASIS

1. Permit Number: 06-054
2. Application reviewed for compliance with the following applicable regulations:
 - a. Chapter 11.
3. Does the permit comply with all applicable regulations identified above?
 - a. Yes
4. Facilities not specifically covered by regulations
 - a. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulation.
N/A
 - b. Briefly state the basis for the deviation.
N/A
5. Application requires review to determine groundwater impacts in accordance with Section 17, Chapter 3.
N/A
6. Documentation of Statement of Basis.

The archives file for this permit will include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Section 6, Chapter 3, Wyoming Water Quality Rules and Regulations. This review was performed by Kevin Frank, PE, SRF Program Senior Analyst, and Rick Estes, PE, NE District Senior Analyst, and was completed on May 18, 2006. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

February 10, 2006

Mr. James Osborne, President
Osborne Concrete Ready Mix, Inc.
P.O. Box 805
Laramie, WY 82070

RE: Laramie Water Main Extension, Hodgeman to Pine Street, Application No.06-055,Albany County

Dear Mr. Osborne:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems described as 1250 ft 10" diameter water main extension and loop, SE 1/4 Section 29 T16N R73W; Albany County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, the general permit and the materials submitted in your application package. All service connections will be protected by the appropriate backflow device as required by Chapter 12, Section 14(i) of the Water Quality Division Rules and Regulations. All construction, installation, or modification allowed by this notification of coverage shall be completed by May 10, 2008.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 06-055 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne

James W. Johnson, Johnson Engineering Assoc.
110 Superior Court
Laramie, WY 82070

LBH/jc/6-0130

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002 • <http://deg.state.wy.us>

ADMIN/OUTREACH
(307) 777-7758
FAX 777-3610

ABANDONED MINES
(307) 777-6145
FAX 777-6462

AIR QUALITY
(307) 777-7391
FAX 777-5616

INDUSTRIAL SITING
(307) 777-7368
FAX 777-6937

LAND QUALITY
(307) 777-7756
FAX 777-5864

SOLID & HAZ. WASTE
(307) 777-7752
FAX 777-5973

WATER QUALITY
(307) 777-7781
FAX 777-5973



STATE OF WYOMING
DEPARTMENT OF ENVIRONMENTAL QUALITY
UNDERGROUND INJECTION CONTROL PERMIT ISSUED UNDER
WYOMING WATER QUALITY RULES AND REGULATIONS
CHAPTER 16

CLASS V INJECTION WELL

(X) New
() Modified

Permit Number UIC 06-056
UIC Facility Number WYS-007-048

In compliance with the Wyoming Environmental Quality act (W.S. 35-11-101 through 1104, specifically 301(a)(i) through 301 (a)(iv), Laws 1973, Ch. 250, Section 1) and Wyoming Water Quality Rules and Regulations, Chapter 16.

Applicant: Cedar Ridge Operating Company, LLC
484 Turner Drive, Building B, Suite 3
Durango, CO 81303
(970) 382-5990

Cedar Ridge Operating Company, LLC hereafter referred to as the permittee, is authorized to operate STATE 34-13-89 #1 within the SW ¼ of SW ¼ Section 34, Township 13 North, Range 89 West, of the 6th Principal Meridian, Carbon County; according to the procedures and conditions of application UIC 06-056 and requirements and other conditions of this permit.

This permit shall become effective on date of issuance.



John Wagner, Administrator
Water Quality Division
Herschler Building, 122 West 25th Street
Cheyenne, WY 82002
(307)-777-7781

5/18/06

Date



John V. Corra, Director
Department of Environmental Quality
Herschler Building, 122 West 25th Street
Cheyenne, WY 82002

5/19/06

Date

Table of Contents

| | | |
|----|--|----|
| A. | Discharge Zone | 3 |
| B. | Well and Area of Review..... | 3 |
| C. | Groundwater Classification | 3 |
| D. | Authorized Operations..... | 3 |
| E. | Hazardous Waste | 3 |
| F. | Proper Operation and Maintenance | 4 |
| G. | Entry and Inspection | 4 |
| H. | Environmental Monitoring Program for Groundwaters of the State | 4 |
| I. | Requirements for Monitoring the Discharge | 5 |
| J. | Test Procedures | 6 |
| K. | Records and Reports | 6 |
| L. | Permit Actions | 7 |
| M. | Mechanical Integrity | 8 |
| N. | Abandonment or Conversion to Water Wells..... | 8 |
| O. | Duties of the Permittee..... | 8 |
| P. | Signatories Requirement..... | 9 |
| Q. | Noncompliance | 10 |
| R. | Permit Transfer | 10 |
| S. | Property Rights | 10 |
| T. | Severability | 10 |

A. Discharge Zone

This injection well is authorized to inject into the Cherokee Creek Formation from 1,494 – 1,546 feet. The packer set on the bottom of the tubing shall be set within 500 feet of the top of the authorized discharge zone (1,494 feet). Additional perforations may be installed within the above named intervals of the authorized formation with the prior written approval of the Water Quality Division.

B. Well and Area of Review

The injection well authorized by this permit is located as follows:

SW ¼ of SW ¼ of Section 34, Township 13 North, Range 89 West, 6th Principal Meridian

The Area of Review (radius of endangering influence) is defined as a circle **2,286 feet (0.43 miles) in diameter** surrounding the injection well. There are no other known wells penetrating the receiving formations within the area of review. The Area of Review is based upon the following assumptions:

Time of Operation: 10 Years (Total of 3,650 Days)

Porosity: 0.24

Maximum injection rate: 292 gallons/minute (10,000 barrels/day or 420,000 gallons/day)

Length of perforated intervals: 52 feet

C. Groundwater Classification

The groundwater in the Cherokee Creek Formation is classified as Class III according to Wyoming Water Quality Rules and Regulations, Chapter 8. This classification was made because the groundwater in this formation has a sodium adsorption ratio greater than 8. An aquifer that contains less than 10,000 mg/L total dissolved solids (and is not exempted) can be considered an underground source of drinking water.

D. Authorized Operations

The permittee is authorized to inject 10,000 barrels per day, (420,000 gallons per day) of produced water resulting from coal bed methane extraction. The permittee is authorized to inject at a pressure of no more than 1,086 psig as measured at the wellhead.

E. Hazardous Waste

This permit does not allow for the injection of any hazardous waste as defined in 40 CFR 261.3 and in Wyoming Solid Waste Management Rules and Regulations, Chapter 2. Injection of any substance defined as a hazardous waste, whether hazardous by listing or by characteristic is a violation of this permit.

F. Proper Operation and Maintenance

The permittee shall take all reasonable steps to minimize or correct any adverse impact on the environment resulting from noncompliance with this permit. The permittee shall operate and maintain all facilities and systems of treatment and control which are installed or used by the permittee to achieve compliance with the conditions of the permit. Proper operation and maintenance includes mechanical integrity of the well, effective performance, adequate funding, operator staffing and training, and laboratory and process controls, including appropriate quality assurance procedures. This provision requires the operation of back-up or auxiliary facilities or similar systems only when necessary to achieve compliance with the conditions of this permit.

The injection well covered by this permit shall meet all construction requirements outlined in Wyoming Water Quality Rules and Regulations, Chapter 16, Section 10.

The permittee is required to operate in accordance with statements, representations and procedures presented in the complete permit application and supporting documents as accepted and approved by the Administrator. Any modifications which will result in a violation of permit conditions shall be reported by submission of a new or amended permit application and shall not be implemented until a new or modified permit has been issued. Injection into a well may not begin until construction is complete and the permit is approved.

G. Entry and Inspection

The permittee shall allow the Administrator (upon presentation of credentials and during normal working hours) to enter the premises where a regulated facility is located, or where records are kept under the conditions of this permit and inspect and photograph the discharge and related facilities, review and copy reports and records required by this permit, collect fluid samples for analysis, measure and record water levels, and perform any other function authorized by law or regulation.

H. Environmental Monitoring Program for Groundwaters of the State

General Requirements:

1. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
2. The permittee shall retain records of all monitoring information including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of the reports required by this permit, and records of all data used to complete the application for this permit, for a period of at least three years from the date of the sample measurement, report, or application. This period may be extended by request of the Administrator at any time.
3. Records of monitoring information shall include:

- a. The date, exact place, and time of sampling or measurements;
 - b. The initials or name(s) of the individual(s) who performed the sampling or measurements;
 - c. The date(s) analyses were performed;
 - d. The time(s) analyses were initiated;
 - e. The initials or name(s) of the individual(s) who performed the analyses;
 - f. References and written procedures for the analytical techniques or methods used;
 - g. The results of such analyses, including the bench sheets, instrument readouts, computer disks or tapes, etc., used to determine these results.
4. Monitoring must be conducted according to test procedures approved under 40 CFR Part 136, unless other test procedures have been specified in this permit.
 5. The permittee shall retain all records concerning the nature and composition of injected fluids until five (5) years after completion of any specified plugging and abandonment procedures. The administrator may require the owner/operator to deliver the records to the administrator at the conclusion of the retention period.
 6. The permittee shall report any noncompliance which may endanger health or the environment within twenty-four (24) hours from the time the operator becomes aware of the circumstances. The report should include:
 - a. Any monitoring or other information which indicates that any contaminant may cause an endangerment to a usable groundwater of the state;
 - b. Any noncompliance with a permit condition or malfunction of the discharge (injection) system which may cause fluid migration into or between usable ground waters of the state;
 - c. A written submission shall be provided within five (5) days of the time the operator becomes aware of the circumstances. This written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected; the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.
 7. The permittee shall report all instances of noncompliance not reported otherwise, at the time monitoring reports are submitted.
 8. Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this permit shall be submitted no later than thirty (30) days following each schedule date.

I. Requirements for Monitoring the Discharge

General Requirements:

1. All operators covered by this permit must provide for metering of water injected into each well.
2. The permittee shall monitor the quality of the injected fluid on an approved schedule. Samples shall be taken from the flow line to each injection well at a point where all pretreatment has taken place. The following parameters shall be analyzed by the listed methods and reported quarterly:

Table 1 (Injected Fluid Sampling Schedule)

| Sampling Schedule | Parameter Analyzed | Analytical Method | Permit limit or UCL |
|-------------------|---------------------------|--------------------------------|---------------------|
| Quarterly | Total Dissolved Solids | EPA Method 160.1 | 5,000 |
| | Sodium Adsorption Ratio | Calculated from other analysis | No limit |
| | Iron Fixing Bacteria | Standard Method | 0 |
| | Sulfate Reducing Bacteria | Standard Method | 0 |
| | Coliform Bacteria | Standard Method | 0 |
| | pH | EPA Method 150.1 | > 6.5 and < 8.5 |
| | Volume | Flow meter | 10,000 barrels/day |
| | Injection Pressure (Max) | Gauge | 1,000 psig |

*All chemical concentrations in this permit are expressed in mg/l unless otherwise noted. pH is always expressed in standard units.

The above upper control limit (UCL) can not be exceeded in any sample. Exceedance of this value is a violation of this permit and shall require notification under Section K of this permit. Failure to perform and report analyses in accordance with the prescribed schedule and method is also a violation of this permit.

3. The permittee shall submit a one-time baseline ground water sample obtained from the perforated intervals and prior to injection of any fluids. Parameters to be analyzed are listed on the reporting form.
4. The permittee shall submit a one-time pressure falloff curve prior to injection of any fluids. Parameters to be analyzed are listed on the reporting form.

J. Test Procedures

All samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity. All samples taken shall include a trip blank of distilled water for each sampling date and a duplicate sample at least once per year. All required analyses shall be conducted in compliance with Wyoming Water Quality Rules and Regulations, Chapter 8, Section 7.

K. Records and Reports

The permittee shall furnish to the Administrator within a specified time any information which the Administrator may request relating to the operation of the facility, including copies of records required to be kept by this permit. The permittee shall retain copies of all records and reports required by this permit for a period of three (3) years following permanent well abandonment. After that time, those records shall be delivered to the Administrator for disposal or archive at his discretion. Reports of compliance or noncompliance with, and any progress reports on, interim and final requirements contained in any compliance schedule shall be submitted no later than thirty (30) days following each schedule date. Confirmed noncompliance resulting in the migration of injected fluid into any zone outside the permitted receiver shall be reported to the Administrator within twenty-four (24) hours, and a written submission (via certified mail) shall be provided within five (5) days of the time the permittee becomes aware of the excursion. The written submission shall contain: a description of the noncompliance; the period of noncompliance, including exact dates and times, and if the noncompliance has not been controlled, the anticipated time it is expected to continue; and a list of the steps taken or planned to reduce, eliminate, and prevent the recurrence of the noncompliance. Confirmed noncompliance not already reported under this section shall be reported at the time monitoring reports are submitted. The reports shall contain the same information as required by the paragraph above. The permittee shall notify the Administrator thirty (30) days in advance of any planned alteration, conversion, or abandonment of the well covered by this permit.

L. Permit Actions

This permit is issued for a period of ten (10) years. If the permittee wishes to continue injection after the expiration date of this permit, he shall apply to the Administrator and obtain a new permit prior to the expiration date of this permit. It shall not be a defense for the permittee in an enforcement action that it would be necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of the permit. The filing of a request by the permittee, or at the instigation of the Administrator, for permit modification, revocation, termination, or notification of planned changes or anticipated noncompliance shall not stay any condition of this permit.

After notice and opportunity for a hearing, a permit may be modified, suspended or revoked in whole or part during its term for cause which includes, but is not limited to any of the following:

1. Violation of this permit;
2. Obtaining a permit by misrepresentation of facts in the application; or
3. Failure of the casing, cement or the confining layer.

This permit will be reviewed at least once every five (5) years, and may be reviewed more frequently. A permit may be modified at any time as may be required, including for conformity with changes in regulations or standards which occur after the permit was issued. A permit may be modified in whole or part in order to apply more or less stringent standards; or prohibitions for toxic or other substances present in the permittees discharge as may be ordered by the Environmental Quality Council.

M. Mechanical Integrity

Mechanical integrity shall be maintained continuously. The permittee shall pressure test the casing before injection and at least once every five (5) years. The casing shall be pressure tested up to an indicated surface pressure of 700 psi and held for 15 minutes. A passing result is indicated if the casing pressure maintains 630-700 psi at the end of the test.

N. Abandonment or Conversion to Water Wells

General Requirements:

1. The permittee shall notify the administrator at least seven (7) days before conversion or abandonment of the facility;
2. An abandonment report, detailing the compliance with abandonment procedures outlined the original application for coverage under this general permit, or describing any deviations from the original plan, shall be submitted as soon as practicable after abandonment. The abandonment shall include reclamation of the well site.
3. In no case shall the abandonment procedure be less stringent than that required at the time of abandonment by the Wyoming Oil and Gas Conservation Commission for the abandonment of producing oil wells.
4. Injection wells covered by this permit shall be permanently abandoned or converted to another use within three (3) years after the date when coal bed methane water was last injected unless those wells are converted to water wells.
5. Wells which are to be converted to another use shall be covered by an approved Wyoming State Engineer's permit for the well showing that it has been converted to a water well. A copy of this permit shall be submitted to the department as proof that the well has been converted.

O. Duties of the Permittee

The permittee shall give advance notice to the Administrator as soon as possible of any planned physical alteration or additions, other than authorized operation and maintenance, to the permitted facility and receive authorization prior to implementing the proposed alternation or addition. The permittee shall furnish the Administrator within a reasonable time any information which the Administrator may request to determine whether cause exists for modifying, revoking, or reissuing, or terminating this permit, or to determine compliance with this permit; and to furnish to the Administrator upon request, copies of records required to be kept by this permit. Any modification which may result in a violation of a permit condition shall be reported to the Administrator, and any modification that will result in a violation of any permit conditions shall be reported to the Administrator through the submission of a new or amended permit application. The permittee shall report all instances where he becomes aware that he failed to submit any relevant facts in the permit application, or where he submitted incorrect information in a permit

application or in any report to the Administrator, and shall promptly submit such facts or information.

If any cultural materials are discovered during construction, work in the area should halt immediately. The Administrator and the Wyoming State Historic Preservation Office shall be contacted (777-7697) and the materials shall be evaluated by an archaeologist or historian meeting the Secretary of the Interior's Professional Qualification Standards (48 FR 22716, Sept. 1983).

P. Signatories Requirement

All reports filed in conjunction with this permit shall contain the following certification:

"I certify, under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."

All reports required by this permit and other requested information shall be signed as follows:

For a corporation – by a principal executive officer of at least the level of vice-president;

For a partnership or sole proprietorship – by a general partner or the proprietor, respectively;

For a municipality, state, federal, or other public agency – by either a principal executive officer or ranking elected official;

or

By a duly authorized representative for any of the above. A person is a duly authorized representative only if:

1. The authorization is made in writing by one of the prescribed principals;
2. The authorization specifies either an individual or position having responsibility for the overall operation of the regulated facility or activity; and
3. The written authorization is submitted to the Administrator.

If an authorization is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization must be submitted to the Administrator prior to or together with any reports or information, to be signed by the new authorized representative.

Q. Noncompliance

The permittee shall comply with all conditions of the permit. Any permit noncompliance constitutes a violation of Wyoming Water Quality Rules and Regulations, Chapter 16 and is grounds for enforcement action, permit termination, revocation, or modification. Conformed noncompliance resulting in an excursion shall be reported to the Administrator orally within twenty-four (24) hours, and a written submission shall be provided within five (5) days of the time the permittee becomes aware of the excursion. The written report shall contain the sections specified in Section K of this permit. Any permit noncompliance constitutes a violation of this permit.

The filing of any request by the permittee for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance, does not stay any permit condition.

R. Permit Transfer

Any transfer of this permit shall be accomplished by the submission of the proper forms for permit transfer to the Administrator. Transfer of this permit must first be approved by the Administrator and the Director. No transfer shall be approved unless the proposed permittee agrees to bring any and all noncompliance issues into compliance with this permit. The permittee is alone responsible for the operation of the facility covered by this permit. Sale of the facility and subsequent operation of this facility by another is a violation of this permit unless a transfer of this permit has first been accomplished.

S. Property Rights

This permit does not convey any property rights of any sort or any exclusive privilege. This permit does not authorize injury to private property or any invasion of personal rights, nor any infringement of federal, state, or local laws or regulations.

T. Severability

Nothing in this permit shall be construed to preclude the institution of any legal action or to relieve the permittee from any responsibilities, liabilities, or penalties established pursuant to any applicable state law or regulation.



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

May 22, 2006

Mr. Terry L. Logan
Cedar Ridge Operating Company
484 Turner Drive, Building B, Suite 3
Durango, CO 81303

RE: State 34-13-89 #1
UIC Facility WYS 007-048, Permit UIC 06-056
Carbon County, Wyoming


Dear Mr. Logan:

Attached please find one copy of the Class V permit and corresponding reporting forms for the above referenced facility. This permit requires reporting on a quarterly basis within 30 days of the end of each calendar quarter, a one-time baseline groundwater sample from the perforated intervals, a one-time pressure falloff curve, and a mechanical integrity test once every five (5) years. When the well is completed please complete and submit the enclosed registration form.

Please be advised that this permit does not authorize the construction of water storage pits (lined or unlined). If storage pits are required for your operation a WYPDES permit must be obtained from the Department and possibly a Chapter 3 permit for monitor wells (for unlined pits).

The underground injection control program was promulgated to prevent serious problems caused by direct discharges to the groundwater. Those problems included groundwater pollution leading to contamination in domestic water wells and serious health affects caused by exposures to toxic substances and water borne pathogens. Your cooperation with our program is sincerely appreciated.

If you have any questions please do not hesitate to contact me at (307) 777-5623 or by email at jpasse@deq.wy.us

Sincerely,

 JOHN A. PASSEHL
 PG-3362
 PROFESSIONAL GEOLOGIST
 State of Wyoming
 John A. Passehl, P.G.
 UIC Program Principal
 Water Quality Division
 JAP/jc/6-0447

Herschler Building • 122 West 25th Street • Cheyenne, WY 82002 • <http://deq.state.wy.us>

ADMIN/OUTREACH
(307) 777-7758
FAX 777-3610

ABANDONED MINES
(307) 777-6145
FAX 777-6462

AIR QUALITY
(307) 777-7391
FAX 777-5616

INDUSTRIAL SITING
(307) 777-7369
FAX 777-6937

LAND QUALITY
(307) 777-7756
FAX 777-5864

SOLID & HAZ. WASTE
(307) 777-7752
FAX 777-5973

WATER QUALITY
(307) 777-7781
FAX 777-5973



Enclosures: Report forms
Registration form
Permit

c: Kevin Frederick, WDEQ
JoDell Mizoue, P.E., Oil and Gas Environmental Consulting, 11 Inverness Way South,
Englewood, CO 80112



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

February 9, 2006

Ryan Amundson
906 20th Street
Wheatland, Wyoming 82201

RE: Amundson Residential Septic System, Application No. **06-057**
Location: NW ¼, Section 21, T23N, R68W, Platte County

Dear Mr. Amundson:

The above application for coverage under General Permit to Construct, Install, Modify or Operate a Small Wastewater Facility for a **4 bedroom** house in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the small wastewater system in accordance with Chapter 11, Part D of the Water Quality Division Rules and Regulations, the general permit, the condition listed below, and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Additionally, the following project specific condition also applies:

Septic Tank Clean-Out Riser Requirement - Either a 6 inch diameter clean-out riser or the manway from **each compartment of the tank** must be extended to the ground surface.

The approval granted under this Notification Of Coverage and the General Permit shall expire on February 9, 2008. Please reference Application Number **06-057** in any future correspondence.

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002 • <http://deg.state.wy.us>

ADMIN/OUTREACH
(307) 777-7758
FAX 777-3610

ABANDONED MINES
(307) 777-6145
FAX 777-6462

AIR QUALITY
(307) 777-7391
FAX 777-5616

INDUSTRIAL SITING
(307) 777-7368
FAX 777-6937

LAND QUALITY
(307) 777-7756
FAX 777-5864

SOLID & HAZ. WASTE
(307) 777-7752
FAX 777-5973

WATER QUALITY
(307) 777-7781
FAX 777-5973



If you have any questions, please contact me at (307) 777-6183.

Sincerely,

A handwritten signature in cursive script that reads "Ronald L. Ewald".

Ronald L. Ewald, P.E.
Environmental Senior Analyst
Southeast District, Water Quality Division

RLE/jc/6-0127


Enclosures: GENERAL PERMIT - Small Wastewater Facility
Certificate of Completion

cc: IPS, Cheyenne
Platte County Planner, Marlin Johnson, P.O. Box 728, Wheatland, Wyoming 82201



Department of Environmental Quality

To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.



Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

February 7, 2006

Steve Payne, P.E., Public Works Director
City of Cody
P.O. Drawer 2200
Cody, Wyoming 82414

RE: Fair Acres Subdivision Treated Waterline Extensions, Permit Number: 06-058,
Sections 28, 29, 32 & 33, T53N, R101W, Park County, PWS #WY5600207C

Dear Mr. Payne:

The above application for coverage under General Permit to construct 6-inch and 8-inch treated water lines, extension of a public water supply distribution system, has been reviewed in accordance with Chapter 3, Section 7 and Chapter 12, Section 14 of the Wyoming Water Quality Rules and Regulations and is hereby approved.

You are authorized to construct, the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact James Brough at 307-332-3144.

Sincerely,

James Brough, P.E.
Environmental Engineer
Water Quality Division

cc: Robert Overfield, P.E., Engineering Associates, P.O. Box 1900, Cody, WY 82414
IPS, Cheyenne

encl: General Permit For a Public Water Supply Distribution System

Lander Field Office • 510 Meadowview Drive • Lander, WY 82520 • <http://deq.state.wy.us>

ABANDONED MINES
(307) 332-5085
FAX 332-7726

AIR QUALITY
(307) 332-6755
FAX 332-7726

LAND QUALITY
(307) 332-3047
FAX 332-7726

SOLID & HAZARDOUS WASTE
(307) 332-6924
FAX 332-7726

WATER QUALITY
(307) 332-3144
FAX 332-3183



WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
"AS-BUILT" PERMIT TO CONSTRUCT

PERMIT NO. 06-059

Kingsbury II Unit, Plan of Development POD

This permit hereby authorizes the applicant:

Williams Production RMT Company
300 Works Avenue
Gillette, WY 82716

to have installed six compliance monitoring wells according to the procedures and conditions of the application number 06-059. The facilities are proximal to the on channel coal bed methane produced water impoundments located in Township 47N, Range 77W, Sections 21, 23, 27, & 28 in the county of Johnson, in the State of Wyoming. All construction, installation, or modification allowed by this permit has been completed.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

1 of 3: The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/ Water Quality Division, Groundwater Program, 1866 South Sheridan Avenue, Sheridan, WY 82801, 307-673-9337, fax 307-672-2213, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.

2 of 3: The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/ Water Quality Division, Groundwater Program, 1866 South Sheridan Avenue, Sheridan, WY 82801, 307-673-9337, fax 307-672-2213 when discharge to each impoundment covered under this permit commences.

3 of 3: Monitoring Requirements:

Groundwater monitoring at the impoundments shall be performed on a quarterly basis until further notice and shall include the following information:

- Measurement of static water level and sampling and analysis of groundwater at downgradient wells P21-14MW-1, MW21-14A, P28-1MW-1, MW32-27C1, MW43-27C1, and P23-43MW-1
- Reporting results of quarterly monitoring and sampling need to be at the department by January 15th, April 15th, July 15th, and October 15th of each year. The first set of data will be due by April 15, 2006.

The parameters listed in the tables below are required for groundwater compliance monitoring beneath the listed impoundments:

Impoundment P21-14

| Parameter | P21-14MW-1 Background Value (mg/L) (11/11/05) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|--|-------------------------------------|---|
| Arsenic | <0.001 (ND) | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 2660 | ≥ 2825 | 3000 |
| Total Dissolved Solids (TDS) | 4090 | ≥ 4545 | 5000 |
| pH | 7.06 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Impoundment R14A-21-4777

| Parameter | MW21-14A Background Value (mg/L) (01/17/06) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|---|----------------------------|--|
| Arsenic | <0.001 (ND) | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 2480 | ≥ 2740 | 3000 |
| Total Dissolved Solids (TDS) | 4200 | ≥ 4600 | 5000 |
| pH | 7.03 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Impoundment P28-21

| Parameter | P28-21MW-1 Background Value (mg/L) (12/22/04) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|---|----------------------------|--|
| Arsenic | 0.015 | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 2140 | ≥ 2400 | 3000 |
| Total Dissolved Solids (TDS) | 3440 | ≥ 4000 | 5000 |
| pH | 7.31 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Impoundment R32-27-4777

| Parameter | MW32-27C1 Background Value (mg/L) (01/17/06) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|--|----------------------------|--|
| Arsenic | <0.001 (ND) | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 1800 | ≥ 2400 | 3000 |
| Total Dissolved Solids (TDS) | 3170 | ≥ 4000 | 5000 |
| pH | 7.33 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Impoundment 43-27-4777

| Parameter | MW43-27C2 for MW43- 27C1 Background Value (mg/L) (01/18/06) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|--|----------------------------|--|
| Arsenic | <0.001 (ND) | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 1440 | ≥ 2400 | 3000 |
| Total Dissolved Solids (TDS) | 2550 | ≥ 4000 | 5000 |
| pH | 7.43 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

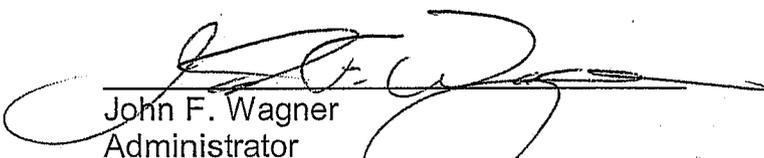
Impoundment P23-43-4777

| Parameter | P23-43MW-1 Background Value (mg/L) (11/11/05) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|---|----------------------------|--|
| Arsenic | <0.001 (ND) | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 1380 | ≥ 2400 | 3000 |
| Total Dissolved Solids (TDS) | 2080 | ≥ 4000 | 5000 |
| pH | 8.10 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Trigger values, specific to the groundwater samples at each impoundment, have been assigned to each constituent and are also listed above. If one or more of these trigger values is exceeded during a quarterly sampling event, monthly sampling of the groundwater for all listed parameters is required, with the analytical results due by the 15th day of each month. If groundwater monitoring reveals a pH measurement of 6.5 or less, the WDEQ may require sampling and analysis of groundwater for the following additional parameters: aluminum, boron, cadmium, chromium, copper, lead and zinc.

The analytical results for each sampling event, along with impoundment and monitor well location information must be submitted in the Excel spread sheet "Compliance Monitoring Data Reporting", which can be found on the WDEQ website at the following address: (<http://deq.state.wy.us/wqd/groundwater/pollution.asp>). These data shall be submitted electronically on the due dates established above to the following department address: cbmgroundwater@state.wy.us. In addition, the accompanying analytical laboratory reports must also be submitted either electronically (pdf format) or hard copy via mail to the WDEQ, Sheridan office at the address listed above.

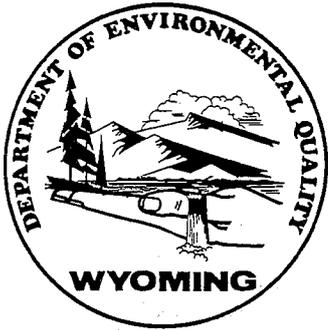
AUTHORIZED BY:


 John F. Wagner
 Administrator
 Water Quality Division


 John V. Corra
 Director
 Department of Environmental Quality

2/14/06
 Date of Issuance

TW/jc/6-0136



GROUNDWATER PROGRAM
REVIEW COMMENTS:
PLANS/SPECIFICATIONS/PROPOSALS/REPORTS

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
1866 South Sheridan Avenue
Sheridan, WY 82801
Phone: 307-672-6457

PERMIT TYPE: CBM: Groundwater Compliance Monitoring Program

WATER QUALITY DIVISION REFERENCE (PERMIT) NUMBER: 06-059

SITE (POD) NAME: Kingsbury II Unit, POD

APPLICANT: Williams Production RMT Company
Attn: Eric Sandberg
300 Works Avenue
Gillette, WY 82716

CONSULTANT: WWC Engineering
Attn: Mr. Ben Schiffer
1849 Terra Avenue
Sheridan, WY 82801

LOCATION: Drainage: Unnamed tributaries to Pumpkin Creek, which drain
northwest into the Powder River
County: Johnson
T47N, R77W; Sections 21, 23, 27, & 28

DATE ON REPORT: February 6, 2006

REVIEWING OFFICIAL: Terry Webster, North District Groundwater Sen. Analyst

DATE OF THIS REVIEW: February 6, 2006

ACTION: Compliance Monitoring Plan authorized for Kingsbury II Unit, POD pursuant to
conditions on permit # 06-059

COMMENTS: GROUNDWATER SECTION

1.0 SITE SUMMARY:

1.1 Site Description.

Watershed Name: Unnamed tributaries to Pumpkin Creek, which drain northwest into the Powder River.

Type of Impoundment(s)

_____ "Off channel "
_____ 5 _____ "On channel"

Groundwater Classification:

Class 1 (domestic) _____
Class 2 (irrigation) _____
Class 3 (agricultural) 5

Basis for Classification: Laboratory analysis of groundwater indicates ambient water quality at four impoundments meets Water Quality Rules and Regulations Chapter 8 Class III standards (Table 1- Chapter 8).

Names of Impoundment (on-channel) covered under Permit 06-059

| Impoundment Name | Capacity (acre/ft) | Qtr Qtr | Section | Township | Range |
|------------------|--------------------|---------|---------|----------|-------|
| P21-14 | 11.41 | NWNW | 28 | 47 | 77 |
| R14A-21-4777 | 9.7 | SESW | 21 | 47 | 77 |
| P28-21 | 10.7 | NENW | 28 | 47 | 77 |
| R32-27-4777 | 20.0 | SWNE | 27 | 47 | 77 |
| 43-27-4777 | 25.6 | SESE | 27 | 47 | 77 |
| P23-43-4777 | 39.4 | NWSE | 23 | 47 | 77 |

1.2 Hydrogeology and Review:

Groundwater occurs within the area of the Kingsbury Unit in a bedrock sandstone, unconfined to semi confined, aquifer. The sandstone unit is encountered at 20 to 30 feet bgs in section 21 and 28 and deeper, approximately 65 to 120 feet in section 27 approximately one mile to the east-southeast.

The groundwater is shallow and the gradient is to the northwest opposite the topography in section 21 and 28. Given the shallow nature of the aquifer and flat gradient (approximately 0.005) it is believed that the monitoring wells

located below the impoundments P21-14, R14A-21-4777, and P28-21 should intercept CBM seepage.

Impoundment R32-27-4477 has three surrounding monitoring wells screened in the sandstone unit. The gradient is to the northwest and the groundwater will be monitored in well MC32-27C1 located downgradient. Impoundment 43-27-4477 is also monitored by three wells which indicate a groundwater flow direction up the topographic drainage to the southwest. The down gradient monitoring well MW43-27C1 at the top of the impoundment will serve as the compliance point. This well will have to be sampled prior to the discharge of CBM water to the impoundment. The up-gradient well MW43-27C2 located below the impoundment was sampled in January of 2006 and this data will be used as the baseline for monitoring at MW43-27C1 until such time as a new sample is reported.

Monitoring well P23-43MW-1/BDR is located below impoundment P23-43-4777. Groundwater was encountered at approximately 70 feet bgs (SWL) in a sandstone unit screened from 65 to 90feet bgs. The aquifer appears to be unconfined.

2.0 MONITORING AND REPORTING REQUIREMENTS

Groundwater monitoring at the impoundment shall be performed on a quarterly basis until further notice and shall include the following information:

- Measurement of static water level and sampling and analysis of groundwater at downgradient wells P21-14MW-1, MW21-14A, P28-1MW-1, MW32-27C1, MW43-27C1, and P23-43MW-1.
- Reporting results of quarterly monitoring and sampling need to be at the department by January 15th, April 15th, July 15th, and October 15th of each year. The first set of data will be due by April 15, 2006.

The parameters listed in the tables below are required for groundwater compliance monitoring beneath the listed impoundments:

Impoundment P21-14

| Parameter | P21-14MW-1 Background Value (mg/L) (11/11/05) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|---|----------------------------|--|
| Arsenic | <0.001 (ND) | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 2660 | ≥ 2825 | 3000 |
| Total Dissolved Solids (TDS) | 4090 | ≥ 4545 | 5000 |
| pH | 7.06 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Impoundment R14A-21-4777

| Parameter | MW21-14A Background Value (mg/L) (01/17/06) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|---|----------------------------|--|
| Arsenic | <0.001 (ND) | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 2480 | ≥ 2740 | 3000 |
| Total Dissolved Solids (TDS) | 4200 | ≥ 4600 | 5000 |
| pH | 7.03 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Impoundment P28-21

| Parameter | P28-21MW-1 Background Value (mg/L) (12/22/04) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|---|----------------------------|--|
| Arsenic | 0.015 | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 2140 | ≥ 2400 | 3000 |
| Total Dissolved Solids (TDS) | 3440 | ≥ 4000 | 5000 |
| pH | 7.31 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Impoundment R32-27-4777

| Parameter | MW32-27C1 Background Value (mg/L) (01/17/06) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|--|----------------------------|--|
| Arsenic | <0.001 (ND) | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 1800 | ≥ 2400 | 3000 |
| Total Dissolved Solids (TDS) | 3170 | ≥ 4000 | 5000 |
| pH | 7.33 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Impoundment 43-27-4777

| Parameter | MW43-27C2 for MW43- 27C1 Background Value (mg/L) (01/18/06) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|--|----------------------------|--|
| Arsenic | <0.001 (ND) | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 1440 | ≥ 2400 | 3000 |
| Total Dissolved Solids (TDS) | 2550 | ≥ 4000 | 5000 |
| pH | 7.43 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Impoundment P23-43-4777

| Parameter | P23-43MW-1 Background Value (mg/L) (11/11/05) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|--|-------------------------------------|---|
| Arsenic | <0.001 (ND) | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 1380 | ≥ 2400 | 3000 |
| Total Dissolved Solids (TDS) | 2080 | ≥ 4000 | 5000 |
| pH | 8.10 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Trigger values, specific to the groundwater samples at this impoundment, have been assigned to each constituent and are also listed above. If one or more of these trigger values is exceeded during a quarterly sampling event, monthly sampling of the groundwater for all listed parameters is required, with the analytical results due by the 15th day of each month. If groundwater monitoring reveals a pH measurement of 6.5 or less, the WDEQ may require sampling and analysis of groundwater for the following additional parameters: aluminum, boron, cadmium, chromium, copper, lead and zinc.

The analytical results for each sampling event, along with impoundment and monitor well location information must be submitted in the Excel spread sheet "Compliance Monitoring Data Reporting", which can be found on the WDEQ website at the following address: (<http://deq.state.wy.us/wqd/groundwater/pollution.asp>). These data shall be submitted electronically on the due dates established above to the following department address: cbmgroundwater@state.wy.us. In addition, the accompanying analytical laboratory reports must also be submitted either electronically (pdf format) or hard copy via mail to the WDEQ, Sheridan office at the address listed above.

END OF REVIEW

TW/jc/6-0135

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
"AS-BUILT" PERMIT TO CONSTRUCT

PERMIT NO. 06-060

West Antelope Phase II, Plan of Development (POD)

This permit hereby authorizes the applicant:

Nance Petroleum Corporation
550 N. 31st Street, Suite 500
P.O Box 7168
Billings, Montana 59103-7168

to have installed one compliance monitoring well according to the procedures and conditions of the application number 06-060. The facilities are proximal to the on-channel coalbed methane produced water impoundment located in Township 58N, Range 80W, Section 24 in the county of Sheridan, in the State of Wyoming. All construction, installation, or modification allowed by this permit has been completed.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

1 of 3: The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/ Water Quality Division, Groundwater Program, 1866 South Sheridan Avenue, Sheridan, WY 82801, 307-673-9337, fax 307-672-2213, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.

2 of 3: The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/ Water Quality Division, Groundwater Program, 1866 South Sheridan Avenue, Sheridan, WY 82801, 307-673-9337, fax 307-672-2213 when discharge to each impoundment covered under this permit commences.

3 of 3: Monitoring Requirements:

Groundwater monitoring at the impoundments shall be performed on a quarterly basis until further notice and shall include the following information:

- Measurement of static water level and sampling and analysis of groundwater at downgradient well MW58-80-2412C.
- Reporting results of quarterly monitoring and sampling need to be at the department by January 15th, April 15th, July 15th, and October 15th of each year. The first set of data will be due by **April 15, 2006**.

The parameters listed in the tables below are required for groundwater compliance monitoring beneath the listed impoundments:

Impoundment – P58-80-2412

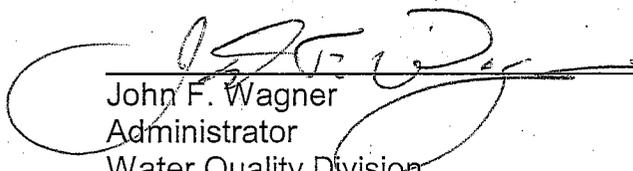
| Parameter | MW58-80-2412C Background Value (mg/L) (12/13/05) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|-----------|---|-------------------------|---|
| Arsenic | 0.0026 | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 1240 | ≥ 2400 | 3000 |
| Total | 2840 | ≥ 4000 | 5000 |


| | | | |
|------------------------|-----|-------|-----------------|
| Dissolved Solids (TDS) | | | |
| pH | 7.7 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Trigger values, specific to the groundwater samples at each impoundment, have been assigned to each constituent and are also listed above. If one or more of these trigger values is exceeded during a quarterly sampling event, monthly sampling of the groundwater for all listed parameters is required, with the analytical results due by the 15th day of each month. If groundwater monitoring reveals a pH measurement of 6.5 or less, the WDEQ may require sampling and analysis of groundwater for the following additional parameters: aluminum, boron, cadmium, chromium, copper, lead and zinc.

The analytical results for each sampling event, along with impoundment and monitor well location information must be submitted in the Excel spread sheet "Compliance Monitoring Data Reporting", which can be found on the WDEQ website at the following address: (<http://deq.state.wy.us/wqd/groundwater/pollution.asp>). These data shall be submitted electronically on the due dates established above to the following department address: cbmgroundwater@state.wy.us. In addition, the accompanying analytical laboratory reports must also be submitted either electronically (pdf format) or hard copy via mail to the WDEQ, Sheridan office at the address listed above.

AUTHORIZED BY:


 John F. Wagner
 Administrator
 Water Quality Division


 John V. Corra
 Director
 Department of Environmental Quality

2/14/06
 Date of Issuance

TW/jc/6-0138



GROUNDWATER PROGRAM
REVIEW COMMENTS:
PLANS/SPECIFICATIONS/PROPOSALS/REPORTS

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
1866 South Sheridan Avenue
Sheridan, WY 82801
Phone: 307-672-6457

PERMIT TYPE: CBM: Groundwater Compliance Monitoring Program

WATER QUALITY DIVISION REFERENCE (PERMIT) NUMBER: 06-060

SITE (POD) NAME: West Antelope Phase II, Plan of Development (POD)

APPLICANT: Nance Petroleum Corporation
 Attn: George Moncure
 550 N. 31st Street, Ste. 500
 P.O. Box 7168
 Billings, Montana 59103-7168

CONSULTANT: HydroSolutions Inc.
 Attn: Monte Smith
 P.O. Box 80866
 Billings, Montana 59108-0866

LOCATION: Drainage: Road Draw an east trending ephemeral tributary
 of Hanging Woman Creek a tributary of the Tongue River
 County: Sheridan
 Township 58 North, Range 80 West, Section 24

DATE ON REPORT: January 17, 2006

REVIEWING OFFICIAL: Terry Webster, North District Groundwater Sen. Analyst

DATE OF THIS REVIEW: February 7, 2006

ACTION: Compliance Monitoring Plan authorized for West Antelope Phase II, POD
 pursuant to conditions on permit 06-060

COMMENTS: GROUNDWATER SECTION

1.0 SITE SUMMARY:

1.1 Site Description.

Watershed Name: Road Draw an east trending ephemeral tributary of Hanging Woman Creek a tributary of the Tongue River

Type of Impoundment(s)

"Off channel "
_____ 1 "On channel"

Groundwater Classification:

Class 1 (domestic) _____
Class 2 (irrigation) _____
Class 3 (agricultural) _____ 1

Basis for Classification: Laboratory analysis of groundwater indicates ambient water quality at two impoundments meets Water Quality Rules and Regulations Chapter 8 Class III standards (Table 1- Chapter 8).

Names of Impoundments (all are on-channel) covered under Permit 06-060

| Impoundment Name | Capacity (acre/ft) | Qtr | Qtr | Section | Township | Range |
|------------------|--------------------|-----|-----|---------|----------|-------|
| P58-80-2412 | 34 | N | W | 24 | 58N | 80W |

1.2 Hydrogeology and Review:

Four wells were completed as monitoring wells around Impoundment P58-60-2412. All the wells were completed in a coal bed aquifer that appears to be continuous beneath the impoundment. The aquifer is confined with a groundwater flow direction to the south opposite the topographic gradient. Monitoring well MW58-80-2412C is located approximately 50 to the south of the impoundment in the direction of groundwater flow.

2.0 MONITORING AND REPORTING REQUIREMENTS

Groundwater monitoring at the impoundments shall be performed on a quarterly basis until further notice and shall include the following information:

- Measurement of static water level and sampling and analysis of groundwater at monitoring well MW58-80-2412C.

- Reporting results of quarterly monitoring and sampling need to be at the department by January 15th, April 15th, July 15th, and October 15th of each year. The first set of data will be due by April 15, 2006.

The parameters listed in the tables below are required for groundwater compliance monitoring beneath the listed impoundments:

Impoundment – P58-80-2412

| Parameter | MW58-80-2412C Background Value (mg/L) (12/13/05) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|---|-------------------------|---|
| Arsenic | 0.0026 | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 1240 | ≥ 2400 | 3000 |
| Total Dissolved Solids (TDS) | 2840 | ≥ 4000 | 5000 |
| pH | 7.7 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Trigger values, specific to the groundwater samples at these impoundments, have been assigned to each constituent and are also listed above. If one or more of these trigger values is exceeded during a quarterly sampling event, monthly sampling of the groundwater for all listed parameters is required, with the analytical results due by the 15th day of each month. If groundwater monitoring reveals a pH measurement of 6.5 or less, the WDEQ may require sampling and analysis of groundwater for the following additional parameters: aluminum, boron, cadmium, chromium, copper, lead and zinc.

The analytical results for each sampling event, along with impoundment and monitor well location information must be submitted in the Excel spread sheet "Compliance Monitoring Data Reporting", which can be found on the WDEQ website at the following address: (<http://deq.state.wy.us/wqd/groundwater/pollution.asp>). These data shall be submitted electronically on the due dates established above to the following department address: cbmgroundwater@state.wy.us. In addition, the accompanying analytical laboratory reports must also be submitted either electronically (pdf format) or hard copy via mail to the WDEQ, Sheridan office at the address listed above.

END OF REVIEW

TW/jc/6-0137



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

February 10, 2006

Mr. Herman Noe, Manager of Engineering
Cheyenne Board of Public Utilities
P.O. Box 1469
Cheyenne, WY 82003-1469

RE: Indian Hills Center Fire Hydrant, Application No.06-061, Laramie County

Dear Mr. Noe:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems described as one new fire hydrant and lead, NW 1/4 Section 19 T14N R66W; Laramie County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, the general permit and the materials submitted in your application package. All construction, installation, or modification allowed by this notification of coverage shall be completed by May 10, 2008.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 06-061 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne

Larry Gallagher, Summit Engineering, LLC
5907 Townsend Place
Cheyenne, WY 82007

LBH/jc/6-0131

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002 • <http://deg.state.wy.us>

| | | | | | | |
|--|---|---|---|--|--|---|
| ADMIN/OUTREACH (307) 777-7758 FAX 777-3610 | ABANDONED MINES (307) 777-6145 FAX 777-6462 | AIR QUALITY (307) 777-7391 FAX 777-5616 | INDUSTRIAL SITING (307) 777-7368 FAX 777-6937 | LAND QUALITY (307) 777-7756 FAX 777-5864 | SOLID & HAZ. WASTE (307) 777-7752 FAX 777-5973 | WATER QUALITY (307) 777-7781 FAX 777-5973 |
|--|---|---|---|--|--|---|





Department of Environmental Quality

To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.



Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

April 25, 2006

Wm. Marty Kelsey, Dean of Admission
Western Wyoming Community College
2500 College Drive
Rock Springs, WY 82901

RE: **Oil Production Building at Western Wyoming Community College; Permit Number 06-062RR; Section 34, T19N, R105W, Sweetwater County**

Dear Mr. Kelsey:

The above application for coverage under the General Permit to Construct, Install, Modify or Operate Extensions to Existing Sewage Collection Systems in accordance with Chapter 3, Section 7, and Chapter 11 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved.

You are authorized to construct, install or modify the facilities in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Doyle H. Conklin, P.E.
SW District Engineering Supervisor
Water Quality Division

cc: ✓IPS, Cheyenne
Vess Walker; City of Rock Springs, 212 D Street; Rock Springs, WY 82901

encl: General Permit for Extensions to Existing Sewage Collection Systems

Lander Field Office • 510 Meadowview Drive • Lander, WY 82520 • <http://deq.state.wy.us>

ABANDONED MINES
(307) 332-5085
FAX 332-7726

AIR QUALITY
(307) 332-6755
FAX 332-7726

LAND QUALITY
(307) 332-3047
FAX 332-7726

SOLID & HAZARDOUS WASTE
(307) 332-6924
FAX 332-7726

WATER QUALITY
(307) 332-3144
FAX 332-3183



WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 06-063R

Wamsutter - BP Base Camp Water System
New System - No Public Water System Number Assigned

This permit hereby authorizes the applicant:

Mark K. Joyce, Project Manager
ESS
9210 Vanguard Drive #101
Anchorage, Alaska 99507

to construct a public water supply system consisting of a 40 gpm water well, degasifier unit, pressure pumps, coagulation system, filter, UV unit, chlorination system, two 12,000 gallon storage tanks, booster pumps, hydropneumatic tank, standby power system, treatment and generator building, 1350 feet of 3-inch HDPE supply line, 382 feet of 4-inch and 681 feet of 2-inch HDPE water mains according to the procedures and conditions of the application number 06-063R. The facility is located at N 1/2 NE 1/4, Section 27, T20N, R94W in the county of Sweetwater, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by March 21, 2008.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 5 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality, Water Quality Division (WQD), Southwest District Engineer, 510 Meadowview Drive, Lander, WY 82520, 307-332-3144, FAX 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.

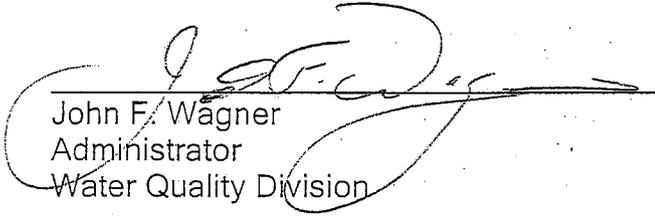
- 2 of 5 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Southwest District a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.

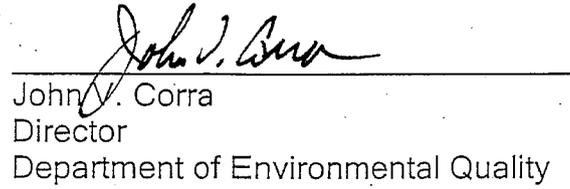
- 3 of 5 Water quality data such as that for bacteriological contaminants, inorganic contaminants (IOC), volatile organic contaminants (VOC), synthetic organic contaminants (SOC) and radionuclide contaminants must be submitted before the new package treatment plant is put into service. The water from the package treatment plant must be in compliance with the United States Environmental Protection Agency (USEPA) National Primary Drinking Water Standards.

- 4 of 5 Operation and Maintenance manuals must be submitted for the package treatment upon completion of construction.

The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John J. Corra
Director
Department of Environmental Quality

3/24/06
Date of Issuance

MDB/mdb/jc/6-0236
~~SK~~ 3-21-06

STATEMENT OF BASIS

1. Permit Number: 06-063R
2. Application reviewed for compliance with the following regulations:
Chapters 3 and 12 of the Wyoming Water Quality Rules and Regulations.
3. Does the permit comply with all applicable regulations identified above?
The approval is based upon a deviation from applicable regulations in accordance with Section 5 of Chapter 12.
4. Facilities include components not specifically covered by regulations and approval is based upon a deviation from applicable regulations in accordance with Section 5 of the applicable regulations.
 - a. Identify specific sections of the regulations for which a deviation is approved and briefly summarize the regulations.

The permit includes approval to deviate from the following regulatory requirements:

Chapter 12, Section 9 (b)(i) requires water storage equal to twice the maximum daily demand.

- b. Briefly state the basis for the deviation.

This water system will only supply water to a mancamp. The mancamp owner has the ability to limit water use when the supply is limited. Total storage will equal 60% of twice the maximum daily demand.

5. If a Section 17 of Chapter 3 review is required indicate the basis for determining groundwater will be protected.
Not Required.
6. Documentation of Statement of Basis: The archives file for this permit include adequate documentation of all sections of this Statement of Basis.


CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Mark D. Baron, mbaron@state.wy.us, Environmental Senior Analyst and completed on March 21, 2006. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."



Department of Environmental Quality

To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.



Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

April 7, 2006

Robert A. DeBernardi
DeBernardi Construction Company
514 "G"
Rock Springs, WY 82901

RE: Water Line at 2751 Yellowstone Road, Section 15, T19N, R105W, Permit Number: 06-064R, Sweetwater County

Dear Mr. DeBernardi:

The above application to install 100 linear feet of 8-inch PVC water line, a fire hydrant and a meter vault with a double check backflow prevention assembly to serve an industrial lot has been reviewed in accordance with Chapter 3, Section 7; and Chapter 12, Section 14 of the Wyoming Water Quality Rules and Regulations and is hereby approved.

You are authorized to construct, the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact James Brough at 307-332-3144.

Sincerely,

James Brough, P.E.
Environmental Engineer
Water Quality Division


xc: IPS, Cheyenne
Amy M. Allen, P.E., JFC Engineers and Surveyors, 1515 9th St., Suite A, Rock Springs, WY 82901

encl: General Permit For a Public Water Supply Distribution System





Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

March 21, 2006

Mr. Zane White
Wind River Oilfield Services of Wyoming, LLC
P.O. Box 1997
Pinedale, WY 82941

RE: **Wind River Oilfield Services Heavy Industrial Employee Housing, Permit Number 06-065R**; SW1/4 Section 32, T31N, R107W, Sublette County

Dear Mr. White:

The above application for coverage under the General Permits to Construct, Install, Modify or Operate Small Wastewater Facilities in accordance with Chapter 3, Section 7 and Chapter 11 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved.

You are authorized to construct a 14 unit RV sewage collection main and small wastewater system in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.


Sincerely,

Doyle H. Conklin, P.E.
SW District Engineering Supervisor
Water Quality Division

cc: IPS, Cheyenne
Keith Raney, Sublette County Sanitarian; P.O. Box 722; Pinedale, WY 82941

encl.: General Permit to Construct, Install, Modify or Operate Small Wastewater Facilities





Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

March 13, 2006

Greg Dunn
Facilities Manager
WYSTAR Inc.
1095 Saberton Ave.
Sheridan, WY 82801

IPS

RE: WYSTAR Recovery Campus PUD-Men's Campus Ph 1 (Water & Sewer) 06-066
PWS# 5600052

Dear Greg:

The above application for coverage under General Permit to Construct, Install, Modify or Operate an extension to the City of Sheridan Wastewater Collection and Water Distribution system in accordance with Chapter 3 and Chapters 11 and 12 of the WWQRR has been reviewed and is hereby approved. You are now authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package. All construction, installation, or modification allowed by this permit shall be completed by March 1, 2007.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permits. Following completion of construction of this facility please return the attached WDEQ Certificate of Completion and the completed Transfer of Ownership.

If you have any questions please contact me at restes1@state.wy.us, 1866 S. Sheridan Avenue, Sheridan, WY, 82801, or by phone (307) 673-9337.

Sincerely,


Rick J. Estes, P.E.
WDEQ/WQD NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Scott R. Baxter, PE, CER, 237 N. Main, Sheridan, WY 82801
Jackie Flowers, PE, Public Works Director-Utilities, City of Sheridan





Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

April 7, 2006

Old Baldy Corporation
Attn: Marshal Brereton, General Manager
c/o Old Baldy Club
East Pic Pike Road
P.O. Box 825
Saratoga, Wyoming 82332

RE: Old Baldy 3rd & 4th Additions: Sewer System and Lift Station,
Application No. 06-068

Dear Mr. Brereton:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Sewage Collection Systems in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the sewage collection system in accordance with Chapter 11, Section 9 of the Water Quality Division Rules and Regulations, the general permit, and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

The approval granted under this Notification Of Coverage and the General Permit shall expire on April 7, 2008. Please reference Application Number 06-068 in any future correspondence.

If you have any questions, please contact me at (307) 777-6183.

Sincerely,

Ronald L. Ewald, P.E.
Environmental Senior Analyst
Southeast District, Water Quality Division
RLE/jc/6-0301

Enclosures: GENERAL PERMIT - Extensions/Modifications of Existing Sewage Collection Systems
Certificate of Completion Form

cc: IPS, Cheyenne
Jim I. Cavalli, Aspen-Banner Engineering, P.O. Box 550, Laramie, WY 82072

Herschler Building • 122 West 25th Street • Cheyenne, WY 82002 • <http://deq.state.wy.us>

ADMIN/OUTREACH
(307) 777-7758
FAX 777-3610

ABANDONED MINES
(307) 777-6145
FAX 777-6462

AIR QUALITY
(307) 777-7391
FAX 777-5616

INDUSTRIAL SITING
(307) 777-7369
FAX 777-6937

LAND QUALITY
(307) 777-7756
FAX 777-5864

SOLID & HAZ. WASTE
(307) 777-7752
FAX 777-5973

WATER QUALITY
(307) 777-7781
FAX 777-5973



AS-BUILT
PERMIT TO CONSTRUCT

New X

Permit No. 06-069

Old Faithful Water Treatment Plant Pre-sedimentation Basin

This permit hereby authorizes the applicant:

Nancy Ward, Assistant Chief of Maintenance, Special Projects
National Park Service
P.O. Box 168
Yellowstone NP, WY 82190

to have completed a geofabric-lined, earthen basin to hold raw water from the Firehole River for treatment in the Old Faithful water treatment plant according to the procedures and conditions of the application number 06-069. The facility is located at North 44.4565 Latitude and West -110.8102 Longitude, Yellowstone National Park in the county of Teton, in the State of Wyoming.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator. Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, meets applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit. The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, or any infringement of federal, state or local laws or regulations.

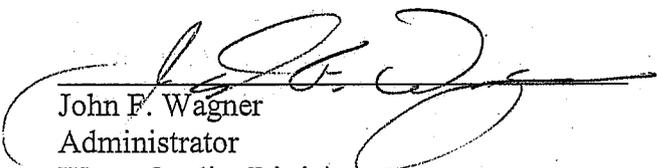
The permittee has constructed and shall operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

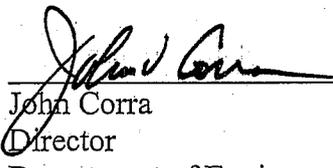
In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

1 of 2 When the water temperatures are 34 degrees Fahrenheit (1 degree Celsius) or less the velocity of flow into the intake structure shall not exceed 0.5 feet per second (i.e., 122 gpm in a 10-inch diameter pipe).

2 of 2 The pre-sedimentation basin shall be inspected on an annual basis to ensure that the integrity of the geofabric liner is in good condition. Any holes or leaks shall be repaired. The impoundment shall be cleared of all debris, brush, or vegetation.

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John Corra
Director
Department of Environmental Quality

2/22/06
Date of Issuance

JSBjc/6-0157

JRC 02-21-06

STATEMENT OF BASIS

1. Permit Number: 06-069
2. Application reviewed for compliance with the following regulations:
Chapter 12
3. Does the permit comply with all applicable regulations identified above?
Yes
4. A review to determine groundwater impacts in accordance with Section 17, Chapter 3.
Public water supplies are exempted from review by Chapter 3, Section 17.
5. Documentation of Statement of Basis: The archives file for this permit includes adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by, James Brough, Northwest District Engineer, jbroug@state.wy.us and completed on February 15, 2006. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

Cc: Sherri Jones, P.E.; Rothberg, Tamburini, Winsor; 1576 Sherman Street, Suite 100, Denver, CO 80203-1713

AS-BUILT
PERMIT TO CONSTRUCT

New X

Permit No. 06-070

Old Faithful Water 14-inch Transmission Line for Fire Protection

This permit hereby authorizes the applicant:

Nancy Ward, Assistant Chief of Maintenance, Special Projects
National Park Service
P.O. Box 168
Yellowstone NP, WY 82190

to have completed a new 14-inch transmission line that runs from the existing storage tank to the government area according to the procedures and conditions of the application number 06-070. The facility is located at North 44.4548 Latitude and West -110.8316 Longitude, Yellowstone National Park in the county of Teton, in the State of Wyoming.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator. Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, meets applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit. The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, or any infringement of federal, state or local laws or regulations.

The permittee has constructed and shall operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

1 of 1 No conditions are attached to this permit.

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John Corra
Director
Department of Environmental Quality

2/22/06
Date of Issuance

JSB/jc/6-0158

JSK 02-21-06

STATEMENT OF BASIS

1. Permit Number: 06-070
2. Application reviewed for compliance with the following regulations:
Chapter 12
3. Does the permit comply with all applicable regulations identified above?
Yes
4. A review to determine groundwater impacts in accordance with Section 17, Chapter 3.
Public water supplies are exempted from review by Chapter 3, Section 17.
5. Documentation of Statement of Basis: The archives file for this permit includes adequate documentation of all sections of this Statement of Basis.


CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by, James Brough, Northwest District Engineer, jbroug@state.wy.us and completed on February 15, 2006. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

Cc: Sherri Jones, P.E.; Rothberg, Tamburini, Winsor; 1576 Sherman Street, Suite 100, Denver, CO 80203-1713



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

February 21, 2006

Victor L. McMurry
P.O. Box 2816
Casper, WY 82602

RE: McMurry Small Wastewater Treatment System - Permit Number 06-072R, NE 1/4
Section 33, T34N, R109W, Sublette County

Dear Mr. McMurry:

The above application for coverage under General Permit to Construct a small wastewater treatment facility consisting of two 1000 gallon septic tanks, a 1000 pump tank and 532 feet of 2-inch pressure sewer service connected to the public sewer, to serve a four bedroom home and three bedroom guest home, in accordance with Chapter 3, Section 7 and Chapter 11, Part D of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Mark Baron, P.E.
Environmental Senior Analyst
Water Quality Division

xc: IPS, Cheyenne
Keith Raney, Environmental Health, Sublette County, P.O. Box 722, Pinedale, WY 82941
Randy Hubbard, Wastewater Superintendent, P.O. Box 709, Pinedale, WY 82941

encl: General Permit for Small Wastewater Treatment Systems

Page 1 of 1

Lander Field Office • 510 Meadowview Drive • Lander, WY 82520 • <http://deq.state.wy.us>

ABANDONED MINES
(307) 332-5085
FAX 332-7726

AIR QUALITY
(307) 332-6755
FAX 332-7726

LAND QUALITY
(307) 332-3047
FAX 332-7726


SOLID & HAZARDOUS WASTE
(307) 332-6924
FAX 332-7726

WATER QUALITY
(307) 332-3144
FAX 332-3183





Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

John Corra, Director

Dave Freudenthal, Governor

October 11, 2007

John Joyce, Project Director
Big Horn Regional Joint Powers Board
101 Grace Avenue
Worland, Wyoming 82401

RE: Revised Standard Specifications and Details for Big Horn Regional Joint Powers Board Transmission and Distribution Waterline Projects; Permit Number: 06-073; Big Horn, Washakie, and Hot Spring Counties

Dear Mr. Joyce:

On September 26, 2007, DEQ received a package from your consultant containing several proposed changes to the Standard Specifications which were recently assigned a DEQ permit #06-073. DEQ concurs that the proposed changes are in accordance with Chapter 3, Section 7; and Chapter 12, Section 14 of the Wyoming Water Quality Rules and Regulations. DEQ will file the recently submitted package with the above referenced permit application.

You are authorized to utilize the proposed changes to the standard specifications and details with the construction of the above referenced facilities in accordance with the general permit and the materials submitted in your application package. If you have any questions, please contact James Brough at 307-332-3144.

Sincerely,

James Brough, P.E.
Northwest District Engineer
Water Quality Division

xc: IPS, Cheyenne
Mark Hines, P.E., HKM Engineering Inc., P.O. Box 7010, Sheridan, WY 82801

F:\DIVISION\WQDIW&WW Section\2006 Permits & Reviews\06-073B.noc.jsb.doc

Lander Field Office • 510 Meadowview Drive • Lander, WY 82520 • <http://deq.state.wy.us>

ABANDONED MINES
(307) 332-5085
FAX 332-7726

AIR QUALITY
(307) 332-6755
FAX 332-7726

LAND QUALITY
(307) 332-3047
FAX 332-7726

SOLID & HAZARDOUS WASTE
(307) 332-6924
FAX 332-7726

WATER QUALITY
(307) 332-3144
FAX 332-3183



WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 06-074R

Big Horn Regional Northern Supply Pipeline Project - Element 1

This permit hereby authorizes the applicant:

John Joyce, Project Director
Big Horn Regional Joint Powers Board
1100 North 10th Street
Worland, WY 82401

to install almost 98,000 linear feet of 18-inch fiberglass and 20-inch PVC transmission line (extends west from Worland Well #3 to Highway 789 and then south to Big Horn/Washakie County line), a chlorination building, three pressure reducing vaults, and a pump station; according to the procedures and conditions of the application number 06-074R. The facility is located within Townships 49 and 50 North, Ranges 91 and 92 West in the county of Big Horn, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by June 5, 2009.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

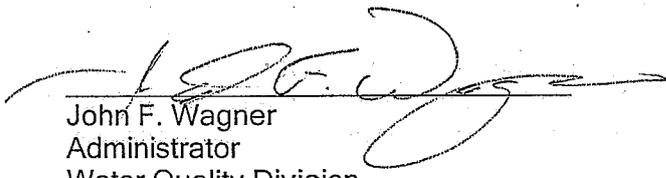
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, or any infringement of federal, state or local laws or regulations.

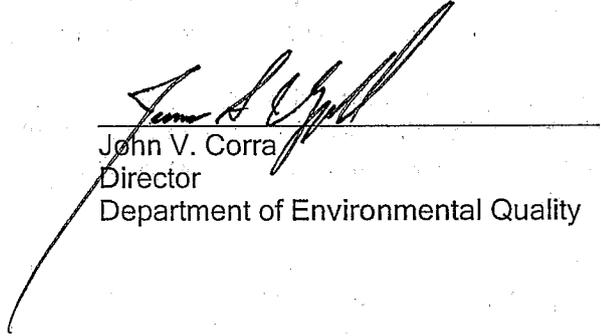
The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 4 Routine inspections and maintenance are essential for the long-term efficiency of this new water system. The owner needs to adhere to the manufacturer's maintenance recommendations for each piece of equipment.
- 2 of 4 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality, Water Quality Division (WQD), Northwest District Engineer, 510 Meadowview Drive, Lander, WY 82520, 307-332-3144, FAX 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 3 of 4 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northwest District a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
- a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.
- 4 of 4 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John V. Corra
Director
Department of Environmental Quality

6/7/6
Date of Issuance
JSB/jsb
6/6/6
bb/6-0508.PER

STATEMENT OF BASIS

1. Permit Number: 06-074R
2. Application reviewed for compliance with the following regulations:
Chapters 3 and 12 of the Wyoming Water Quality Rules and Regulations.
3. Does the permit comply with all applicable regulations identified above?
Yes.
4. If Section 17 of Chapter 3 review is required indicate the basis for determining groundwater will be protected.
Public water supplies are exempted from review by Chapter 3, Section 17.
5. Documentation of Statement of Basis: The archives file for this permit includes adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by James S. Brough, jbroug@state.wy.us, Environmental Senior Analyst and completed on June 5, 2006. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."


JSB/bb/6-0508.STM

cc: Mark Hines, HKM Engineering Inc., P.O. Box 7010, Sheridan, WY 82801

F:\DIVISION\WQDWPI\2006 Permits & Reviews\06-074R.pc.jsb.doc



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

March 23, 2006

Amir Algaar
4 Starters, LLC
P.O. Box 13723
Jackson, WY 83002

RE: Lincoln County - Etna Village Estates Phase I (Lots 1-56) - Water Main Extension -Permit Number 06-075, NE1/4 Section 10, T35N, R119W, Lincoln County, PWS # WY5600157

Dear Mr. Algaar:

The above application for coverage under General Permit to Construct a public water supply distribution system extension consisting of 5545 linear feet (LF) of 6 - inch and 1709 LF of 8 - inch PVC water main in accordance with Chapter 3, Section 7 and Chapter 12, Section 14 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Mark Baron, P.E.
Environmental Senior Analyst
Water Quality Division

xc: IPS, Cheyenne


encl: General Permit for Public Water Supply Distribution System

Page 1 of 1





Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

March 17, 2006

Kevin Ringdahl
L&K Construction, LLC
P.O. Box 1449
Green River, WY 82935

RE: Sweetwater County - Boars Tusk Subdivision Water Main Extension -Permit Number 06-076, NW1/4 SW 1/4 SE 1/4 Section 29, T20N, R105W, Sweetwater County, PWS # WY5601369

Dear Mr. Ringdahl:

The above application for coverage under General Permit to Construct a public water supply distribution system extension consisting of 7835 linear feet (LF) of 8 - inch and 4880 LF of 10-inch PVC water main in accordance with Chapter 3, Section 7 and Chapter 12, Section 14 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Mark Baron, P.E.
Environmental Senior Analyst
Water Quality Division

xc: IPS, Cheyenne

encl: General Permit for Public Water Supply Distribution System






Dave Freudenthal, Governor

Department of Environmental Quality

To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.



John Corra, Director

NOTIFICATION OF COVERAGE

March 15, 2006

Neil C. Outzen
Box 332
Gillette, WY 82717

RE: Outzen Commercial Septic, Permit # 06-077

Dear Neil:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of a commercial small wastewater septic system in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit. **A minimum of two (2) photos of the system installation, gravel and pipe or set infiltrators shall accompany the Certificate of Completion submitted to this office.** All construction, installation, or modification allowed by this permit shall be completed by June 1, 2007.

Typically, Campbell County Planning Department performs the final inspection for this installation. Please contact that office for this inspection. If you have any questions please contact me at 1866 S. Sheridan Avenue 673-9337, 673-2213 (fax).

Sincerely,

Rick J. Estes, P.E.
WDEQ/WQ NE District Senior Environmental Analyst


cc: ~~ES~~ES, Cheyenne
EJ Collins, PE, 200 W. Hogeeye, Gillette, WY 82716
Keith Bowar, Campbell County, 500 S. Gillette Ave, Suite 1500, Gillette, WY 82716





Department of Environmental Quality

To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.



John Corra, Director

Dave Freudenthal, Governor

NOTIFICATION OF COVERAGE

February 22, 2006

John Stahla
Stahla Construction
P.O. Box 818
Moorcroft, WY 82721

RE: Stahla Construction Home Septic System, Permit # 06-078

Dear John:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of a small wastewater septic system in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit. **A minimum of two (2) photos of the system installation, gravel and pipe or set infiltrators shall accompany the Certificate of Completion submitted to this office.** All construction, installation, or modification allowed by this permit shall be completed by January 1, 2007.

On August 4, 2004, the Crook County Commissioners enacted Resolution NO. 9-2004. This resolution requires that ALL small wastewater treatment facilities permitted by the Wyoming Department of Environmental Quality (WDEQ) and installed in Crook County after September 1, 2004, MUST BE INSPECTED BY AN INSPECTOR DESIGNATED BY CROOK COUNTY.

Please contact the Crook County Clerks Office for requirements of this resolution.

In addition, a Transfer of Ownership must be completed and submitted to this office if the property is sold to another individual.

Page 1 of 2


1866 SOUTH SHERIDAN AVENUE • SHERIDAN, WY 82801

AIR, LAND AND WATER DIVISIONS
(307) 673-WDEQ (9337) • FAX (307) 672-2213



If you have any questions please contact me at; 1866 S. Sheridan Avenue 673-9337, 673-2213
(fax).

Sincerely,

A handwritten signature in black ink, appearing to read "Rick J. Estes". The signature is fluid and cursive, with a large initial "R" and "E".


Rick J. Estes, P.E.
WDEQ/WQ NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Crook County Clerk, P.O. Box 37, Sundance, WY 82729
Vince Waters, NEWSO, 647 Mckean RD, Moorcroft, WY 82721



Department of Environmental Quality

To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.



Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

February 14, 2006

Dan VerBurg
2401 Nouglaes Way #108
Gillette, WY 82716

RE: VerBurg Residential Septic System, Permit # 06-079

Dear Joan:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of a small wastewater septic system in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. **A minimum of two (2) photos of the system installation, gravel and pipe or set infiltrators shall accompany the Certificate of Completion submitted to this office.** All construction, installation, or modification allowed by this permit shall be completed by January 1, 2007.

On August 4, 2004, the Crook County Commissioners enacted Resolution NO. 9-2004. This resolution requires that ALL small wastewater treatment facilities permitted by the Wyoming Department of Environmental Quality (WDEQ) and installed in Crook County after September 1, 2004, MUST BE INSPECTED BY AN INSPECTOR DESIGNATED BY CROOK COUNTY.

Please contact the Crook County Clerks Office for requirements of this resolution.

If you have any questions please contact me at; 1866 S. Sheridan Avenue 673-9337, 673-2213 (fax).

Sincerely,

Rick J. Estes, P.E.
WDEQ/WQ NE District Senior Environmental Analyst

cc: ~~IPS~~, Cheyenne
Crook County Clerk, P.O. Box 37, Sundance, WY 82729
Bob Lewton, Lewton Excavation, PO Box 672, Sturgis, SD,

Page 1 of 1

1866 SOUTH SHERIDAN AVENUE • SHERIDAN, WY 82801

AIR, LAND AND WATER DIVISIONS
(307) 673-WDEQ (9337) • FAX (307) 672-2213





Department of Environmental Quality



Dave Freudenthal, Governor

To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

John Corra, Director

NOTIFICATION OF COVERAGE

February 22, 2006

William E. Gartman
N56W35307 Appletree Ct.
Oconomowoc, WI 53066

RE: Gartman Home Septic System, Permit # 06-080

Dear William:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of a small wastewater septic system in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit. **A minimum of two (2) photos of the system installation, gravel and pipe or set infiltrators shall accompany the Certificate of Completion submitted to this office.** All construction, installation, or modification allowed by this permit shall be completed by March 1, 2007.

On August 4, 2004, the Crook County Commissioners enacted Resolution NO. 9-2004. This resolution requires that ALL small wastewater treatment facilities permitted by the Wyoming Department of Environmental Quality (WDEQ) and installed in Crook County after September 1, 2004, MUST BE INSPECTED BY AN INSPECTOR DESIGNATED BY CROOK COUNTY.

Please contact the Crook County Clerks Office for requirements of this resolution.

If you have any questions please contact me at; 1866 S. Sheridan Avenue 673-9337, 673-2213 (fax).

Sincerely,

Rick J. Estes, P.E.
WDEQ/WQ NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Crook County Clerk, P.O. Box 37, Sundance, WY 82729
Randy Gantz, Gantz Backhoe Service Inc., box 280, Hulett, WY 82720

Page 1 of 1

1866 SOUTH SHERIDAN AVENUE • SHERIDAN, WY 82801

AIR, LAND AND WATER DIVISIONS
(307) 673-WDEQ (9337) • FAX (307) 672-2213





Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

February 22, 2006

Daluss Siewert
P.O. Box 327
Beulah, WY 82712

RE: Siewert Home Septic System, Permit # 06-081

Dear Daluss:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of a small wastewater septic system in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit. **A minimum of two (2) photos of the system installation, gravel and pipe or set infiltrators shall accompany the Certificate of Completion submitted to this office.** All construction, installation, or modification allowed by this permit shall be completed by March 1, 2007.

On August 4, 2004, the Crook County Commissioners enacted Resolution NO. 9-2004. This resolution requires that ALL small wastewater treatment facilities permitted by the Wyoming Department of Environmental Quality (WDEQ) and installed in Crook County after September 1, 2004, MUST BE INSPECTED BY AN INSPECTOR DESIGNATED BY CROOK COUNTY.

Please contact the Crook County Clerks Office for requirements of this resolution.

If you have any questions please contact me at; 1866 S. Sheridan Avenue 673-9337, 673-2213 (fax).

Sincerely,

Rick J. Estes, P.E.
WDEQ/WQ NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Crook County Clerk, P.O. Box 37, Sundance, WY 82729
Randy Gantz, Gantz Backhoe Service Inc., Box 280, Hulett, WY 82720

Page 1 of 1


1866 SOUTH SHERIDAN AVENUE • SHERIDAN, WY 82801

AIR, LAND AND WATER DIVISIONS
(307) 673-WDEQ (9337) • FAX (307) 672-2213





Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

February 22, 2006

Lance Rogers
P.O. Box 86
Hulett, WY 82720

RE: Tt Campsite Septic System, Permit # 06-082

Dear Lance:

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of a small wastewater septic system in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) has been reviewed and is hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit. **A minimum of two (2) photos of the system installation, gravel and pipe or set infiltrators shall accompany the Certificate of Completion submitted to this office.** All construction, installation, or modification allowed by this permit shall be completed by March 1, 2007.

On August 4, 2004, the Crook County Commissioners enacted Resolution No. 9-2004. This resolution requires that ALL small wastewater treatment facilities permitted by the Wyoming Department of Environmental Quality (WDEQ) and installed in Crook County after September 1, 2004, MUST BE INSPECTED BY AN INSPECTOR DESIGNATED BY CROOK COUNTY.

Please contact the Crook County Clerks Office for requirements of this resolution.

If you have any questions please contact me at; 1866 S. Sheridan Avenue 673-9337, 673-2213 (fax).

Sincerely,

Rick J. Estes, P.E.
WDEQ/WQ NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Crook County Clerk, P.O. Box 37, Sundance, WY 82729
Randy Gantz, Gantz Backhoe Service Inc., box 280, Hulett, WY 82720





Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

February 15, 2006

Mr. Kenneth Krieger, P.G.A. Professional
Cheyenne Country Club
800 Stinner Road
Cheyenne, WY 82001

RE: Cheyenne Country Club Fire Line, Application No.06-083, Laramie County

Dear Mr. Krieger:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems described as 6" diameter fire service tap and 4" fire line to building, SW 1/4 Section 24 T14N R67W; Laramie County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, the general permit and the materials submitted in your application package. All construction, installation, or modification allowed by this notification of coverage shall be completed by May 10, 2008.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 06-083 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne

Mr. Herman Noe, Manager of Engineering
Cheyenne Board of Public Utilities
P.O. Box 1469
Cheyenne, WY 82003-1469


Rick Johnston, Gust & Johnston
523 West 27th, Suite A-1
Cheyenne, WY 82001

LBH/jc/6-0146

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002 • <http://deg.state.wy.us>

| | | | | | | |
|--|---|---|---|--|--|---|
| ADMIN/OUTREACH (307) 777-7758 FAX 777-3610 | ABANDONED MINES (307) 777-6145 FAX 777-6462 | AIR QUALITY (307) 777-7391 FAX 777-5616 | INDUSTRIAL SITING (307) 777-7368 FAX 777-6937 | LAND QUALITY (307) 777-7756 FAX 777-5864 | SOLID & HAZ. WASTE (307) 777-7752 FAX 777-5973 | WATER QUALITY (307) 777-7781 FAX 777-5973 |
|--|---|---|---|--|--|---|





The State
of Wyoming



Department of Environmental Quality

Dave Freudenthal, Governor

John Corra, Director

152 N. Durbin Street • Suite 100 • Casper, Wyoming 82601

NOTIFICATION OF COVERAGE

February 15, 2006

Hal Hutchinson, City Engineer
City of Casper
200 N. David
Casper, WY 82601

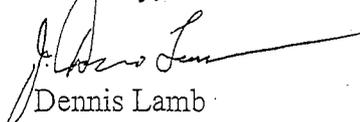
RE: Beverly Street Pedestrian Bypass Sewer ReRoute Permit # 06-084

Dear Mr. Hutchinson;

The above application for coverage under General Permit to Construct, Install, Modify or Operate extensions to or modifications of existing sewage collection systems in accordance with Chapter 3 and Chapter 11, Part B, of the Wyoming Water Quality Rules and Regulations (WWQRR) have been reviewed and are hereby approved. You are authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O. of the general permit.

If you have any questions please contact Dennis Lamb at 152 North Durbin Street, Casper, WY, 82601, (307) 473-3452. Thank you.

Sincerely,


Dennis Lamb
NE District Supervisor
DEQ/WQD

cc: IPS, Cheyenne



WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
"AS-BUILT" PERMIT TO CONSTRUCT

PERMIT NO. 06-086

Kenai, Plan of Development (POD): Impoundment 22-3-5375

This permit hereby authorizes the applicant:

Comet Energy Services, Inc.
Attn: Mr. Kent Fink
1241 Eagle View
Buffalo, Wyoming 82834

to have installed one compliance monitoring well according to the procedures and conditions of the application number 06-086. The facilities are proximal to the on channel coal bed methane produced water impoundment located in Township 53N, Range 75W, Section 3, in the county of Campbell, in the State of Wyoming. The WYPDES Permit Number is #0054330 (001). All construction, installation, or modifications allowed by this permit have been completed.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facilities to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facilities described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facilities. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facilities. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facilities are located or are being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

1 of 2: The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/ Water Quality Division, Groundwater Program, 1866 South Sheridan Avenue, Sheridan, WY 82801, (307)-673-9337, fax (307)-672-2213, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.

2 of 3: The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/ Water Quality Division, Groundwater Program, 1866 South Sheridan Avenue, Sheridan, WY 82801, 307-673-9337, fax 307-672-2213 when discharge to each impoundment covered under this permit commences.

3 of 3: Monitoring Requirements:

Groundwater monitoring at the impoundments shall be performed on a quarterly basis until further notice and shall include the following information:

- Measurement of static water level and sampling and analysis of groundwater at downgradient well; Crump MW#1-B.
- Reporting results of quarterly monitoring and sampling need to be at the department by January 15th, April 15th, July 15th, and October 15th of each year. The first set of data will be due by July 15, 2006.

The parameters listed in the table below are required for groundwater compliance monitoring beneath the listed impoundment:

**Impoundment 22-3-5375
WYPDES #WY0054330 (001)**

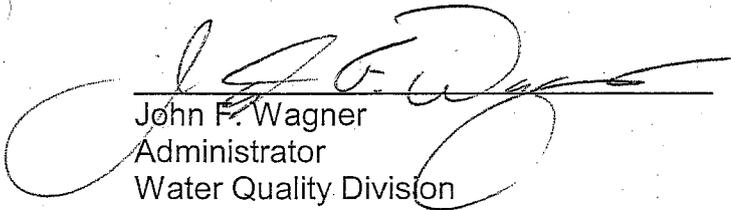
| Parameter | Crump MW#1-B Background Value (mg/L) (4/14/06) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|-----------|---|-------------------------|---|
| Arsenic | 0.003 | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 2480 | ≥ 2740 | 3000 |

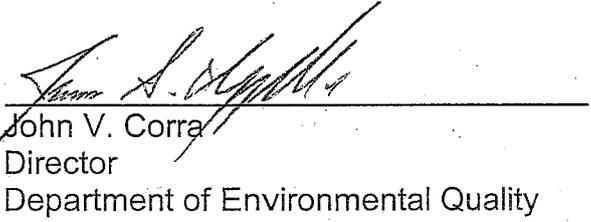
| | | | |
|------------------------------|------|--------|----------------|
| Total Dissolved Solids (TDS) | 4340 | ≥ 4670 | ≥ 5000 |
| pH | 7.55 | ≤ 6.5 | 6.5 – 8.5(s.u) |

Trigger values, specific to the groundwater samples at each impoundment, have been assigned to each constituent and are also listed above. If one or more of these trigger values is exceeded during a quarterly sampling event, monthly sampling of the groundwater for all listed parameters is required, with the analytical results due by the 15th day of each month. If groundwater monitoring reveals a pH measurement of 6.5 or less, the WDEQ may require sampling and analysis of groundwater for the following additional parameters: aluminum, boron, cadmium, chromium, copper, lead and zinc.

The analytical results for each sampling event, along with impoundment and monitor well location information must be submitted in the Excel spread sheet "Compliance Monitoring Data Reporting", which can be found on the WDEQ website at the following address: (<http://deq.state.wy.us/wqd/groundwater/pollution.asp>). These data shall be submitted electronically on the due dates established above to the following department address: cbmgroundwater@state.wy.us. In addition, the accompanying analytical laboratory reports must also be submitted either electronically (pdf format) or hard copy via mail to the WDEQ, Sheridan office at the address listed above.

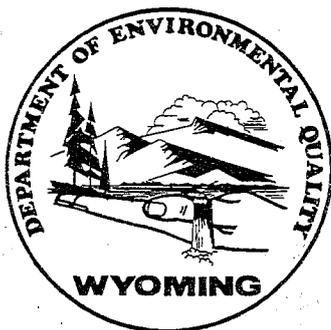
AUTHORIZED BY:


 John F. Wagner
 Administrator
 Water Quality Division


 John V. Corra
 Director
 Department of Environmental Quality

5/18/04
 Date of Issuance

TW/jc/6-0383



GROUNDWATER PROGRAM
REVIEW COMMENTS:
PLANS/SPECIFICATIONS/PROPOSALS/REPORTS

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
1866 South Sheridan Avenue
Sheridan, WY 82801
Phone: 307-672-6457

PERMIT TYPE: CBM: Groundwater Compliance Monitoring Program

WATER QUALITY DIVISION REFERENCE (PERMIT) NUMBER: 06-086

SITE (POD) NAME: Kenai POD

APPLICANT: Mr. Kent Fink
Comet Energy Services, Inc.
1241 Eagle View
Buffalo, Wyoming 82834

CONSULTANT: Western Land Services
Attn. Phil Turner
54 W. Seymour Street
Sheridan, Wyoming 82801

LOCATION: Drainage: Unnamed tributary to the Middle Prong of Wild Horse
Creek tributary to the Powder River
County: Campbell
Township 53 North; Range 75 West; Sections 3

WYPDES No: Discharge Permit #WY0054330 (001)

DATE ON REPORT: February 10, 2006 & April 24, 2006

REVIEWING OFFICIAL: Terry Webster, North District Groundwater Sen. Analyst

DATE OF THIS REVIEW: February 16, 2006 & March 2, 2006

ACTION: Compliance Monitoring Plan authorized for Kenai POD pursuant
to conditions on permit # 06-086

- Measurement of static water level and sampling and analysis of groundwater at downgradient well Crump MW#1-B.
- Reporting results of quarterly monitoring and sampling need to be at the department by January 15th, April 15th, July 15th, and October 15th of each year. The first set of data will be due by July 15, 2006.

The parameters listed in the tables below are required for groundwater compliance monitoring beneath the listed impoundments:

**Impoundment 22-3-5375
WYPDES #WY0054330 (001)**

| Parameter | Crump MW#1-B Background Value (mg/L) (4/14/06) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|---|-------------------------|---|
| Arsenic | 0.003 | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 2480 | ≥ 2740 | 3000 |
| Total Dissolved Solids (TDS) | 4340 | ≥ 4670 | ≥ 5000 |
| pH | 7.55 | ≤ 6.5 | 6.5 – 8.5(s.u) |

Trigger values, specific to the groundwater samples at this impoundment, have been assigned to each constituent and are also listed above. If one or more of these trigger values is exceeded during a quarterly sampling event, monthly sampling of the groundwater for all listed parameters is required, with the analytical results due by the 15th day of each month. If groundwater monitoring reveals a pH measurement of 6.5 or less, the WDEQ may require sampling and analysis of groundwater for the following additional parameters: aluminum, boron, cadmium, chromium, copper, lead and zinc.

The analytical results for each sampling event, along with impoundment and monitor well location information must be submitted in the Excel spread sheet "Compliance Monitoring Data Reporting", which can be found on the WDEQ website at the following address: (<http://deq.state.wy.us/wqd/groundwater/pollution.asp>). These data shall be submitted electronically on the due dates established above to the following department address: cbmgroundwater@state.wy.us. In addition, the accompanying analytical laboratory reports must also be submitted either electronically (pdf format) or hard copy via mail to the WDEQ, Sheridan office at the address listed above.

END OF REVIEW

TW/jc/6-0384



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

March 27, 2006

Mr. Charles Guschewsky
Blue Oval, LLC
555 East Main Street
Lander, WY 82520

RE: **Cummins Intermountain – Water Distribution, Permit No. 06-087**; SW1/4 Section 33, T19N, R105W, Sweetwater County

Dear Mr. Guschewsky:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to Existing Public Water Supply Distribution Systems in accordance with Chapter 3, Section 7 and Chapter 12 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved.

You are authorized to construct, install or modify the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact me at 307-332-3144.

Sincerely,

Doyle H. Conklin, P.E.
SW District Engineering Supervisor
Water Quality Division

cc: IPS, Cheyenne
City of Rock Springs; Attn: Paul Kauchich, P.E.; 212 D Street; Rock Springs, WY 82901
Bryan Seppie, P.E; Joint Powers Water Board; P.O. Box 1299; Green River, WY 82935

encl.: General Permit for Extensions to Existing Public Water Distribution Systems

Lander Field Office • 510 Meadowview Drive • Lander, WY 82520 • <http://deq.state.wy.us>

ABANDONED MINES
(307) 332-5085
FAX 332-7726

AIR QUALITY
(307) 332-6755
FAX 332-7726

LAND QUALITY
(307) 332-3047
FAX 332-7726

SOLID & HAZARDOUS WASTE
(307) 332-6924
FAX 332-7726

WATER QUALITY
(307) 332-3144
FAX 332-3183





Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

May 15, 2006

Christian Community Service Church
Attn: Jose E. Gallegos, Board Member
91 South Wheatland Hwy.
Wheatland, Wyoming 82201

RE: Christian Community Service Church – Septic System, Application No. **06-088**
Location: SW¼ SW¼, Section 24, T24N, R68W, Platte County

Dear Board Member Gallegos:

The above application for coverage under General Permit to Construct, Install, Modify or Operate a Small Wastewater Facility for a domestic type waste septic system and leachfield for a church in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the small wastewater system in accordance with Chapter 11, Part D of the Water Quality Division Rules and Regulations, the general permit, the condition listed below, and the materials submitted in your application package.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Additionally, the following project specific condition also applies:

Septic Tank Clean-Out Riser Requirement - Either a 6 inch diameter clean-out riser or the manway from **the compartments of the septic tank** must be extended to the ground surface.

The approval granted under this Notification Of Coverage and the General Permit shall expire on May 15, 2008. Please reference Application Number **06-088** in any future correspondence.

Herschler Building • 122 West 25th Street • Cheyenne, WY 82002 • <http://deq.state.wy.us>

ADMIN/OUTREACH
(307) 777-7758
FAX 777-3610

ABANDONED MINES
(307) 777-6145
FAX 777-6462

AIR QUALITY
(307) 777-7391
FAX 777-5616

INDUSTRIAL SITING
(307) 777-7369
FAX 777-6937

LAND QUALITY
(307) 777-7756
FAX 777-5864


SOLID & HAZ. WASTE
(307) 777-7752
FAX 777-5973

WATER QUALITY
(307) 777-7781
FAX 777-5973



If you have any questions, please contact me at (307) 777-6183.

Sincerely,

A handwritten signature in cursive script that reads "Ronald L. Ewald".

Ronald L. Ewald, P.E.
Environmental Senior Analyst
Southeast District, Water Quality Division

RLE/jc/6-0406

Enclosures: GENERAL PERMIT - Small Wastewater Facility
Certificate of Completion

cc: IPS, Cheyenne
Gary Weber, Weber Building and Development, 21 Cozad Road, Wheatland,
Wyoming 82201
Platte County Planner, Marlin Johnson, P.O. Box 728, Wheatland, Wyoming 82201



The State
of Wyoming

Department of Environmental Quality



Dave Freudenthal, Governor

152 N. Durbin Street • Suite 100 • Casper, Wyoming 82601

SOLID & HAZARDOUS WASTE DIVISION
(307) 473-3450
Fax: (307) 473-3458

AIR QUALITY DIVISION
(307) 473-3455
Fax: (307) 473-3458

WATER QUALITY DIVISION
(307) 473-3465
Fax: (307) 473-3458

NOTIFICATION OF COVERAGE

April 13, 2006

Mr. Mike Nelson
Public Works Director
City of Green River
50 East 2nd North
Green River, WY 82935

RE: Green River Northside 4 Improvements Phase A, Application No. 06-089

Dear Mr. Nelson:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modification of Existing Public Water Supply Distribution Systems in accordance with Chapter 3 and Chapter 12 of the Wyoming Water Quality Rules and Regulations and for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modification of Existing Sewage Collection Systems in accordance with Chapter 3 and Chapter 11 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the facility(ies) in accordance with the general permits and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V. Section O. of the general permits.

If you have any questions, please contact me at 307-473-3471.

Sincerely,

Kevin J. Frank

Kevin J. Frank, PE
Senior Analyst
Water Quality Division

cc: IPS, Cheyenne

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 06-090

REFERENCE PERMIT NO. 05-242

Flat Creek Motel Sanitary Sewer System

This permit hereby authorizes the applicant:

CDK Sewer, LLC
Flat Creek Motel
P.O. Box 12710
Jackson, WY 83002

to install three service laterals, a 6-inch sewer main, a lift station with grinder pumps, a 3-inch force main (7,054 linear feet), manholes, cleanouts, and a connection to Jackson's gravity sewer system; according to the procedures and conditions of the application number 06-090. The facility is located within Sections 22, 27 & 28, Township 41 North and Range 116 West in the county of Teton, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by September 30, 2006.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

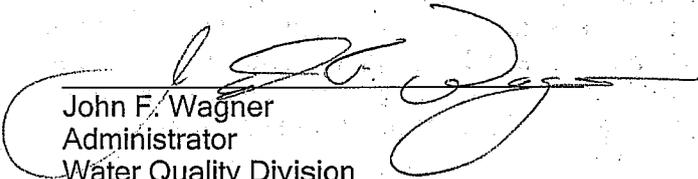
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, or any infringement of federal, state or local laws or regulations.

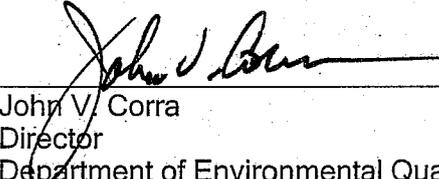
The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 3 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality, Water Quality Division (WQD), Northwest District Engineer, 250 Lincoln Street, Lander, WY 82520, 307-332-3144, FAX 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 3 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northwest District a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
- a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.
- 3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John V. Corra
Director
Department of Environmental Quality

3/4/06
Date of Issuance
ARK 03/02/06
JCH/jch/jc/6-0187

STATEMENT OF BASIS

1. Permit Number: 06-090
2. Application reviewed for compliance with the following regulations:
Chapters 3 and 11 of the Wyoming Water Quality Rules and Regulations.
3. Does the permit comply with all applicable regulations identified above? No
Chapter 11, Section 9 (c)(ii)(B) states that the minimum force main size is 4-inch diameter. A 3-inch diameter force main is sufficiently large since the lift station is preceded by a grinder and can handle the expected flow rates at this facility.
Chapter 11, Section 9 (d) gives a maximum spacing of 400 feet between manholes. The local sewer cleaning contractor has the capability of pressure cleaning 1,000 linear feet (500 feet each direction).
4. Facilities include components not specifically covered by regulations and approval is based upon a deviation from applicable regulations in accordance with Section 5 of applicable regulations.
No
5. If Section 17 of Chapter 3 review is required indicate the basis for determining groundwater will be protected.
Chapter 3, Section 17(a)(i) allows for no groundwater review if there is no discharge to groundwater. This facility does not discharge to groundwater.
6. Documentation of Statement of Basis: The archives file for this permit includes adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Jeff Hermansky, jherma@state.wy.us, NW District Engineering Supervisor and completed on March 2, 2006. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

xc: Thomas Kirsten, P.E., Jorgensen Associates, P.O. Box 9550, Jackson, WY 83002
Archive Plans, 05-242



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

February 21, 2006

Mr. Herman Noe, Manager of Engineering
Cheyenne Board of Public Utilities
P.O. Box 1469
Cheyenne, WY 82003-1469

RE: Cheyenne Southern View Sub. Water and Sewer Extensions, Application No.06-091, Laramie County

Dear Mr. Noe:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems and of Existing Sewage Collection Systems described as 8" diameter water line, relocation of water meter vault to SCWSD, and 8" diameter sewer line, SE 1/4 Section 5 T13N R63W; Laramie County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, the sewage collection system in accordance with Chapter 11, Section 9 of the Water Quality Division Rules and Regulations, and both systems in accordance with the general permit and the materials submitted in your application package. All construction, installation, or modification allowed by this notification of coverage shall be completed by May 10, 2008.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 06-091 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne
Lawrence R. Gallagher, Summit Engineering, LLC
5907 Townsend Place
Cheyenne, WY 82009

LBH/jc/6-0161

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002 • <http://deg.state.wy.us>

ADMIN/OUTREACH
(307) 777-7758
FAX 777-3610

ABANDONED MINES
(307) 777-6145
FAX 777-6462

AIR QUALITY
(307) 777-7391
FAX 777-5616

INDUSTRIAL SITING
(307) 777-7368
FAX 777-6937

LAND QUALITY
(307) 777-7756
FAX 777-5864

SOLID & HAZ. WASTE
(307) 777-7752
FAX 777-5973

WATER QUALITY
(307) 777-7781
FAX 777-5973





Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

April 27, 2006

Tim Karlberg
1004 11th Street
Wheatland, Wyoming 82201

RE: Karlberg Residential Septic System, Application No. **06-092**
Location: SE¼ NE¼, Section 34, T22N, R69W, Platte County

Dear Mr. Karlberg:

The above application for coverage under General Permit to Construct, Install, Modify or Operate a Small Wastewater Facility for a **3 bedroom** house in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the small wastewater system in accordance with Chapter 11, Part D of the Water Quality Division Rules and Regulations, the general permit, the condition listed below, and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Additionally, the following project specific condition also applies:

Septic Tank Clean-Out Riser Requirement - Either a 6 inch diameter clean-out riser or the manway from **each compartment of the tank** must be extended to the ground surface.

The approval granted under this Notification Of Coverage and the General Permit shall expire on April 27, 2008. Please reference Application Number **06-092** in any future correspondence.

If you have any questions, please contact me at (307) 777-6183.

Sincerely,

Ronald L. Ewald, P.E.
Environmental Senior Analyst
Southeast District, Water Quality Division
RLE/jc/6-0353

Herschler Building • 122 West 25th Street • Cheyenne, WY 82002 • <http://deq.state.wy.us>

| | | | | | | |
|--|---|---|---|--|--|---|
| ADMIN/OUTREACH (307) 777-7758 FAX 777-3610 | ABANDONED MINES (307) 777-6145 FAX 777-6462 | AIR QUALITY (307) 777-7391 FAX 777-5616 | INDUSTRIAL SITING (307) 777-7369 FAX 777-6937 | LAND QUALITY (307) 777-7756 FAX 777-5864 | SOLID & HAZ. WASTE (307) 777-7752 FAX 777-5973 | WATER QUALITY (307) 777-7781 FAX 777-5973 |
|--|---|---|---|--|--|---|



Enclosures: GENERAL PERMIT - Small Wastewater Facility
Certificate of Completion

cc: IPS, Cheyenne
Mike Grant, Mike Grant Construction, 433 Richeau Road, Wheatland, WY 82001
Platte County Planner, Marlin Johnson, P.O. Box 728, Wheatland, Wyoming 82201



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

April 12, 2006

Matt Thurling
The Home Depot
370 Corporate Drive
Tukwila, WA 98188

IPS

RE: Home Depot (Water & Sewer) 06-093
PWS# 5600052

Dear Matt:

The above application for coverage under General Permit to Construct, Install, Modify or Operate an extension to the City of Sheridan Wastewater Collection and Water Distribution system in accordance with Chapter 3 and Chapters 11 and 12 of the WWQRR has been reviewed and is hereby approved. You are now authorized to construct, install, or modify the facility in accordance with general permit and the materials submitted in your application package. All construction, installation, or modification allowed by this permit shall be completed by May 1, 2007.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permits. Following completion of construction of this facility please return the attached WDEQ Certificate of Completion and the completed Transfer of Ownership of any facilities to be owned by others.

If you have any questions please contact me at restes1@state.wy.us, 1866 S. Sheridan Avenue, Sheridan, WY, 82801, or by phone (307) 673-9337.

Sincerely,

Rick J. Estes, P.E.
WDEQ/WQD NE District Senior Environmental Analyst

cc: IPS, Cheyenne
Dave Guetig, PE, Galloway, Romero & Associates, 5350 DTC Parkway, Greenwood Village, CO 80111
Jackie Flowers, PE, Public Works Director-Utilities, City of Sheridan

Page 1 of 1

1866 SOUTH SHERIDAN AVENUE • SHERIDAN, WY 82801

AIR, LAND AND WATER DIVISIONS
(307) 673-WDEQ (9337) • FAX (307) 672-2213



WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
AS-BUILT
PERMIT TO CONSTRUCT

New Permit

PERMIT NO. 06-095

WOLF CREEK CAMPGROUND

This permit hereby authorizes the applicant:

Bridger Teton National Forest
P.O. Box 1689
Jackson, WY 83001

to have constructed Wolf Creek Campground according to the procedures and conditions of the application number 06-095. The facility is located in SE ¼ Section 5, T37N, R117W in the county of Lincoln, in the State of Wyoming. All construction, installation, or modification allowed by this permit has been completed.

The issuance of this permit confirms that the Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and/or operator. Granting this permit does not imply that the Wyoming DEQ guarantees or ensures that the permitted facility, meets applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by the DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by the DEQ statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and/or operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the state does not waive its sovereign immunity.

The permittee shall allow authorized representatives from the DEQ, Water Quality Division, to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

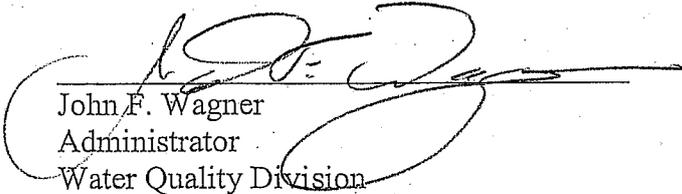
Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and/or operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit. The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

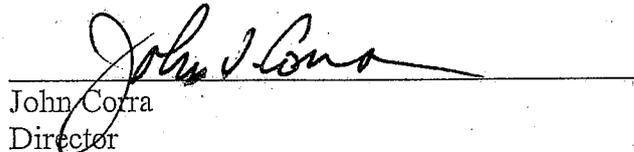
The permittee has constructed and shall operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and/or operator shall comply with all of the following permit conditions:

1 of 1 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John Corra
Director
Department of Environmental Quality

4/12/06
Date of Issuance

DHC/dhc/jc/6-0258

xc: Pete Hallsten; WYDOT; P.O. Box 14700; Jackson, WY 83001
Jonathan Teichert; Lincoln County Planning Office; P.O. Box 468; Kemmerer, WY 83101

STATEMENT OF BASIS


1. Permit Number: 06-095
2. Application reviewed for compliance with the following regulations:
Chapters 3, 11 and 12 of the Wyoming Water Quality Rules and Regulations
3. Does the permit comply with all applicable regulations identified above?
Yes
4. A review to determine groundwater impacts in accordance with Section 17, Chapter 3.
Not Required
5. Documentation of Statement of Basis: The archives file for this permit includes adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by, Doyle H. Conklin, Southwest District Engineering Supervisor, dconkl@state.wy.us, and completed on March 28, 2006. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

March 30, 2006

Carole "Kniffy" Hamilton
Forest Supervisor
Bridger Teton National Forest
P.O. Box 1689
Jackson, WY 83001

RE: As-Built Permit To Construct, WQD Permit No. 06-095

Dear Ms. Hamilton:

The Department of Environmental Quality/Water Quality Division (DEQ/WQD) has reviewed the referenced As-Built Application submitted by your engineer, Craig Smith. Our review of the information and as-constructed plans submitted to this office indicates that the application meets DEQ/WQD regulations and the enclosed As-Built Permit To Construct is hereby issued. The enclosed permit covers Wolf Creek Campground which has already been constructed.

Please be advised that the system must be constructed, installed and operated in accordance with the statements, representations and procedures presented in the application and all supporting documentation as well as the terms and conditions of Permit No. 06-095. You are urged to be familiar with all aspects of the permit application, permit and permit conditions. Any person objecting to a permit issued by the DEQ and desiring affirmative relief may request a hearing before the Environmental Quality Council in accordance with the Rules of Practice and Procedure for the Department of Environmental Quality and the Wyoming Administrative Procedures Act.

Sincerely,

John Corra
Director
Department of Environmental Quality

JC/DHC/dhc/jc/6-0257
DRN 4-7-6

Enclosure

cc: IPS

Herschler Building • 122 West 25th Street • Cheyenne, WY 82002 • <http://deq.state.wy.us>

ADMIN/OUTREACH
(307) 777-7758
FAX 777-3610

ABANDONED MINES
(307) 777-6145
FAX 777-6462

AIR QUALITY
(307) 777-7391
FAX 777-5616

INDUSTRIAL SITING
(307) 777-7369
FAX 777-6937

LAND QUALITY
(307) 777-7756
FAX 777-5864


SOLID & HAZ. WASTE
(307) 777-7752
FAX 777-5973

WATER QUALITY
(307) 777-7781
FAX 777-5973





Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

March 3, 2006

Mr. William Merrill, City Engineer
City of Laramie
P.O. Box C
Laramie, Wyoming 82073

RE: City of Laramie Palmer Drive Water Distribution Replacement, App. No.06-096,Albany County

Dear Mr. Merrill:

The above application for coverage under General Permit to Construct, Install, Modify or Operate Extensions to or Modifications of Existing Public Water Supply Distribution Systems described as replacement of 860 feet of 8" diameter cast iron pipe with 860 ft of 8" diameter PVC pipe with appurtenances, NW 1/4 Section 3 T15N R73W; Albany County, in accordance with Chapter 3, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved. You are authorized to construct, install or modify the water distribution system in accordance with Chapter 12, Section 14 of the Water Quality Division Rules and Regulations, the general permit and the materials submitted in your application package. All construction, installation, or modification allowed by this notification of coverage shall be completed by May 10, 2008.

Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit. Please reference Application No. 06-096 in any future correspondence.

If you have any questions, please contact me at 307-777-7088.

Sincerely,

Louis B. Harmon PE-PG
Southeast District Engineer
Water Quality Division

cc: IPS, Cheyenne

LBH/jc/6-0190

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002 • <http://deg.state.wy.us>

ADMIN/OUTREACH
(307) 777-7758
FAX 777-3610

ABANDONED MINES
(307) 777-6145
FAX 777-6462

AIR QUALITY
(307) 777-7391
FAX 777-5616

INDUSTRIAL SITING
(307) 777-7368
FAX 777-6937

LAND QUALITY
(307) 777-7756
FAX 777-5864

SOLID & HAZ. WASTE
(307) 777-7752
FAX 777-5973

WATER QUALITY
(307) 777-7781
FAX 777-5973



WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION

PERMIT TO CONSTRUCT

PERMIT NO. 06-097

Kemmerer Diamondville Water Treatment Plant

PWS: WY560028

This permit hereby authorizes the applicant:

Kemmerer Diamondville Water and Wastewater Joint Powers Board
Attn: Barry E Mootz
700 Cedar Avenue
Kemmerer, WY 83101

to construct, install or modify a 5 micron sediment filter unit and an ultraviolet disinfection system for the water plant restroom according to the procedures and conditions of application number 06-097. The facility is located in NW1/4 Section 12, T21N, R116W, in the county of Lincoln, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by April 30, 2008.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

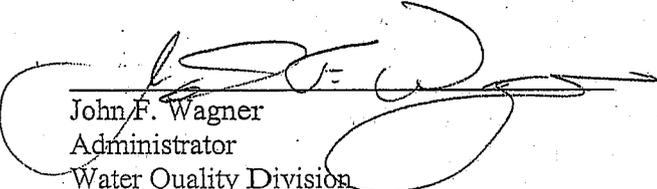
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.


The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 3 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/ Water Quality Division, District, 510 Meadowview Drive, Lander, WY 82520, 307-332-3144, fax 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 3 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the District a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
 - a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.
- 3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John V. Corra
Director
Department of Environmental Quality

Date of Issuance

4/10/06

DHC/dhc/jc/6-0299

JRK 4-10-6

STATEMENT OF BASIS

1. Permit Number: 06-097
2. Application reviewed for compliance with the following regulations :
Chapter(s) 3 and 12 of the Wyoming Water Quality Rules and Regulations
3. Does the permit comply with all applicable regulations identified above?
Yes
4. A review to determine groundwater impacts in accordance with Section 17, Chapter 3.
Not Applicable. Public water supplies are exempted from review by Chapter 3, Section 17.
5. Documentation of Statement of Basis: The archives file for this permit include adequate documentation of all sections of this Statement of Basis.

CERTIFICATION

The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by Doyle H. Conklin, dconkl@state.wy.us, Southwest District Engineering Supervisor, and authorized on April, 5, 2006. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents, permit conditions, and the items identified in this "Statement of Basis."

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
"AS-BUILT" PERMIT TO CONSTRUCT

PERMIT NO. 06-098

Recluse 18-1

This permit hereby authorizes the applicant:

Kennedy Oil
Attn: Tami Henry
700 West Sixth Street
Gillette, Wyoming 82716

to have installed one compliance monitoring well according to the procedures and conditions of the application number 06-098. The facilities are proximal to the on channel coalbed methane produced water impoundment located in Township 56N, Range 73W, Section 18, in the county of Campbell, in the State of Wyoming. All construction, installation, or modification allowed by this permit has been completed.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, nor any infringement of federal, state or local laws or regulations.

The permittee shall operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

1 of 3: The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/ Water Quality Division, Groundwater Program, 1866 South Sheridan Avenue, Sheridan, WY 82801, 307-673-9337, fax 307-672-2213, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.

2 of 3: The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality/ Water Quality Division, Groundwater Program, 1866 South Sheridan Avenue, Sheridan, WY 82801, 307-673-9337, fax 307-672-2213 when discharge to the impoundment covered under this permit commences.

2 of 3: Monitoring Requirements:

Groundwater monitoring at the impoundment shall be performed on a quarterly basis until further notice and shall include the following information:

- Measurement of static water level and sampling and analysis of groundwater at well Recluse MW18-1.
- Reporting results of quarterly monitoring and sampling need to be at the department by January 15th, April 15th, July 15th, and October 15th of each year. The first set of data will be due by **April 15, 2006**.

The parameters listed in the tables below are required for groundwater compliance monitoring beneath the listed impoundment:

Impoundment Recluse 18-1

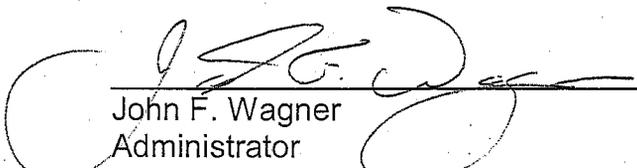
| Parameter | Recluse MW18-1 Background Value (mg/L) (12/21/04) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|-----------|--|-------------------------|---|
| Arsenic | 0.03 | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 2360 | ≥ 2660 | 3000 |
| Total | 4230 | ≥ 4615 | 5000 |

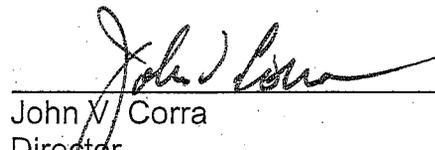
| | | | |
|------------------------|-----|-------|-----------------|
| Dissolved Solids (TDS) | | | |
| pH | 6.9 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Trigger values, specific to the groundwater samples at each impoundment, have been assigned to each constituent and are also listed above. If one or more of these trigger values is exceeded during a quarterly sampling event, monthly sampling of the groundwater for all listed parameters is required, with the analytical results due by the 15th day of each month. If groundwater monitoring reveals a pH measurement of 6.5 or less, the WDEQ may require sampling and analysis of groundwater for the following additional parameters: aluminum, boron, cadmium, chromium, copper, lead and zinc.

The analytical results for each sampling event, along with impoundment and monitor well location information must be submitted in the Excel spread sheet "Compliance Monitoring Data Reporting", which can be found on the WDEQ website at the following address: (<http://deq.state.wy.us/wqd/groundwater/pollution.asp>). These data shall be submitted electronically on the due dates established above to the following department address: cbmgroundwater@state.wy.us. In addition, the accompanying analytical laboratory reports must also be submitted either electronically (pdf format) or hard copy via mail to the WDEQ, Sheridan office at the address listed above.

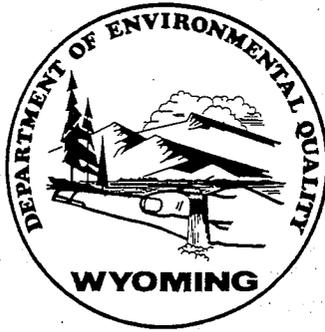
AUTHORIZED BY:


 John F. Wagner
 Administrator
 Water Quality Division


 John V. Corra
 Director
 Department of Environmental Quality

3/10/06
 Date of Issuance

TW/jc/6-0214



GROUNDWATER PROGRAM
REVIEW COMMENTS:
PLANS/SPECIFICATIONS/PROPOSALS/REPORTS

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
1866 South Sheridan Avenue
Sheridan, WY 82801
Phone: 307-672-6457

PERMIT TYPE: CBM: Groundwater Compliance Monitoring Program

WATER QUALITY DIVISION REFERENCE (PERMIT) NUMBER: 06-098

SITE (POD) NAME: Recluse 18-1, Campbell County, WY

APPLICANT: Kennedy Oil
Attn: Tami Henry
700 West Sixth Street
Gillette, Wyoming 82716

CONSULTANT: Goolsby, Finley & Associates
Attn: Mr. Andy Finley, PG
159 North Wolcott STE 125
Casper, WY 82601

LOCATION: Drainage: Intermittent tributary of Bitter Creek a northwest trending tributary of the Powder River
County: Campbell
Township 56 North; Range 73 West; Section 18

DATE ON REPORT: February 22, 2006

REVIEWING OFFICIAL: Terry Webster, North District Groundwater Sen. Analyst

DATE OF THIS REVIEW: February 23, 2006

ACTION: Compliance Monitoring Plan authorized for Recluse 18-1 pursuant to conditions on permit # 06-098

COMMENTS: GROUNDWATER SECTION

1.0 SITE SUMMARY:

1.1 Site Description

Watershed Name: Intermittent tributary to Bitter Creek a northwest trending tributary of the Powder River

Type of Impoundment(s)

_____ "Off channel "
One "On channel"

Groundwater Classification:

Class 1 (domestic) _____
Class 2 (irrigation) _____
Class 3 (agricultural) one

Basis for Classification: Laboratory analysis of groundwater indicates ambient water quality at both impoundments meets Water Quality Rules and Regulations Chapter 8 Class III standards (Table 1- Chapter 8).

Name of Impoundment covered under Permit 06-098

| Impoundment Name | Capacity (acre/ft) | Qtr Qtr | Section | Township | Range |
|------------------|--------------------|---------|---------|----------|-------|
| Recluse 18-1 | 12.07 | NWSW | 18 | 56 N | 73 W |

1.2 Hydrogeology & Review

Class III groundwater was encountered in monitoring well Recluse MW18-1, located immediately below and down the topographic gradient to the northwest of impoundment Recluse 18-1. The well was screened from 70 to 100 feet in a 26 foot thick sand formation. The SWL was 70 feet below ground surface and does not appear to have risen above the screened interval. Two additional monitoring wells, Recluse MW18-1B to the northeast and Recluse MW18-1A to the southwest, were drilled adjacent to and approximately 100 feet from MW18-1 on the sides of the drainage. Both these wells were drilled to 150 feet and both were dry. Sand and sandstone units were found in both wells at the approximate depth that groundwater would have been expected.

The dry holes to a depth of 150 feet in the immediate vicinity of MW18-1 and the lack of a rise in the static water level above the screened interval indicate that the aquifer is confined but not under measurable pressure head in a

narrow zone of saturated material. Given the lack of pressure head and the small aerial extent of the aquifer it is believed that if seepage from the impoundment reaches the groundwater it will be detected in the well even if the groundwater flow direction is not down the topographic gradient toward the well.

No further monitoring wells will be required at the site and monitoring wells Recluse MW18-1A and 1B may be plugged and abandoned.

The laboratory monitoring report for well MW18-1 indicated high levels of metals (Al 219 mg/L, Cr 0.31 mg/L, Pb 0.190 mg/L, Hg 0.0006 mg/L) and a low pH (6.92 s.u.). The lab report indicated that there was increased matrix interference in a number of the results. The well purging data indicated that the turbidity was measured at 20 NTUs prior to sampling, which is consistent with the Groundwater Program requirements. Upon inquiry to the laboratory that did the analysis it was determined that the sample required digestion prior to analysis and that this fact and other indicators suggested to laboratory personnel that the sample contained sediment in excess of 20 NTUs. The metals analysis from this sample should not in the future be used as ambient concentrations.

2.0 MONITORING AND REPORTING REQUIREMENTS

Groundwater monitoring at the impoundments shall be performed on a quarterly basis until further notice and shall include the following information:

- Measurement of static water level and sampling and analysis of groundwater at well Recluse MW18-1.
- Reporting results of quarterly monitoring and sampling need to be at the department by January 15th, April 15th, July 15th, and October 15th of each year. The first set of data will be due by April 15, 2006.
- The parameters listed in the tables below are required for groundwater compliance monitoring beneath the listed impoundment:

Impoundment Recluse 18-1

| Parameter | Recluse MW18-1 Background Value (mg/L) (12/21/04) | Trigger Value (mg/L) | Class III Water Quality Standards (mg/L) |
|------------------------------------|--|-------------------------|---|
| Arsenic | 0.03 | ≥ 0.16 | 0.2 |
| Selenium | <0.005 (ND) | ≥ 0.04 | 0.05 |
| Sulfate | 2360 | ≥ 2660 | 3000 |
| Total Dissolved Solids (TDS) | 4230 | ≥ 4615 | 5000 |
| pH | 6.9 | ≤ 6.5 | 6.5 – 8.5 (s.u) |

Trigger values, specific to the groundwater samples at this impoundment, have been assigned to each constituent and are also listed above. If one or more of these trigger values is exceeded during a quarterly sampling event, monthly sampling of the groundwater for all listed parameters is required, with the analytical results due by the 15th day of each month. If groundwater monitoring reveals a pH measurement of 6.5 or less, the WDEQ may require sampling and analysis of groundwater for the following additional parameters: aluminum, boron, cadmium, chromium, copper, lead and zinc.

The analytical results for each sampling event, along with impoundment and monitor well location information must be submitted in the Excel spread sheet "Compliance Monitoring Data Reporting", which can be found on the WDEQ website at the following address: (<http://deq.state.wy.us/wqd/groundwater/pollution.asp>). These data shall be submitted electronically on the due dates established above to the following department address: cbmgroundwater@state.wy.us. In addition, the accompanying analytical laboratory reports must also be submitted either electronically (pdf format) or hard copy via mail to the WDEQ, Sheridan office at the address listed above.

END OF REVIEW

TW/jc/6-0215

WYOMING DEPARTMENT OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION
PERMIT TO CONSTRUCT

PERMIT NO. 06-099

PWS #WY5600492N

Spotted Horse Ranch Chlorination System

This permit hereby authorizes the applicant:

Kevin Watkins, President
Spotted Horse Ranch, Inc.
12355 South Hwy 191
Jackson, WY 83001

to install two pellet type chlorinators on two existing wells that serve a campground; according to the procedures and conditions of the application number 06-099. The facility is located within Section 32, Township 39 North and Range 115 West in the county of Teton, in the State of Wyoming. All construction, installation, or modification allowed by this permit shall be completed by June 30, 2006.

The issuance of this permit confirms that the Wyoming Department of Environmental Quality (DEQ) has evaluated the application submitted by the permittee and determined that it meets minimum applicable construction and design standards. The compliance with construction standards and the operation and maintenance of the facility to meet the engineer's design are the responsibility of the permittee, owner, and operator.

Granting this permit does not imply that DEQ guarantees or ensures that the permitted facility, when constructed, will meet applicable discharge permit conditions or other effluent or operational requirements. Compliance with discharge standards remains the responsibility of the permittee.

Nothing in this permit constitutes an endorsement by DEQ of the construction or the design of the facility described herein. This permit verifies only that the submitted application meets the design and construction standards imposed by Wyoming statutes, rules and regulations. The DEQ assumes no liability for, and does not in any way guarantee or warrant the performance or operation of the permitted facility. The permittee, owner and operator are solely responsible for any liability arising from the construction or operation of the permitted facility. By issuing this permit, the State of Wyoming does not waive its sovereign immunity.

The permittee shall allow authorized representatives from DEQ to enter and inspect any property, premise or place on or at which the facility is located or is being constructed or installed for the purpose of investigating actual or potential sources of water pollution, and for determining compliance or non-compliance with any rules, regulations, standards, permits or orders.

Nothing in this permit shall be construed to preclude the institution of any legal action or other proceeding to enforce any applicable provision of law or rules and regulations. It is the duty of the permittee, owner and operator to comply with all applicable federal, state and local laws or regulations in the exercise of its activities authorized by this permit.

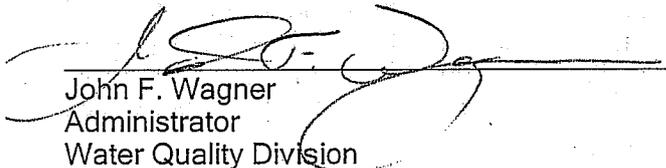
The issuance of this permit does not convey any property rights in either real or personal property or any invasion of personal rights, or any infringement of federal, state or local laws or regulations.

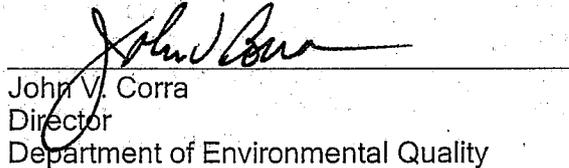
The permittee shall construct and operate the permitted facility in accordance with the statements, representations, procedures, terms and conditions of the permit application, supporting documents and permit. This permit does not relieve the permittee from any duty to obtain any other permit or authorization that may be required by any provision of federal, state or local laws.

In carrying out its activities authorized by this permit, the permittee, owner and operator shall comply with all of the following permit conditions:

- 1 of 3 The applicant will provide immediate oral or written notice to the Wyoming Department of Environmental Quality, Water Quality Division (WQD), Northwest District Engineer, 510 Meadowview Drive, Lander, WY 82520, 307-332-3144, FAX 307-332-3183, in accordance with the provisions of Section 11, Chapter 3, Wyoming Water Quality Rules and Regulations of any changes or modifications which are not consistent with the terms and conditions of this permit.
- 2 of 3 Within sixty days of completion of construction of the authorized facility, the applicant will submit to the Northwest District a certification of completion signed by the Engineer of Record or the owner. A form titled "Certificate of Completion" has been provided.
- a. Date that construction of the facility was completed; and
 - b. Date that the facility was placed in operation; and
 - c. Certification the facility was constructed in accordance with the terms and conditions of the permit; or
 - d. Certification the facility was completed with changes or modifications. Submittal of as-constructed plans and specifications for the system as it was constructed, certified by an engineer if appropriate is required. All modifications or deviations from the authorized plans must be highlighted.
- 3 of 3 The review and approval of this permit is based upon the items identified in the attached "Statement of Basis".

AUTHORIZED BY:


John F. Wagner
Administrator
Water Quality Division


John V. Corra
Director
Department of Environmental Quality

3/21/06
Date of Issuance
JRW 3/20/06
JSB/jsb/jc/6-0229

STATEMENT OF BASIS

1. Permit Number: 06-099
2. Application reviewed for compliance with the following regulations:
Chapters 3, and 12 of the Wyoming Water Quality Rules and Regulations.
3. Does the permit comply with all applicable regulations identified above?
Yes
4. Facilities include components not specifically covered by regulations and approval is based upon a deviation from applicable regulations in accordance with Section 5 of applicable regulations.
No
5. If Section 17 of Chapter 3 review is required indicate the basis for determining groundwater will be protected.
Public water systems are exempted from review by Chapter 3, Section 17.
6. Documentation of Statement of Basis: The archives file for this permit includes adequate documentation of all sections of this Statement of Basis.

CERTIFICATION


The issuance of this permit is based upon a review of the application package submitted in accordance with the requirements of Chapter 3, Section 6, Wyoming Water Quality Rules and Regulations. This review was performed by James S. Brough, jbroug@state.wy.us, Environmental Engineer and completed on March 17, 2006. Permit issuance is recommended based upon statements, representations, and procedures presented in the permit application and supporting documents permit conditions, and the items identified in this "Statement of Basis."

Xc: Jerald B. Crews, P.E., Cardinal Design Group, 405 South 7th Street East, Riverton, WY 82501

F:\DIVISION\WQDI\WPI\2006 Permits & Reviews\06-099.pc.jsb.doc



Department of Environmental Quality



To protect, conserve and enhance the quality of Wyoming's environment for the benefit of current and future generations.

Dave Freudenthal, Governor

John Corra, Director

NOTIFICATION OF COVERAGE

March 2, 2006

Bill Nielson, Chairman
Mountain Holding, Inc.
1825 Big Horn Ave.
Cody, WY 82414

RE: Panorama View III Addition - Cody Canal Sanitary Sewer Interceptor Main, Permit Number: 06-100, Section 1, T52N, R102W, Park County

Dear Mr. Nielson:

DEQ understands that this sewer line will serve 46 residential connections in the Panorama View III Addition, however, and further additions may require upgrades of some of the city's existing sewer mains. The above application for coverage under General Permit to construct approximately 3,000 linear feet of 8-inch PVC sewer line, extension of a sewage collection system, in accordance with Chapter 3, Section 7; and Chapter 11, Section 9 of the Wyoming Water Quality Rules and Regulations has been reviewed and is hereby approved.

You are authorized to construct, the facility in accordance with the general permit and the materials submitted in your application package. Your attention is directed to the mandatory reporting requirements outlined in Part V, Section O of the general permit.

If you have any questions, please contact James Brough at 307-332-3144.

Sincerely,

James Brough, P.E.
Environmental Engineer
Water Quality Division

xc: IPS, Cheyenne
Jeremy A. Easum, P.E., Sage Civil Engineering, 2824 Big Horn Ave., Cody, WY 82414
Stephen W. Payne, P.E., City of Cody's Public Works Director

encl: General Permit an Existing Sewage Collection System

Lander Field Office • 510 Meadowview Drive • Lander, WY 82520 • <http://deq.state.wy.us>

ABANDONED MINES
(307) 332-5085
FAX 332-7726

AIR QUALITY
(307) 332-6755
FAX 332-7726

LAND QUALITY
(307) 332-3047
FAX 332-7726

SOLID & HAZARDOUS WASTE
(307) 332-6924
FAX 332-7726

WATER QUALITY
(307) 332-3144
FAX 332-3183

